Installation and service
instructions

Installation, service and
maintenance instructions
for low voltage air circuit-breakers

1SDH000532R0002 L2564

Emax UL Listed

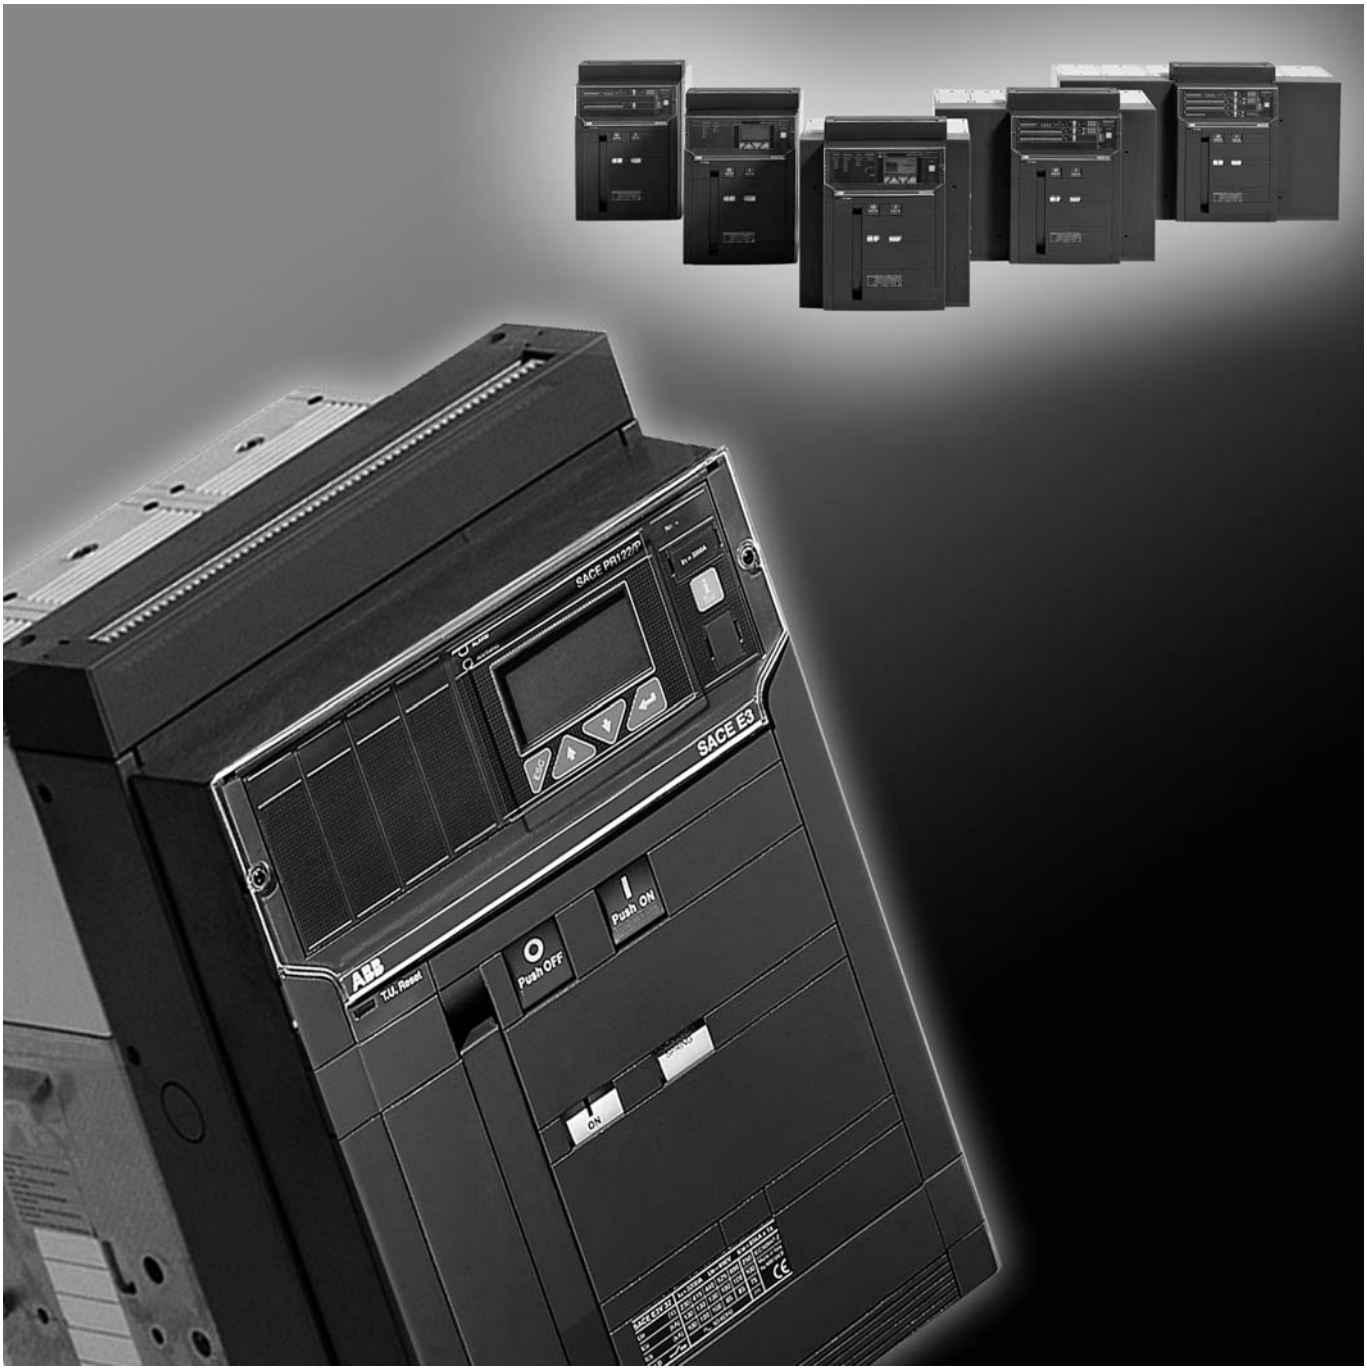

ABB SACE

Dwg.		Resp.Off.		Title **Installation, service and maintenance instructions for low voltage air circuit-breakers**	Language **en**
App.		Take-over Off.			
Model	L2564			Apparatus **Emax UL**	Scale
ABB	**ABB SACE**			Doc.No. **1SDH000532R0002**	

Index

1. Description ..... *page* 6
1.1 General characteristics ..... « 6
1.2 External front view of the circuit-breaker ..... « 6
1.3 Circuit-breaker rating plate ..... « 6
1.4 Moving part construction characteristics ..... « 6
1.5 Fixed part construction characteristics ..... « 7

2. Checking on receipt ..... « 7

3. Storage, lifting and weights ..... « 7

4. Installation ..... « 8
4.1 Installation room ..... « 8
4.2 Installation of the fixed circuit-breaker ..... « 8
4.3 Installation of the fixed part of the withdrawable circuit-breaker ..... « 8
4.3.1 Preparation of the fixed part ..... « 8
4.3.2 Installation of the fixed part ..... « 9
4.3.3 Installation of the fixed part on board a ship ..... « 9
4.4 Installation of the flange on the compartment door ..... « 10

5. Electrical connections ..... « 10
5.1 Connections to the power circuit ..... « 10
5.1.1 Shapes of the terminals ..... « 10
5.1.2 Examples of positioning the connection busbars according to the types of terminal ..... « 11
5.1.3 Assembly procedure for the connection busbars ..... « 12
5.2 Earthing ..... « 12
5.3 Wiring the circuit-breaker auxiliary circuits ..... « 12
5.3.1 Interfacing elements for fixed circuit-breakers ..... « 12
5.3.2 Withdrawable circuit-breaker ..... « 13
5.4 Conversion of the auxiliary contacts or of the position contacts from normally closed (opening) to normally open (closing) or vice versa ..... « 14

6. Putting into service ..... « 15
6.1 General procedures ..... « 15

7. Instructions for use ..... « 16
7.1 Operating and signalling parts ..... « 16
7.2 Circuit-breaker closing and opening procedures ..... « 17
7.3 Racking-in/out operation ..... « 18

8. Maintenance ..... « 19
8.1 Warning ..... « 19
8.2 Maintenance program ..... « 20
8.3 Maintenance operations ..... « 20
8.3.1 Preliminary operations ..... « 20
8.3.2 General inspection of the circuit-breaker ..... « 21
8.3.3 Checking contact wear ..... « 21
8.3.4 Operating mechanism maintenance ..... « 22
8.3.5 Circuit-breaker maintenance ..... « 22

9. Measures to be taken for any operating anomalies ..... « 23

10. Accessories ..... « 24
10.1 Electrical accessories ..... « 24
10.2 Mechanical accessories ..... « 27
10.3 Spare parts ..... « 27

11. Protection releases- General characteristics ..... « 29
11.1 Safety note ..... « 30
11.1.1 Notes for dielectric stiffness tests ..... « 30
11.2 Abbreviations and notes ..... *page* 30
11.2.1 Abbreviations ..... « 30
11.2.2 Notes ..... « 31

12. SACE PR121/P Release Identification ..... « 32
12.1 Standard ..... « 32
12.2 Specifications ..... « 32
12.2.1 General ..... « 32
12.2.2 Electrical characteristics ..... « 32
12.2.2.1 Self-supply ..... « 32
12.2.2.2 Auxiliary self-supply ..... « 33
12.2.3 Environmental characteristics ..... « 33
12.2.4 Communication bus ..... « 33
12.2.5 Protection functions ..... « 33
12.2.5.1 Rms and peak calculation ..... « 33
12.2.5.2 Watchdog ..... « 33
12.2.6 Description of the protection functions ..... « 33
12.2.6.1 Protection "L" ..... « 33
12.2.6.2 Protection "S" ..... « 34
12.2.6.3 Protection "I" ..... « 34
12.2.6.4 Protection "G" ..... « 34
12.2.6.5 Protection against instantaneous short-circuit "linst" ..... « 34
12.2.7 Summary table of protections ..... « 35
12.2.8 Measurements ..... « 35
12.2.9 Trip curves ..... « 36
12.2.9.1 Trip curves for functions L-I ..... « 36
12.2.9.2 Trip curves for functions L-S(t=k/I2)-I ..... « 36
12.2.9.3 Trip curves for functions L-S(t=k)-I ..... « 37
12.2.9.4 Trip curves for function G ..... « 37
12.3 Other functions ..... « 38
12.3.1 Indication of the cause of the trip and trip test button ..... « 38
12.4 Putting into service ..... « 38
12.4.1 Connections ..... « 38
12.4.2 CS and TC connection test ..... « 38
12.4.3 Current sensor connection for external neutral ..... « 38
12.5 User interface ..... « 38
12.5.1 Trip Test ..... « 39
12.5.2 Initial settings ..... « 39
12.5.3 Changing protection functions ..... « 39
12.5.3.1 Example of setting ..... « 39
12.5.4 PR121/P unit default settings ..... « 40
12.6 Operating instructions / Operation in service ..... « 40
12.6.1 Neutral adjustment ..... « 40
12.6.2 Table of neutral adjustments ..... « 40
12.6.3 Replacing an electronic release ..... « 40
12.6.4 Uninstalling the electronic release ..... « 40
12.7 Definition of alarms and signals in the PR121/P unit ..... « 41
12.7.1 Optical signals ..... « 41
12.7.2 Troubleshooting ..... « 41
12.7.3 In the case of a fault ..... « 42
12.8 Accessories ..... « 42
12.8.1 ABB SACE PR010/T test and configuration unit ..... « 42
12.8.2 BT030 communication unit ..... « 42
12.8.3 PR021/K and HMI030 units ..... « 42
12.8.4 PR030/B power supply unit ..... « 42

13. SACE PR122/P Release Identification ..... « 43
13.1 Standard ..... « 43
13.2 Specifications ..... « 43
13.2.1 General ..... « 43
13.2.2 Electrical characteristics ..... « 44
13.2.2.1 Self-supply ..... « 44

13.2.2.2 Auxiliary power supply ..... *page* 44
13.2.2.3 Powered by the PR120/V module ..... « 44
13.2.3 Environmental characteristics ..... « 44
13.2.4 Description of inputs/outputs ..... « 44
13.2.4.1 Binary opto-insulated inputs. ..... « 44
13.2.4.2 Binary opto-insulated outputs ..... « 44
13.2.5 Communication bus ..... « 45
13.2.6 Protection functions ..... « 45
13.2.6.1 Rms and peak calculation ..... « 45
13.2.6.2 Mains frequency ..... « 45
13.2.6.3 Harmonic distortion ..... « 45
13.2.6.4 Circuit-breaker state ..... « 45
13.2.7 Measurement functions ..... « 45
13.2.8 Watchdog ..... « 46
13.2.9 Description of the protection functions ..... « 46
13.2.9.1 Protection "L" ..... « 46
13.2.9.1.1 Thermal memory "L" ..... « 46
13.2.9.2 Protection "S" ..... « 46
13.2.9.2.1 Thermal memory "S". ..... « 46
13.2.9.2.2 Start-up threshold "S" ..... « 47
13.2.9.2.3 Zone selectivity "S" ..... « 47
13.2.9.3 Protection "I" ..... « 48
13.2.9.3.1 Start-up threshold "I " ..... « 48
13.2.9.4 Protection "G" ..... « 48
13.2.9.4.1 Start-up threshold "G" ..... « 48
13.2.9.4.2 Zone selectivity "G" ..... « 48
13.2.9.5 Protection against phase unbalance "U" ..... « 48
13.2.9.6 Protection against overtemperature inside the relay, "OT" ..... « 49
13.2.9.7 Load control function ..... « 49
13.2.9.8 Voltage protections "UV", "OV", "RV" ..... « 49
13.2.9.8.1 Protection "UV" ..... « 49
13.2.9.8.2 Protection "OV" ..... « 49
13.2.9.8.3 Protection "RV" ..... « 49
13.2.9.9 Protection against reverse active power "RP". ..... « 50
13.2.9.10 Frequency protections "UF", "OF" ..... « 50
13.2.9.11 Summary table of the protection function settings for the PR122/P ..... « 51
13.2.9.11.1 Summary of the additional protection functions for the PR122/P with the optional PR120/V module« 52
13.2.9.11.2 Table of measurements ..... « 52
13.2.10 Trip curves ..... « 53
13.2.10.1 Trip curves for functions L-I ..... « 53
13.2.10.2 Trip curves for functions L-S(t=k/I2)-I ..... « 53
13.2.10.3 Trip curves for functions L-S(t=k)-I ..... « 54
13.2.10.4 Trip curves for function G ..... « 54
13.2.10.5 Trip curves for function U ..... « 55
13.2.10.6 Trip curves for function UV ..... « 55
13.2.10.7 Trip curves for function OV ..... « 56
13.2.10.8 Trip curves for function RV ..... « 56
13.2.10.9 Trip curves for function RP ..... « 57
13.3 Putting into service ..... « 58
13.3.1 Connections ..... « 58
13.3.1.1 Current sensor connection for external neutral..... « *58*
13.3.2 VT connections ..... « 58
13.3.3 CS and TC connection test ..... « 59
13.3.4 Test ..... « 59
13.3.5 Initial settings ..... « 59
13.3.6 Password management ..... « 59
13.3.7 Replacing an electronic release ..... « 59
13.3.7.1 Installation ..... « 59
13.3.7.2 Uninstalling. ..... « 60
13.4 User interface ..... « 61
13.4.1 Use of pushbuttons ..... « 62
13.4.2 Read and Edit modes ..... *page* 62
13.4.3 Changing parameters ..... « 62
13.4.3.1 Modification of basic configuration ..... « 64
13.4.4 Default settings. ..... « 66
13.5 Operating instructions / Operation in service ..... « 67
13.5.1 Menu ..... « 67
13.5.2 Protections Menu ..... « 68
13.5.2.1 Protections Menu table ..... « 68
13.5.3 Measurements Menu ..... « 71
13.5.3.1 Measurements Menu table ..... « 71
13.5.4 Settings Menu ..... « 71
13.5.4.1 Settings Menu table ..... « 71
13.5.4.2 Neutral adjustments ..... « 72
13.5.4.2.1 Neutral adjustments table ..... « 72
13.5.4.3 Mains frequency settings ..... « 72
13.5.4.4 Modules. ..... « 72
13.5.4.4.1 PR120/V MEASURING module ..... « 72
13.5.4.4.2 PR120/D-M - COM module ..... « 73
13.5.4.4.3 PR120/K - SIGNALLING module ..... « 73
13.5.4.4.4 PR120/D WL-COM module ..... « 73
13.5.4.4.5 Settings for the Local Bus unit ..... « 73
13.5.5 Test Menu ..... « 73
13.5.5.1 Test Menu table ..... « 73
13.5.6 Information Menu ..... « 74
13.5.6.1 Information on the trip and opening data ..... « 74
13.6 Definition of alarms and signals in the PR122/P unit « 74
13.6.1 Optical signals ..... « 74
13.6.2 Electrical signals ..... « 74
13.6.3 Table of error and warning messages ..... « 75
13.6.4 Error messages displayed in pop-up windows ..... « 77
13.7 Troubleshooting PR122/P unit ..... « 78
13.7.1 In the case of a fault ..... « 78
13.8 Accessories ..... « 78
13.8.1 ABB SACE PR010/T test and configuration unit ..... « 78
13.8.2 ABB SACE PR030/B power supply unit ..... « 78
13.8.3 BT030 wireless communication unit ..... « 78

14. SACE PR123/P Release Identification ..... « 79
14.1 Standard ..... « 79
14.2 Specifications ..... « 79
14.2.1 General ..... « 79
14.2.2 Electrical characteristics ..... « 80
14.2.2.1 Self-supply ..... « 80
14.2.2.2 Auxiliary power supply ..... « 80
14.2.2.3 Powered by the PR120/V module ..... « 80
14.2.3 Environmental characteristics ..... « 80
14.2.4 Description of inputs/outputs ..... « 80
14.2.4.1 Binary opto-insulated inputs ..... « 80
14.2.4.2 Binary opto-insulated outputs ..... « 80
14.2.5 Communication bus ..... « 80
14.2.6 Protection functions ..... « 80
14.2.6.1 Rms and peak calculation ..... « 81
14.2.6.2 Mains frequency ..... « 81
14.2.6.3 Harmonic distortion ..... « 81
14.2.6.4 Circuit-breaker state. ..... « 81
14.2.7 Measurement functions ..... « 81
14.2.8 Watchdog ..... « 81
14.2.9 Description of the protection functions ..... « 82
14.2.9.1 Protection "L" ..... « 82
14.2.9.1.1 Thermal memory "L" ..... « 82
14.2.9.2 Protection "S" ..... « 82
14.2.9.2.1 Thermal memory "S" ..... « 82
14.2.9.2.2 Start-up threshold "S" ..... « 82

14.2.9.2.3 Zone selectivity "S" ..... *page* 83
14.2.9.3 Double S ..... « 83
14.2.9.4 Directional Protection "D" ..... « 83
14.2.9.4.1 Start-up threshold "D " ..... « 84
14.2.9.4.2 "D" (directional) zone selectivity ..... « 84
14.2.9.5 Protection "I" ..... « 85
14.2.9.5.1 Start-up threshold "I " ..... « 85
14.2.9.6 Protection "G" ..... « 85
14.2.9.6.1 Start-up threshold "G" ..... « 86
14.2.9.6.2 Zone selectivity "G" ..... « 86
14.2.9.7 Protection against phase unbalance "U" ..... « 86
14.2.9.8 Protection against overtemperature inside the relay, "OT" ..... « 86
14.2.9.9 Load control function ..... « 87
14.2.9.10 Voltage protections "UV", "OV", "RV" ..... « 87
14.2.9.10.1 Protection "UV"
14.2.9.10.2 Protection "OV" ..... « 87
14.2.9.10.3 Protection "RV" ..... « 87
14.2.9.11 Protection against reverse active power "RP" ..... « 87
14.2.9.12 Frequency protections UF, OF ..... « 87
14.2.9.13 Double protections setting ..... « 87
14.2.9.14 Summary table of the protection function settings for the PR123/P ..... « 88
14.2.9.15 Table of measurements ..... « 89
14.2.10 Trip curves ..... « 90
14.2.10.1 Trip curves for functions L-S(t=k/I2)-I ..... « 90
14.2.10.2 Trip curves for functions L-S(t=k)-I ..... « 90
14.2.10.3 Trip curves for function G ..... « 91
14.2.10.4 Trip curves for function D ..... « 91
14.2.10.5 Trip curves for function U ..... « 92
14.2.10.6 Trip curves for function UV ..... « 92
14.2.10.7 Trip curves for function OV ..... « 93
14.2.10.8 Trip curves for function RV ..... « 93
14.2.10.9 Trip curves for function RP ..... « 94
14.3 Putting into service ..... « 95
14.3.1 Connections ..... « 95
14.3.1.1 Current sensor connection for external neutral..... « *95*
14.3.2 VT connections ..... « 95
14.3.3 CS and TC connection test ..... « 96
14.3.4 Test ..... « 96
14.3.5 Initial settings ..... « 96
14.3.6 Password management ..... « 96
14.3.7 Replacing an electronic release ..... « 96
14.3.7.1 Installation ..... « 96
14.3.7.2 Uninstalling ..... « 97
14.4 User interface ..... « 98
14.4.1 Use of pushbuttons ..... « 99
14.4.2 Read and Edit modes ..... « 99
14.4.3 Changing parameters ..... « 99
14.4.3.1 Modification of basic configuration ..... « 101
14.4.4 Default settings ..... « 103
14.5 Operating instructions / Operation in service ..... « 104
14.5.1 Menu ..... « 104
14.5.2 Protections Menu ..... « 105
14.5.2.1 Protections Menu table ..... « 105
14.5.3 Measurements Menu ..... « 108
14.5.3.1 Measurements Menu table ..... « 108
14.5.4 Settings Menu ..... « 108
14.5.4.1 Settings Menu table ..... « 109
14.5.4.2 Adjusting the neutral ..... « 109
14.5.4.2.1 Neutral adjustments table ..... « 109
14.5.4.3 Mains frequency settings ..... « 110
14.5.4.4 Modules ..... « 110
14.5.4.4.1 PR120/V module ..... *page* 110
14.5.4.4.2 PR120/D-M - COM module ..... «110
14.5.4.4.3 PR120/K module ..... «110
14.5.4.4.4 PR120/D WL-COM module ..... «110
14.5.4.4.5 Settings for the Local Bus unit ..... «110
14.5.5 Test Menu ..... «110
14.5.5.1 Test Menu table ..... «111
14.5.6 Information Menu ..... «111
14.5.6.1 Information on the trip and opening data ..... «111
14.6 Definition of alarms and signals in the PR123/P unit «112
14.6.1 Optical signals ..... «112
14.6.2 Electrical signals ..... «112
14.6.3 Table of error and warning messages ..... «112
14.6.4 Error messages displayed in pop-up windows. ..... «113
14.7 Troubleshooting PR123/P unit ..... «114
14.7.1 In the case of a fault ..... «115
14.8 Accessories ..... «115
14.8.1 ABB SACE PR010/T test and configuration unit ..... «115
14.8.2 ABB SACE PR030/B power supply unit ..... «115
14.8.3 BT030 wireless communication unit ..... «115

15 Modules ..... «116
15.1 PR120/V - MEASURING Module ..... «116
15.1.1 General characteristics ..... «116
15.1.2 Front view ..... «116
15.1.3 Releases complete with the module . ..... «116
15.1.4 Powering the PR122/P and PR123/P units via the PR120/V module ..... «116
15.1.5 Operating instructions / Operation in service ..... «117
15.1.5.1 Using the Measurement submenus with the PR120/V ..... «117
15.1.5.2 Table of submenus for the PR120/V module ..... «119
15.1.5.3 Measurements Menu table ..... «119
15.1.5.4 Measurements menu ..... «120
15.1.5.4.1 Historicals ..... «120
15.1.5.4.2 Trips. ..... «120
15.1.5.4.3 Events . ..... «120
15.1.5.4.4 Measurements ..... «120
15.1.5.4.5 Power factor ..... «120
15.1.5.4.6 Energy ..... «121
15.1.5.4.7 Peak factor ..... «121
15.1.5.4.8 Mains frequency ..... «121
15.1.5.4.9 Contact wear ..... «121
15.1.5.4.10 Waveforms ..... «121
15.1.6 Data logger ..... «121
15.1.7 Electrical characteristics of the transformers ..... «122
15.2 PR120/D-M - COM communication module ..... «123
15.2.1 General characteristics ..... «123
15.2.2 Front view ..... «123
15.2.3 Releases complete with the module ..... «123
15.2.4 Power supply ..... «123
15.2.5 Connection ..... «123
15.2.6 Communication functions available ..... «123
15.2.7 PR120/D-M - COM module menu ..... «123
15.3 PR120/K - signalling module ..... «124
15.3.1 General characteristics ..... «124
15.3.2 Front view ..... «124
15.3.3 Releases complete with the module ..... «124
15.3.4 Characteristics of the digital input ..... «124
15.3.5 Characteristics of the signalling contacts ..... «124
15.3.6 Power supply ..... «125
15.3.7 PR120/K module menu ..... «125
15.3.8 Programming contacts K51/p1, K51/p2, K51/p3 and K51/p4 ..... «126

15.3.9 Configurable input ..... *page* 126
15.3.9.1 Input configuration settings ..... « 126
15.3.9.2 Input function settings (ACTION) ..... « 126
15.3.9.3 Setting the input enabling delay ..... « 126
15.3.10 PR120/K module menu layout ..... « 127
15.4 PR120/D-WL-COM wireless communication module ..... « 128
15.4.1 General characteristics ..... « 128
15.4.2 Front view ..... « 128
15.4.3 Releases complete with the module ..... « 128
15.4.4 Power supply. ..... « 128
15.4.5 Connection ..... « 128

16 Appendices ..... « 129
16.1 PR021/K outside signalling unit ..... « 129
16.1.1 General information ..... « 129
16.1.2 Power supply ..... « 129
16.1.3 General characteristics of the signalling relays ..... « 129
16.1.4 Relay functions ..... « 129
16.1.5 PR021/K signalling unit menu ..... « 129
16.1.5.1 PR021/K unit menu table ..... « 130
16.1.5.2 Important note ..... « 130
16.2 SD-Pocket ..... « 131
16.3 SD-Testbus ..... « 131
16.4 Data logger (recorder) ..... « 132
16.4.1 General characteristics ..... « 132
16.4.2 Description of the data logger menu ..... « 132
16.4.2.1 Data logger enabled ..... « 132
16.4.2.2 Setting the sampling frequency ..... « 132
16.4.2.3 Setting the standard stop events (triggers) ..... « 133
16.4.2.4 Setting and viewing customized stop events (triggers) ..... « 133
16.4.2.5 Setting the stopping delay ..... « 133
16.4.2.6 Restart/Stop data logger ..... « 133
16.4.3 Recording time windows ..... « 133
16.4.4 Description of the information given by the data logger system ..... « 134
16.4.4.1 Combination of devices for reading/setting data from the data logger system ..... « 134
16.4.4.2 Access to saved data from the system ..... « 134
16.4.4.3 Information from the system on the configuration and status of the data logger ..... « 135
16.4.5 Data logger commands from the system ..... « 135
16.5 Table showing list of events ..... « 136
16.5.1 "Standard" events for PR120/K and for PR121/K selectable from the relay ..... « 136
16.5.2 "Standard" events for the data logger function, selectable from the relay ..... « 136
16.5.3 Examples of "Custom" events for the data logger function, for PR120/K and PR021/K ..... « 136
16.5.4 Combining the devices needed to customize settings ..... « 136

17. Overall dimensions ..... « 137

18. Circuit diagrams ..... « 156

1. Description

1.1 General Characteristics

The SACE Emax series of circuit-breakers consists of a steel sheet structure, which houses the operating mechanism, the poles and the auxiliary parts. Each pole, insulated from the others, contains the circuit-breaking parts and the current sensor of the corresponding phase. The structure of the poles differs according to whether the circuit-breaker is selective or current-limiting.
The fixed version circuit-breaker has its own terminals for connection to the power circuit; in the withdrawable version the circuit-breaker comprises the moving part of the apparatus, which is completed with a fixed part fitted with the terminals for connection to the power circuit of the installation. The moving part and the fixed part are coupled by means of special contacts installed in the fixed part.

1.2 External front view of the circuit-breaker

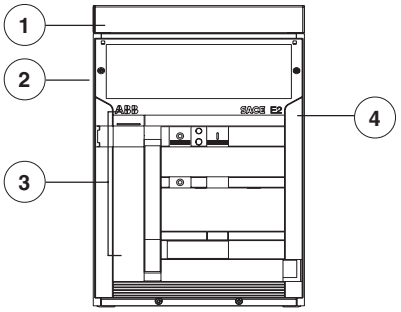

1 PR121, PR122 or PR123 electronic microprocessor-based release
2 Trademark
3 Operating and control parts of the operating mechanism and release tripped signals
4 Rating plate

Fixed circuit-breaker

Fig. 1

1.3 Circuit-breaker rating plate

SACE E2B-A 16	1600A			Frame Size	
Rated Maximum Voltage (V)	254	508	635	ANSI C37.13	UL LISTED Low-Voltage AC Power Circuit - Breaker 63FA
Rated Short-Circuit Current (kA)	42	42	42		
Rated Short Time Current (kA)	42	42	42		
Rated Frequency (Hz)	50-60				

Fig. 2

1.4 Moving part construction characteristics

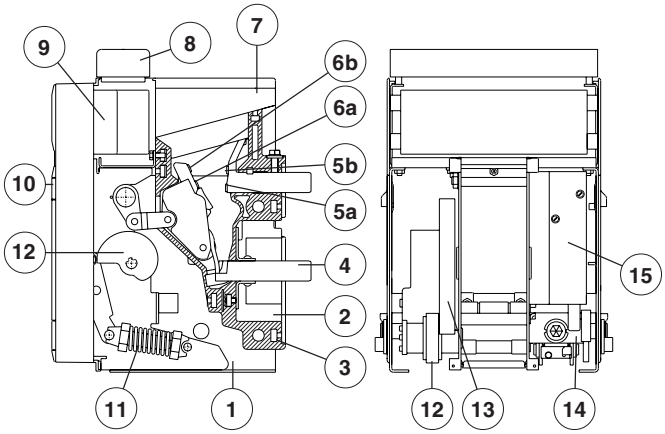

Selective circuit-breaker

1 Supporting structure made of steel sheet
2 Current sensor for protection release
3 Terminal supporting molded case /insulating box
4 Horizontal rear terminals
5a Main fixed contact plates
5b Fixed arcing contact plates
6a Main moving contact plates
6b Moving arcing contact plates
7 Arcing chamber
8 Terminal box for the fixed version-Sliding contacts for the withdrawable version
9 Protection release
10 Circuit-breaker closing and opening mechanism
11 Closing springs
12 Spring loading geared motor (on request)
13 Lever for manually loading the closing springs
14 Racking-out device (only for withdrawable circuit breakers)
15 Service releases (shunt closing release, shunt opening release, under-voltage release) (on request)

Fig. 3

1.5 Fixed part construction characteristics

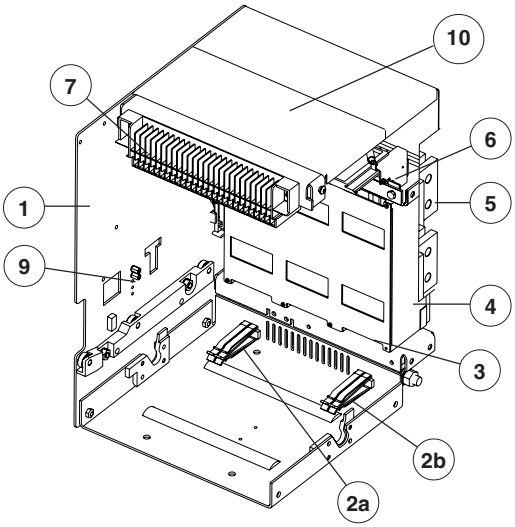

LOW switching power



1 Steel sheet supporting structure
2 Earthing contacts (a: for all versions; b: for E4, E6)
3 Safety shutters (IP20 degree of protection)
4 Insulating terminal support base
5 Terminals
6 Contacts for signalling connected/test isolated/ disconnected (on request)
7 Sliding contacts
8 Padlock for safety shutters (on request)
9 Anti-racking-in lock for circuit-breakers of different size
10 Casing
11 Insulation

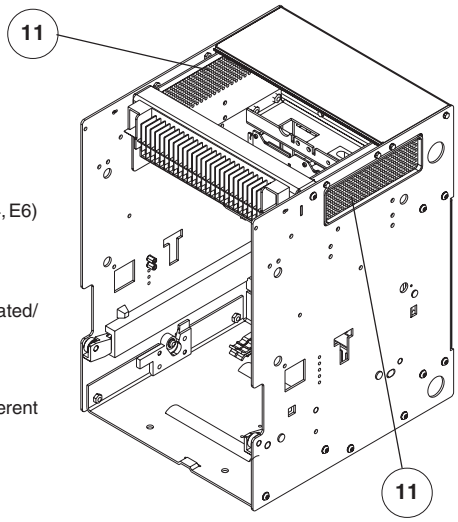

HIGH switching power

		E1		E2				E3				E4					E6		
		B-A	N-A	B-A	N-A	S-A	H-A	N-A	S-A	H-A	V-A	S-A	H-A	V-A	L-A	H-A/f	H-A	V-A	L-A
LOW switching power	RH TERMINALS	-	-	OK	OK	-	-	OK	MAX 2500	-	-	OK	OK	-	-	OK	OK	-	-
	RV TERMINALS	-	-	OK	OK	-	-	OK	OK	-	-	OK	OK	-	-	OK	OK	-	-
	Mixed TERMINALS	-	-	OK	OK	-	-	OK	MAX 2500	-	-	OK	OK	-	-	OK	OK	-	-
HIGH switching power	RH TERMINALS	OK	OK	-	-	OK	OK	-	-	MAX 2500	MAX 2500	-	-	OK	OK	-	-	OK	OK
	RV TERMINALS	OK	OK	-	-	OK	OK	-	-	OK	OK	-	-	OK	OK	-	-	OK	OK
	Mixed TERMINALS	OK	OK	-	-	OK	OK	-	-	MAX 2500	MAX 2500	-	-	OK	OK	-	-	OK	OK

Fig. 4

2. Checking on receipt

Examine the state of the material received and its consistency with the content of the order. Should any damage or errors be found on unpacking, which must be carried out carefully, make the relative notification within and not over 5 days from the receipt of the material. The notification must indicate the number of the shipping note.

3. Storage, lifting and weights

The circuit-breaker, protected by an external wooden crate, is fixed by means of screws to the transport pallet or to the bottom of the packing case. If the circuit-breaker has to remain in the warehouse even for a short time before being put into service, after checking it on receipt, it must be put back in its container and covered with a waterproof sheet.

Caution
- Use a dry, dust-free room free of aggressive chemical agents as a storage room
- Position the circuit-breaker and any fixed part on a horizontal surface, not in direct contact with the floor, but on a suitable support surface (Fig. 6)
- The maximum number of stackable circuit-breakers is indicated in figure 7.
- Keep the circuit-breaker in the open position and with the closing springs unloaded to avoid unnecessary stress and the risk of accident to the personnel.

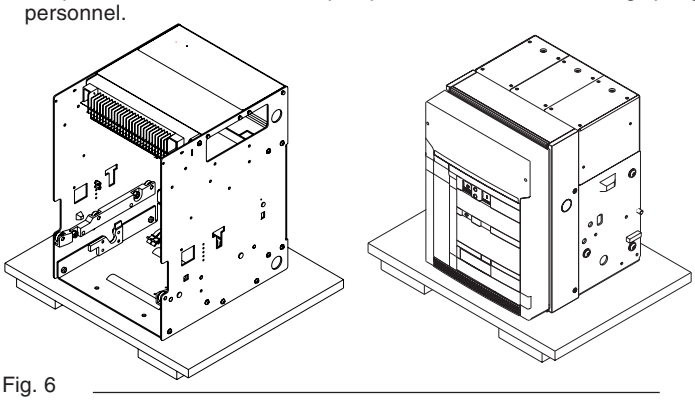

Fig. 6

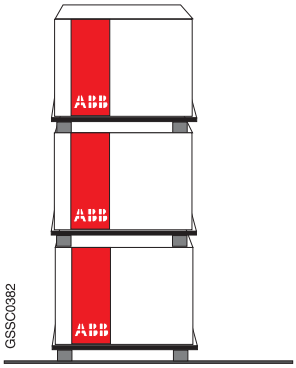

Fig. 7

With regard to lifting, follow the instructions: the circuit-breakers must be placed on a sturdy supporting surface and lifted, preferably by means of a special fork-lift truck. However, the use of ropes is allowed. In this case, the lifting ropes must be hooked up as shown in the figures (the lifting plates are always supplied with the circuit-breaker).

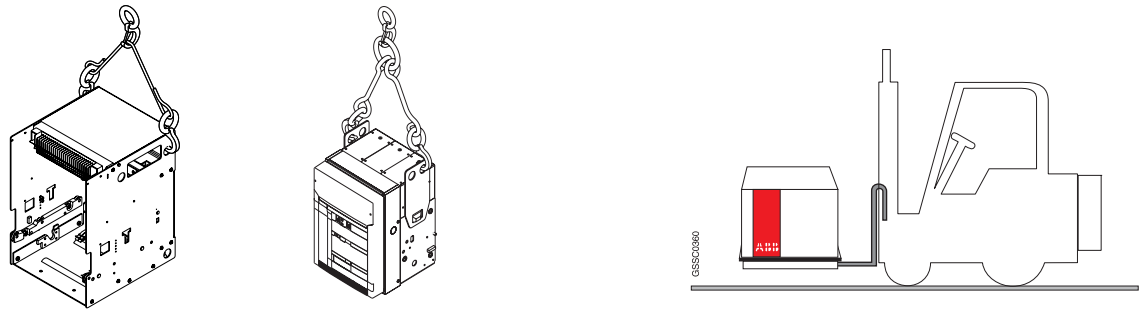

Fig. 8

Table of the circuit-breaker weights

Selective circuit-breaker	Fixed 3-pole		Fixed 4-pole		Withdrawable3-pole		Withdrawable4-pole	
	kg	Lbs	kg	Lbs	kg	Lbs	kg	Lbs
E1	45	99	54	119	70	154	82	181
E2	50	110	61	135	78	172	93	205
E3	66	145	80	176	104	229	125	275
E4	97	213	117	258	147	324	165	363
E4/f	-	-	120	265	-	-	170	375
E6	140	308	160	353	210	463	240	529

Notes
The weights indicated in the table are intended for circuit-breakers complete with PR121-A, PR122-A or PR123-A releases and relative current sensors, excluding the accessories. The withdrawable version includes the moving part in the same conditions as above, and the fixed part with horizontal rear terminals.

4. Installation

4.1 Installation room

Install the circuit-breaker in a dry, dust-free, non-corrosive room, and in such a way that it is not subject to shocks or vibrations. Where this is not possible, install it inside a switchboard with a suitable degree of protection. For the preparation of the installation room, please refer to the "Overall dimensions" paragraph, which gives information on the following points:

- minimum installation volumes of the circuit-breakers and derived versions
- distances to be respected for circuit-breakers in compartments
- overall dimensions of the circuit-breakers
- fixing drillings
- compartment door drillings.

The installation, commissioning and any ordinary and extraordinary maintenance have to be done by skilled personnel, with a detailed knowledge of the apparatus.

4.2 Installation of the fixed circuit-breaker

Fix the circuit-breaker to a horizontal surface using the screws (M10 x 12 min.) (fig.9).

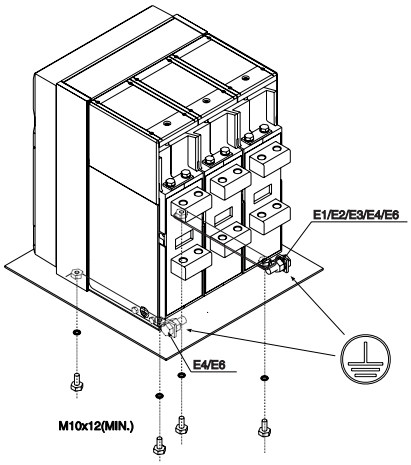

Fig. 9

4.3 Installation of the fixed part of the withdrawable circuit-breaker

4.3.1 Preparation of the fixed part

Assembly of the anti-racking-in lock

Before installing the fixed part, it is necessary to check the presence of the anti-racking-in lock for circuit-breakers with different electrical characteristics from those of the fixed part. If the anti-racking-in lock has been supplied separately, proceed to assemble it as follows:

– On the self-adhesive plate (4), find the assembly position of the stop bolts in relation to the circuit-breaker which has to be housed in the fixed part
– Insert the two hexagon-head screws (1) into the holes found in the previous item as shown in the figure
– Fix the two screws with the washers (2) and the hexagonal stops (3).

Make sure that the anti-racking-in lock corresponding to the one installed on the fixed part is present on the circuit-breaker (moving part).

– Anti-racking-in plate on the moving part (5).

Example for E1B 08 according to the nameplate diagram

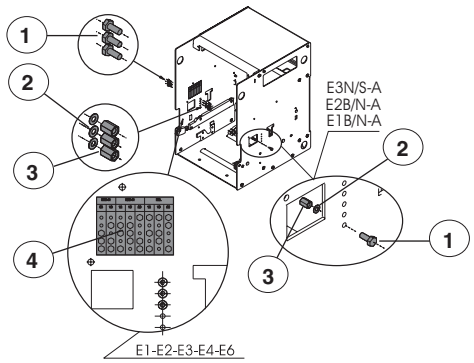

Fig. 10

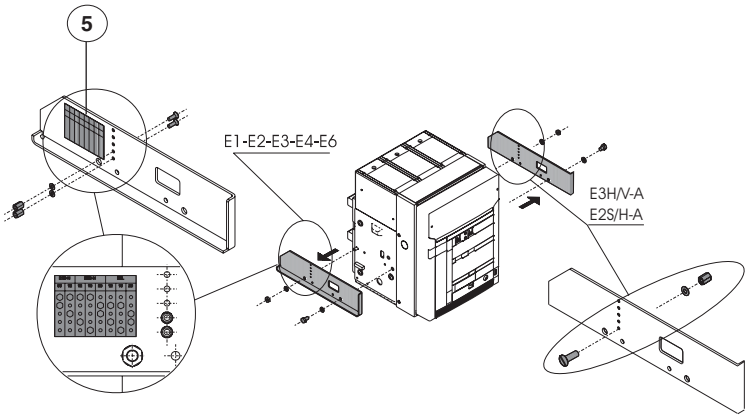

Fig. 11

4.3.2 Installation of the fixed part (Fig. 12b)

Attach the fixed part by means of the screws (1), washers (2) and nuts (3) (M8x 16), supplied by ABB SACE. If other screws are used, make sure that the head of the screws does not extend more than 5.5 mm (0.22 inches) from the base of the fixed part.

4.3.3 Installation of the fixed part on board a ship (Fig. 12a)

Regarding the fixing points of the SACE Emax withdrawable version air circuit-breakers, for applications on board a ship, additional fixing on the sides of the fixed part itself is recommended (the M12 screws and the spacers are not provided in the supply).

E1 - E2 - E3

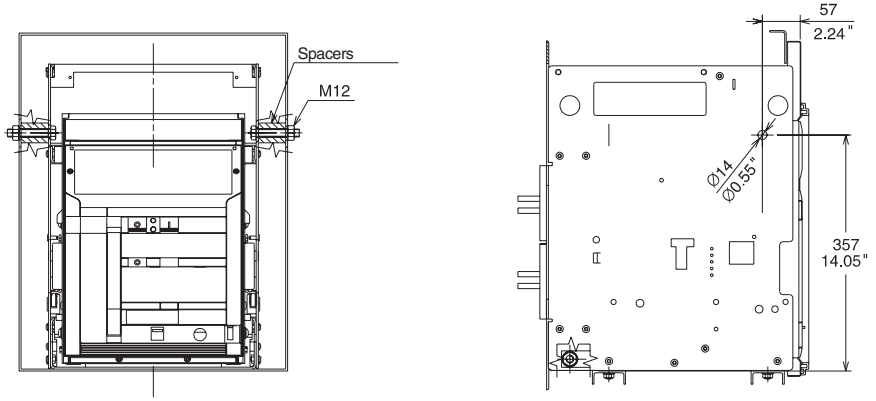

E4 - E6

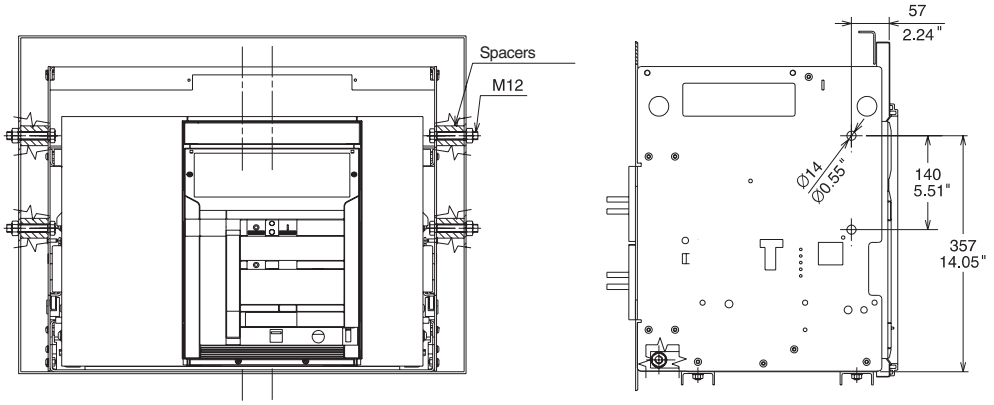

Fig. 12a

4.4 Installation of the flange on the compartment door (Fig. 13)

– Make the compartment door drillings specified in the "Overall dimensions" paragraph.
– Attach the flange (1) on the front of the compartment door, fixing it from the inside by means of the self-tapping screws (2).

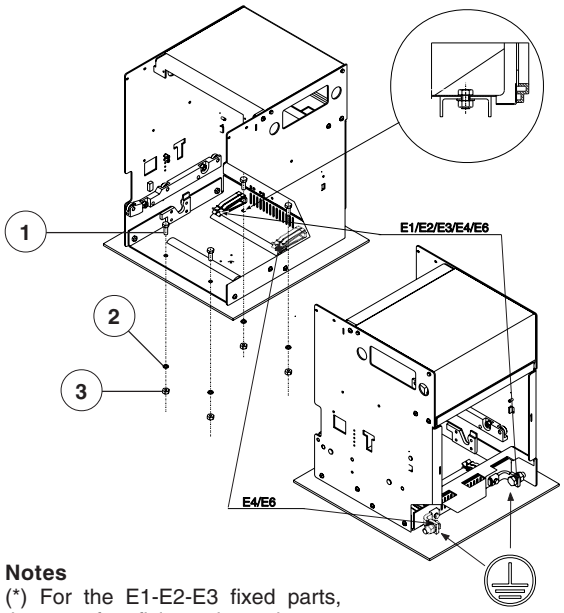

Notes
(*) For the E1-E2-E3 fixed parts, there are four fixing points, whereas there are six for E4-E6.

Fig. 12b

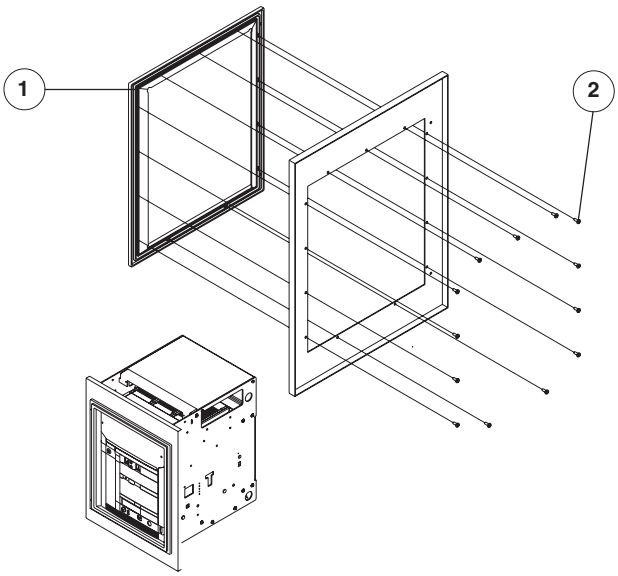

Fig. 13

5. Electrical connections

5.1 Connections to the power circuit

5.1.1 Shapes of the terminals

Fixed circuit-breaker

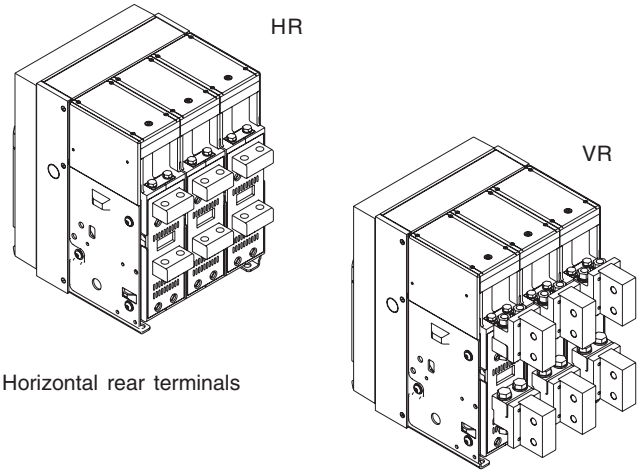

Horizontal rear terminals

Vertical rear terminals

Fig. 14

Fixed part for withdrawable circuit-breaker

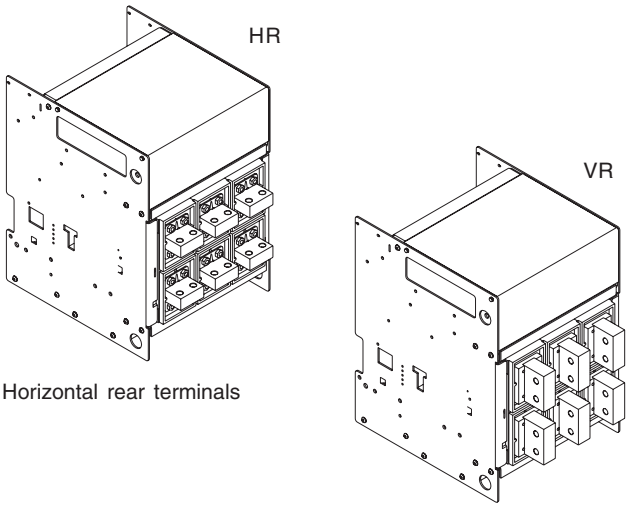

Horizontal rear terminals

Vertical rear terminals

Fig. 15

Note
The drawings are provided to show the type of terminal in graphic form. The exact shape of the terminals is given in the "Overall dimensions" chapter.

5.1.2 Examples of positioning the connection busbars according to the types of terminal

The connection busbars enable the connection between the terminals of the circuit-breakers and the busbars of the switchgear. Their sizing must be carefully studied by the switchgear designer. Some examples of possible constructions in relation to the shape and size of the circuit-breaker terminals are given in this paragraph. The various types of terminals are of constant dimensions for each size of circuit-breaker: it is normally advisable to exploit the whole contact surface of the terminal, so the width of the connection busbars should be the same as that of the terminal. Different connection capacities can be obtained by adjusting the thickness and number of busbars in parallel. In some cases, reductions in the width of the connection in relation to that of the terminal are allowable, as shown in the following examples.

Possible length of connection busbars

	Connection busbars			
	Nominal current	***Number***	***Dimensions mm / inches***	
E1	800 A	1	76.2/3"	6.35/0.26"
E1	1200 A	2	50.8/2"	6.35/0.26"
E2	1200 A	2	50.8/2"	6.35/0.26"
E2	1600 A	2	76.2/3"	6.35/0.26"
E3	1200 A	2	50.8/2"	6.35/0.26"
E3	1600 A	2	76.2/3"	6.35/0.26"
E3	2000 A	2	101.6/4"	6.35/0.26"
E3	2500 A	3	101.6/4"	6.35/0.26"
E3	3200 A	5	76.2/3"	6.35/0.26"
E4	3200 A	5	76.2/3"	6.35/0.26"
E4/f	3200 A	5	76.2/3"	6.35/0.26"
E4	3600 A	6	76.2/3"	6.35/0.26"
E4/f	3600 A	6	76.2/3"	6.35/0.26"
E6	4000 A	7	76.2/3"	6.35/0.26"
E6	5000 A	8	101.6/4"	6.35/0.26"

Fig. 16

Positioning the first anchoring baffle of the busbars according to the short-circuit current

Anchoring to the switchgear

HORIZONTAL TERMINALS

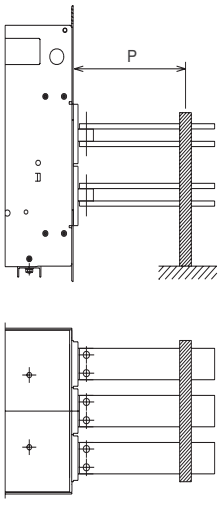

P	E1-E2	E3-E4-E6
(mm)	250	150
(inch)	9.84"	5.91"

VERTICAL TERMINALS

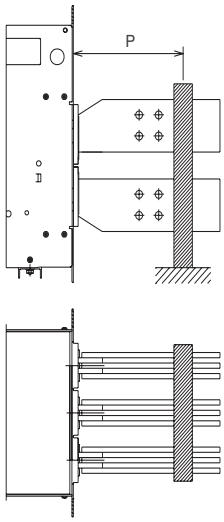

P	E1-E2	E3-E4-E6
(mm)	250	250
(inch)	9.84"	9.84"

Fig. 17

5.1.3 Assembly procedure for the connection busbars

Check the state of the contact surfaces of the connections very carefully: they must be very clean with no burrs, dents or traces of rust, which must be eliminated using a fine file or an emery cloth to prevent localized increases in temperature. On completion of the operation, remove all traces of grease or dust with a cloth soaked in a suitable solvent. When copper connections are used, it is advisable to tin-plate the contact surfaces.
When aluminium connections are used, it is advisable to apply a thin layer of Vaseline over the contact surfaces.
The connections must not exert any strain on the terminals in any direction.
Always insert a large-diameter flat washer and a spring washer between them (to spread the tightening pressure over a greater area).
Make the contact between connection and terminal and tighten the fixing screws completely.
Always use two wrenches (so as not to strain the insulating parts excessively), applying the tightening torque indicated in Fig. 18. Check tightness after 24 hours.

M12/ ½" high-strength screws
Tightening torque of the main terminals: 70 Nm / 584 Lbft

Fixed part terminals

	No. of screws for phase	No. of screws for neutral
E1/E2	2	2
E3	3	3
E4	4	2
E4/f	4	4
E6	6	3

Fixed circuit-breaker terminals

	No. of screws for phase	No. of screws for neutral
E1/E2	2	2
E3	3	3
E4	4	2
E4/f	4	4
E6	6	3

Fig. 18

5.2 Earthing

The fixed circuit-breaker and the fixed part of the withdrawable circuit-breaker have one or two terminals on the rear, marked with the special symbol, for connection to earth (Fig. 9 and Fig. 12b).
Each terminal is complete with a bolt for fixing the connection.
A conductor with a cross-section conforming to current standards must be used for the connection.
Before assembling the connection, clean and degrease the area around the screw.
After the assembly, tighten the bolt with a torque of 70 Nm / 584 Lbft.

5.3 Wiring the circuit-breaker auxiliary circuits

5.3.1 Interfacing elements for fixed circuit-breakers

A special terminal box is provided, fitted with screw terminals for connecting the auxiliary circuits.
The terminals are marked with alphanumerical identification codes as for the electrical circuit diagram. The terminal box is identified by code XV on the electrical circuit diagram. The terminal box is immediately accessible when the compartment door is open.

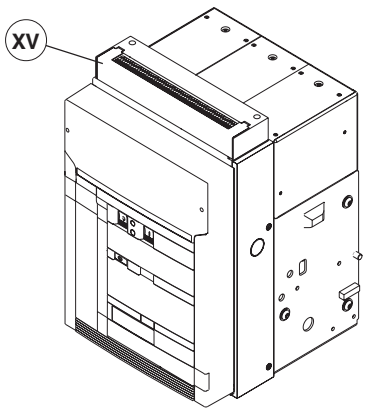

Fig. 19

5.3.2 Withdrawable circuit-breaker

For connection of the moving part to the auxiliary circuits, a connection with sliding contacts is available on the fixed part (see figure), identified by code X on the electrical circuit diagram.
The terminals of the fixed connector are immediately accessible when the compartment door is open.
Furthermore, a terminal box identified by code XF is available for connecting the position contacts of the moving part in relation to the fixed part.
The connector and terminal box have screw terminals.

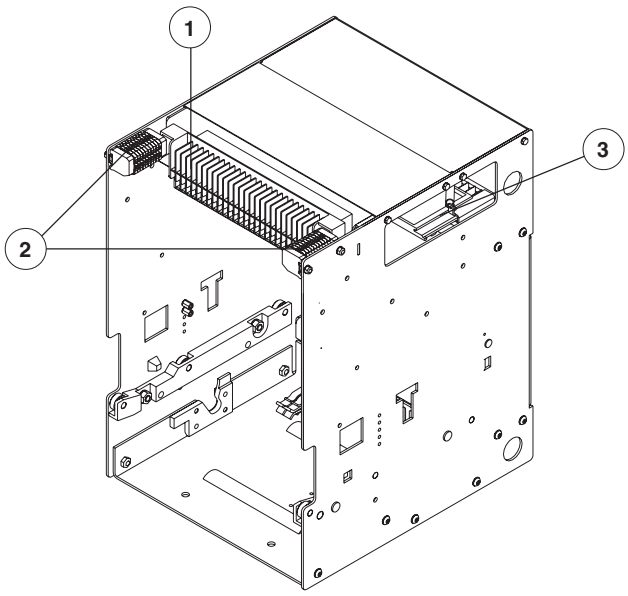

E1 - E2 - E3
10 contacts in position

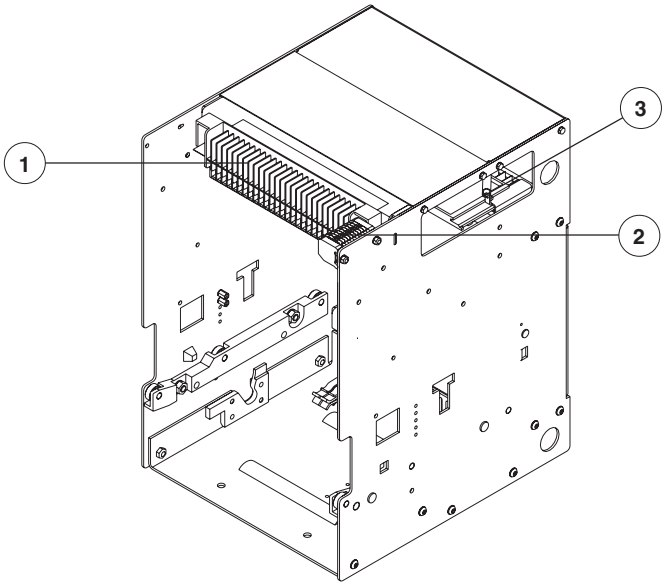

E1 - E2 - E3 - E4 - E6
5 contacts in position

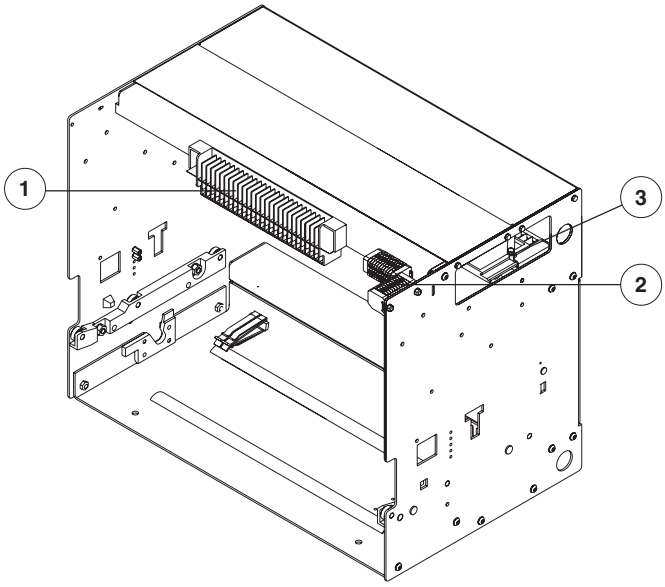

E4 - E6
10 contacts in position

Legend
① Sliding contacts (X)
② Terminal box for position contacts (XF)
③ Position contacts

Fig. 20

5.4 Conversion of the auxiliary contacts or of the position contacts from normally closed (opening) to normally open (closing) or vice versa

The contacts are wired at the factory as shown on the electrical circuit diagram. If it is necessary to change their state for installation requirements, proceed as follows.

a) Auxiliary contacts

To access the auxiliary contacts, carry out the following operations:

– remove the front protection (3) of the release by taking action on the blocks (1) as shown in the figure
– remove the protection release (4) removing the side nuts (2) and then sliding the release out from the front of the circuit-breaker.

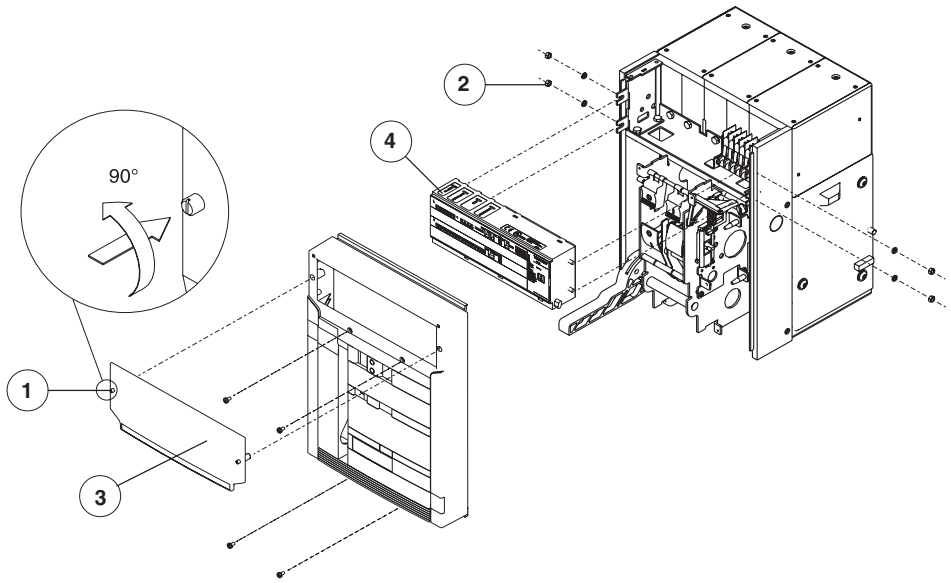

Fig. 21

Being of the two-way type (changeover contacts), the auxiliary contacts can be modified from break contacts to make contacts and vice versa simply by moving the output conductor from one position to the other, as shown in the figure.

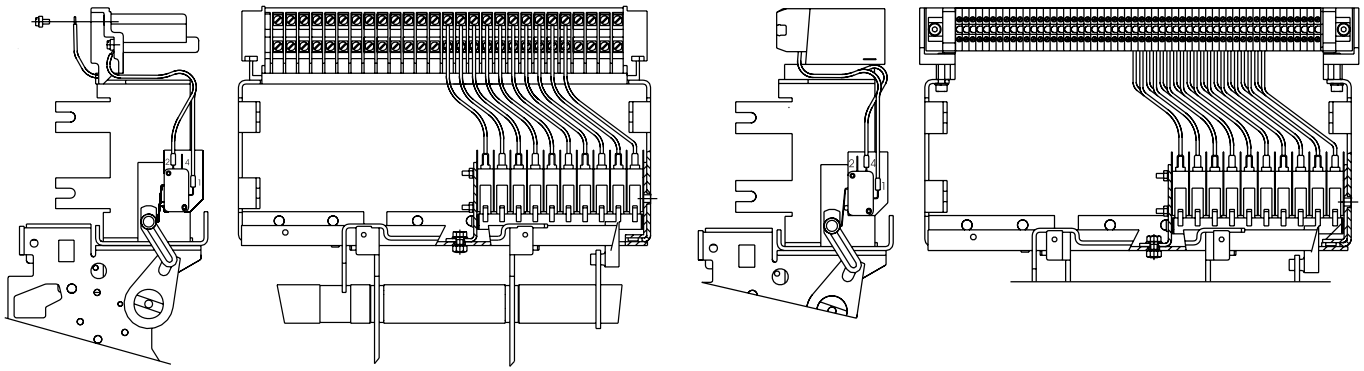

N.C. contact Sliding contacts N.O. contact Terminal box

Fig. 22

b) Position contacts

To change the state of the position contact, proceed in the same way as explained for the auxiliary contacts (see Fig. 21-22).

6. Putting into service

6.1 General procedures

– Check tightness of the power connections at the circuit-breaker terminals
– Carry out all the preparatory operations on the release
– Make sure that the value of the auxiliary circuit power supply voltage is between 85 and 110% of the rated voltage of the electrical applications
– Make sure that there is an adequate air circulation in the place of installation to avoid overheating
– Also carry out the checks specified in the following table.

Item inspected	Procedure	Positive check
1 Manual operating mechanism	Carry out some opening and closing operations (see the chapter 7.2). CAUTION When there is an undervoltage release, the circuit-breaker can only be closed after the release has been electrically energized.	The spring loading lever moves correctly.
2 Geared motor (if any)	Supply the spring-loading geared motor at the corresponding rated voltage. Carry out some closing and opening operations. Note. Supply the undervoltage release at the corresponding rated voltage (if any)	The springs are loaded correctly. The signals are correct. The geared motor stops with the springs loaded. The geared motor recharges the springs after each closing operation.
3 Undervoltage release (if any)	Supply the undervoltage release at the corresponding rated voltage and carry out the circuit-breaker closing operation. Disconnect the release. Supply the undervoltage release at the corresponding rated voltage and carry out the circuit-breaker closing operation.	The circuit-breaker closes correctly. The signals are correct. The circuit-breaker opens. The signal changes over.
4 Shunt opening release (if any)	Close the circuit-breaker. Supply the shunt opening release at the corresponding rated voltage.	The circuit-breaker opens correctly. The signals are correct.
5 Shunt closing release (if any)	Open the circuit-breaker. Supply the shunt closing release at its rated voltage.	The circuit-breaker closes correctly. The signals are correct.
6 Circuit-breaker lock in the open position (with key or padlocks)	Open the circuit-breaker, turn the key and remove it from its seat. Attempt the circuit-breaker closing operation.	Both manual and electrical closing are prevented.
7 Auxiliary contacts of the circuit-breaker	Insert the auxiliary contacts in suitable signalling circuits. Carry out some circuit-breaker closing and opening operations.	The signals are given correctly.
8 Auxiliary contacts for signalling circuit-breaker connected, test isolated and disconnected	Insert the auxiliary contacts in suitable signalling circuits. Then put the circuit-breaker in the connected, test isolated and disconnected position.	The signals due to the relative operations are given correctly.
9 Lock devices for circuit-breakers connected and disconnected. Interlocking devices between circuit-breakers side by side and one on top of another (if any)	Carry out the operating tests.	The locks function correctly.
10 For withdrawable circuit-breakers: racking -in/out device	Carry out some racking-in and out operations.	Racking-in operation: the circuit-breaker racks in correctly. The first turns of the crank handle do not meet with any particular resistance.

7. Instructions for use

7.1 Operating and signalling parts

1 Pushbutton for the manual opening operation
2 Lever for manual loading of the closing springs
3 Mechanical indicator for circuit-breaker open "O" and closed "I"
4 Mechanical indicator for protection release tripped (on request)
5 Pushbutton for the manual closing operation
6 Signalling device for springs loaded- unloaded
7 Operation counter (on request)
8 Key lock on the closing operation (on request)
9 Mechanical indicator for circuit-breaker connected, test isolated and disconnected
10 Seat for the racking-in/out lever
11 Lever releasing the racking-in/out operation
12 Key lock on the racking-in/out operation (on request)
13 Padlock on the manual closing operation (on request)
14 Padlock on the racking-in/out operation (on request)

Fixed circuit-breaker

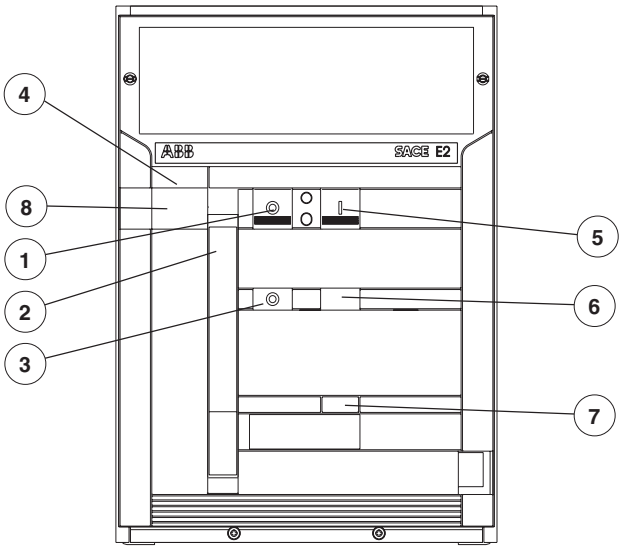

Withdrawable circuit-breaker

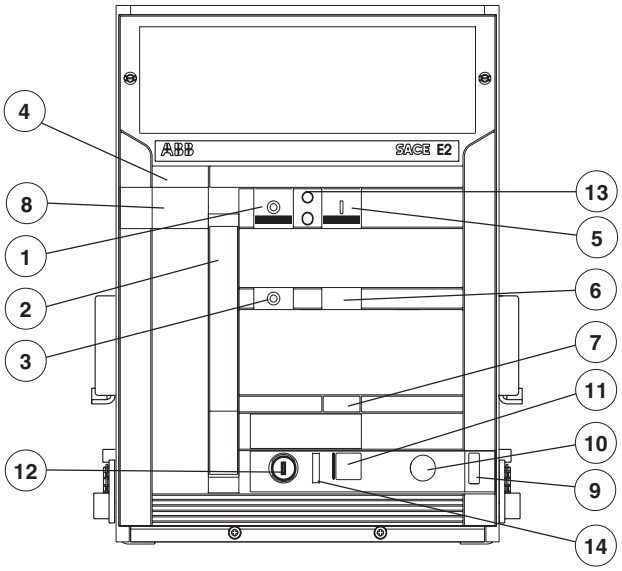

Fig. 23

Note
On request, a transparent cover can be installed on the front of the circuit-breaker to increase the degree of protection to IP54. The cover has a locking key.
As an alternative to the transparent cover, a protection can be mounted on the manual closing and opening controls, which only allows operation of the pushbuttons by means of a special tool.

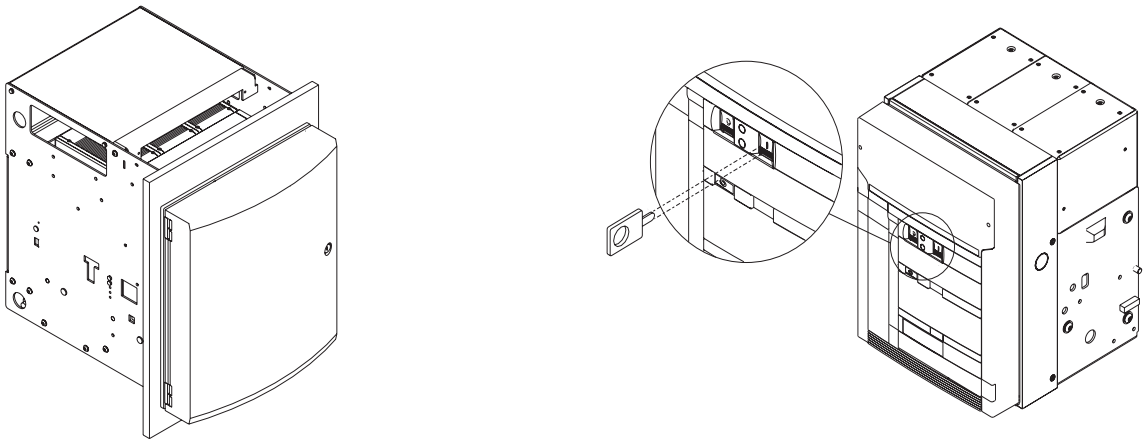

Fig. 24

7.2 Circuit-breaker closing and opening procedures

The operation of the circuit-breaker can be either manual or electrical.

a) Manual loading of the closing springs

– Make sure that the indicator (3) shows "O" (circuit-breaker open)
– Make sure that the indicator (6) is WHITE (springs unloaded)
– Repeatedly activate the lever (2) until the indicator (6) changes its color to YELLOW

b) Electrical loading of the closing springs

The electrical loading of the circuit-breaker is possible when the following accessories (supplied on request) are present:
– geared motor for automatic loading of the closing springs
– shunt closing release
– shunt opening release.

The geared motor automatically reloads the springs after each closing operation until the yellow indicator appears (6, Fig. 25). When the power is cut off during loading, the geared motor stops and automatically starts reloading the springs again when the power returns. It is, in any case, always possible to complete the reloading operation manually.

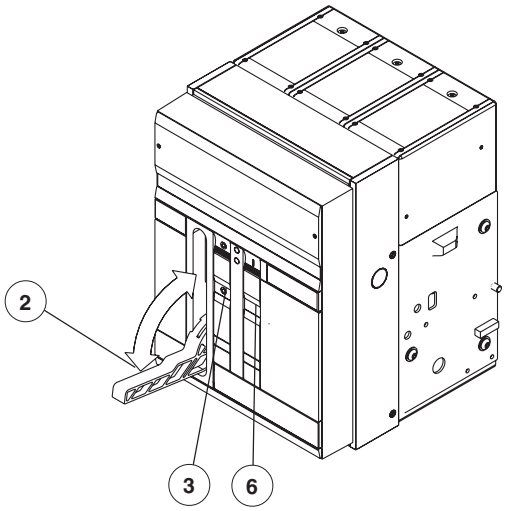

Fig. 25

c) Closing the circuit-breaker

The operation can only be carried out with the closing springs fully loaded.
For manual closing, press the pushbutton (5) marked with the letter "I". When there is a shunt closing release, the operation can be carried out remotely by means of the special control circuit. The special indicator (3) changes to indicate "I" to signal that the circuit-breaker has closed. Furthermore, the indicator of the state of the springs (6) goes to the WHITE position. Even with the closing springs unloaded, the operating mechanism retains enough energy for the opening operation. The geared motor, if any, immediately starts the automatic spring reloading operation.

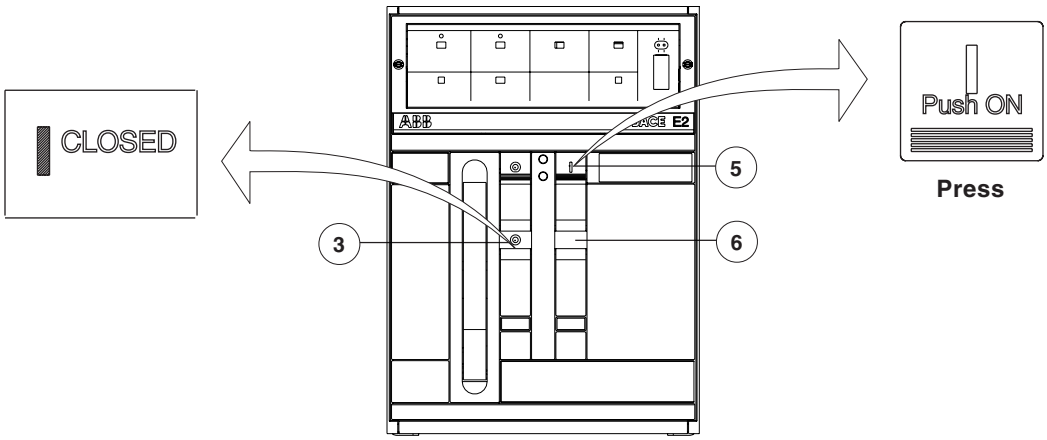

Fig. 26

d) Opening the circuit-breaker

For manual opening of the circuit-breaker, press pushbutton "O" (1). When there is a shunt opening release, the operation can also be carried out remotely by means of the special control circuit. Opening having taken place is signaled by the letter "O" appearing in the indicator (3).

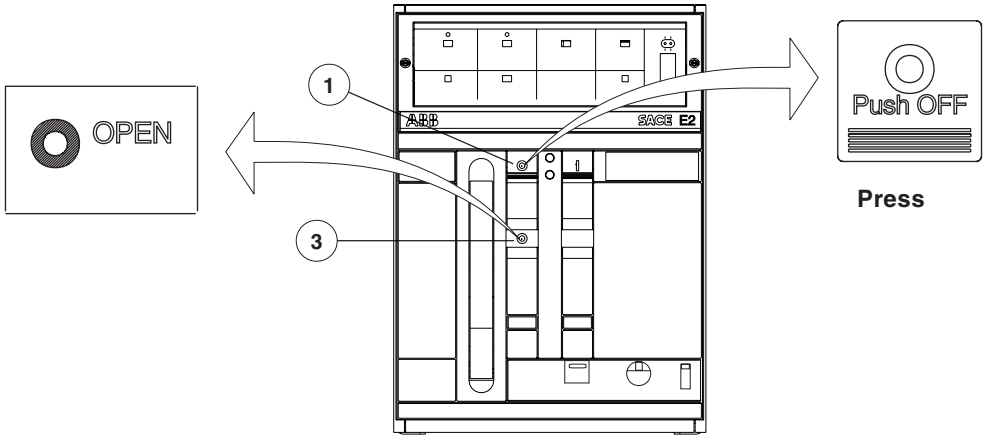

Fig. 27

7.3 Racking-in/out operation

WARNING

A) Open the circuit-breaker before carrying out any racking-in/out operation.
B) The circuit-breaker (moving part) and fixed part are fitted with a lock which prevents the fixed part from being racked into the circuit-breakers with a different rated current: the congruence of the anti-racking-in lock must be checked by the operator before carrying out the racking-in operation to avoid any unnecessary stress.
C) Before the racking-in operation, remove any padlock on the segregation shutter of the isolation terminals on the fixed part.

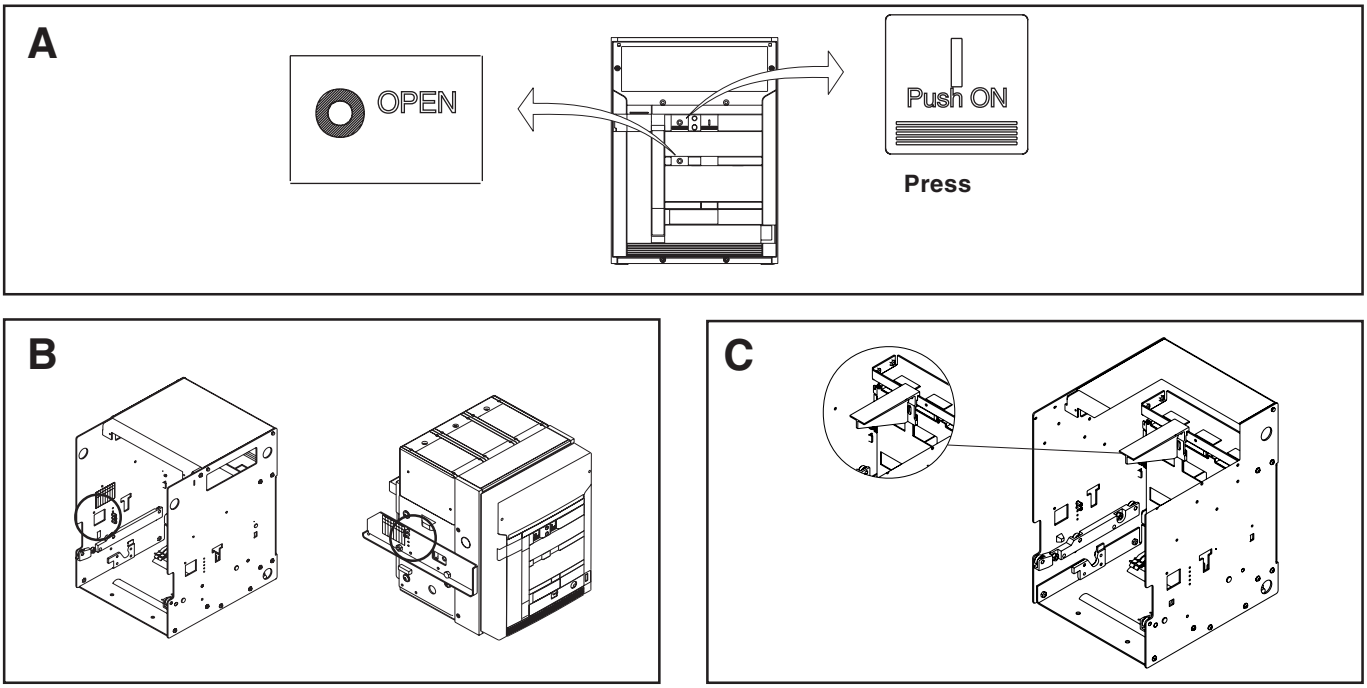

Fig. 28

NOTES

In relation to the fixed part, the circuit-breaker (moving part) can take up different positions, identified as follows:

– DISCONNECTED: the moving part is inserted in the fixed part WITHOUT any connection between the terminals and WITHOUT coupling the sliding contacts for the auxiliary circuits: in this position all electrical operation of the circuit-breaker is prevented. On the front the indicator (9, Fig. 23) indicates DISCONNECTED. The switchgear compartment door can be closed.
– TEST ISOLATED: the moving part is inserted in the fixed part WITHOUT any connection between the power terminals, but WITH the sliding contacts coupled for the auxiliary circuits. In this position, the circuit-breaker can be operated for the offline tests. The indicator (9, Fig. 23) indicates TEST ISOLATED.
– CONNECTED: the moving part is fully inserted in the fixed part WITH the connection of both the power terminals and the sliding contacts for the auxiliary circuits. The circuit-breaker is operational. The indicator (9, Fig. 23) indicates CONNECTED.

a) Positioning the moving part in the fixed part in the DISCONNECTED position

Lift the moving part as shown in the paragraph (3) and insert it in the fixed part guide, tilting it as shown in figure 29.

The manual connection must allow the edge (E) of the circuit-breaker guide to slide under the blocks (D) of the fixed part. Remove the lifting devices.
The position reached is stable and allows for any inspections of the circuit-breaker.
Push the moving part as far as the stop in the fixed part.
Close the compartment door.

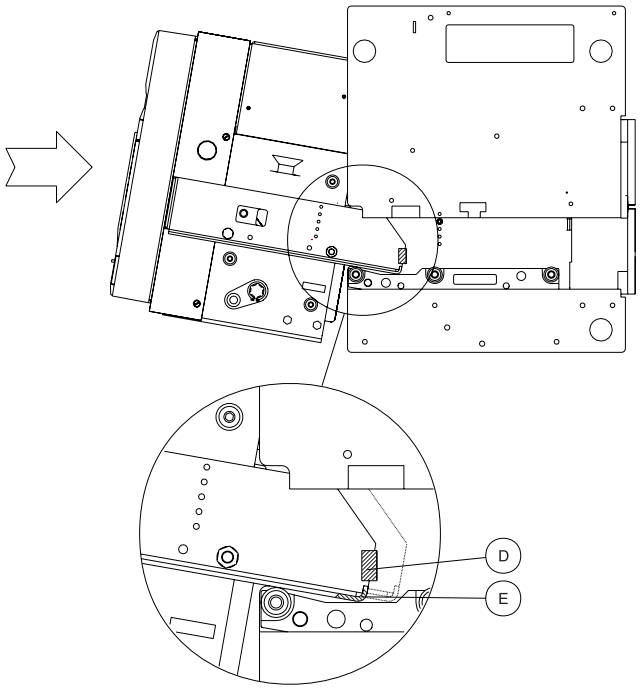

Fig. 29

b) Passing from the DISCONNECTED to the TEST ISOLATED position

Make sure that the indicator (9) is in the DISCONNECTED position.
For the connection procedure, make sure that the key (12) is in the correct position and/or the padlock (14), if any, has been removed.
Make sure that the circuit-breaker is open.
Push the moving part right into the fixed part.
Lower the releasing lever (11).
Insert the crank handle in the corresponding coupling (10).
Proceed to turn the crank handle clockwise until the TEST ISOLATED indication appears on the indicator (9). During the initial turns, the crank handle must oppose no particular resistance to rotation.
Should it be necessary to carry out offline circuit-breaker operations, the crank handle must be removed.

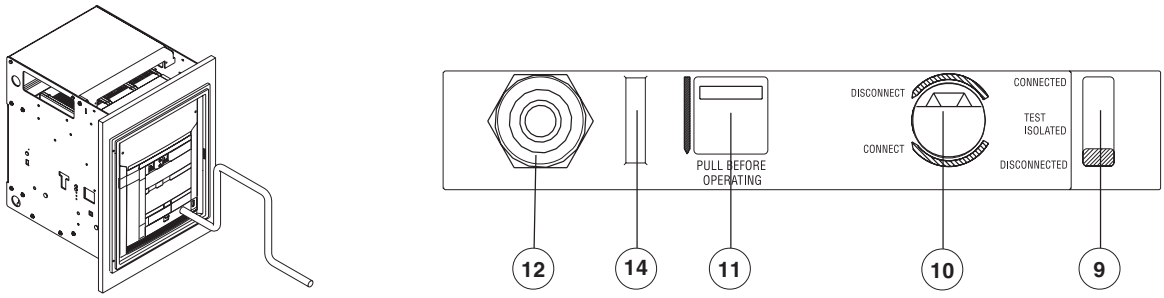

Fig. 30

c) Passing from the TEST ISOLATED position to the CONNECTED position

Make sure that the circuit-breaker is open.
Lower the releasing lever (11).
Insert the crank handle in the corresponding coupling (10).
Proceed to turn the crank handle clockwise until the CONNECTED indication appears on the indicator (9).
Remove the crank handle to enable the circuit-breaker to close.

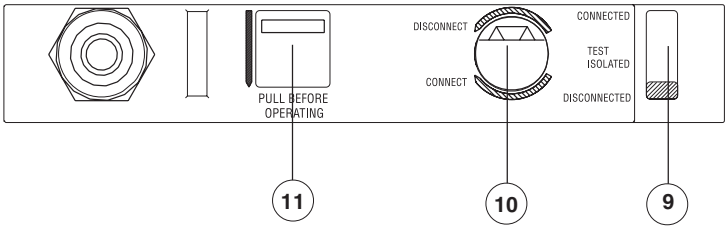

Fig. 31

d) Passing from the CONNECTED position to the TEST ISOLATED position, to the DISCONNECTED position.

Repeat the connection procedures changing the direction for turning the crank handle to anti-clockwise. Open the door in the disconnected position.

8. Maintenance

8.1 Warning

Before carrying out any maintenance work, it is necessary to complete the following procedure:
– open the circuit-breaker and check that the operating mechanism springs are unloaded
– in the case of withdrawable circuit-breakers, work with the circuit-breaker racked-out of the fixed part
– for action on fixed version circuit-breakers or on fixed parts of withdrawable circuit-breakers, disconnect the supply to the power circuit and to the auxiliary circuits. Furthermore, visibly earth the terminals both on the power supply side and on the load side.

During normal service, the circuit-breakers require limited maintenance.

The table of the maintenance program is given in the following paragraph, indicating the corresponding periodic intervals for action. In particular, with regard to the time intervals, it is advisable to follow the recommendations in the table, at least for the first year of service.
On the basis of the results obtained during the routine checks, establish the best time intervals for the maintenance operations.

It is also advisable to refer to the following rules:
– circuit-breakers which rarely operate, or which remain closed for long periods, must be operated from time to time to avoid any tendency to stick
– during service, routinely inspect the circuit-breaker from the outside to check for any dust, dirt or damage of any kind.
– for circuit-breakers with SACE PR122 and SACE PR123 releases, check the percentage of wear on the contacts. For circuit-breakers fitted with SACE PR121 releases, installation of the mechanical operation counter (supplied on request) is recommended; the latter release also provides various information useful for controlling power circuit breaker status.

With regular maintenance, SACE Emax circuit-breakers, either with or without a geared motor, can withstand the following operation without replacement of parts.

Circuit-breaker		Mechanical life (*)		Electrical life (*)	
		N° of operations (operations)	Frequency (operations/hour)	N° of operations (operations)	Frequency (operations/hour)
E1	800	20000	30	10000	30
	1200	20000	30	10000	30
E2	1200	20000	30	10000	30
	1600	20000	30	10000	30
E3	1200	15000	30	10000	30
	1600	15000	30	10000	30
	2000	15000	30	8000	30
	2500	15000	30	8000	30
E4	3200	8000	30	5000	30
	3600	8000	30	5000	30
E6	3200	8000	30	5000	30
	4000	8000	30	5000	30
	5000	8000	30	3000	30

(*) With regular ordinary maintenance

8.2 Maintenance program

Maintenance operations	Interval	
	Installation in normal rooms	Installations in dusty or polluted rooms
General inspection (see par. 8.3.2)	One year or after a short-circuit trip	Six months or after a short-circuit trip
External visual check and inspection of the power section	One year	Six months
Operating mechanism maintenance (par. 8.3.4)	One year or 10000 operations for E1, E2, E3 One year or 5000 operations for E4, E6	Six months or 10000 operations for E1, E2, E3 Six months or 5000 operations for E4, E6
Checking trip of the release	One year	Six months
Circuit breaker maintenance (par. 83.5)	Every 10000 operations for E1, E2, E3 Every 5000 operations for E4, E6	

8.3 Maintenance operations

8.3.1 Preliminary operations

– Remove the flange (1) of the release, turning the screws (2) as shown in the figure
– Remove the front escutcheon plate (3) by removing the four screws (4)
– Remove, if present, one or both side guards (5) by removing the front (6) and lateral (7) screws
– Remove the arcing chambers (8) by removing the screws (9).

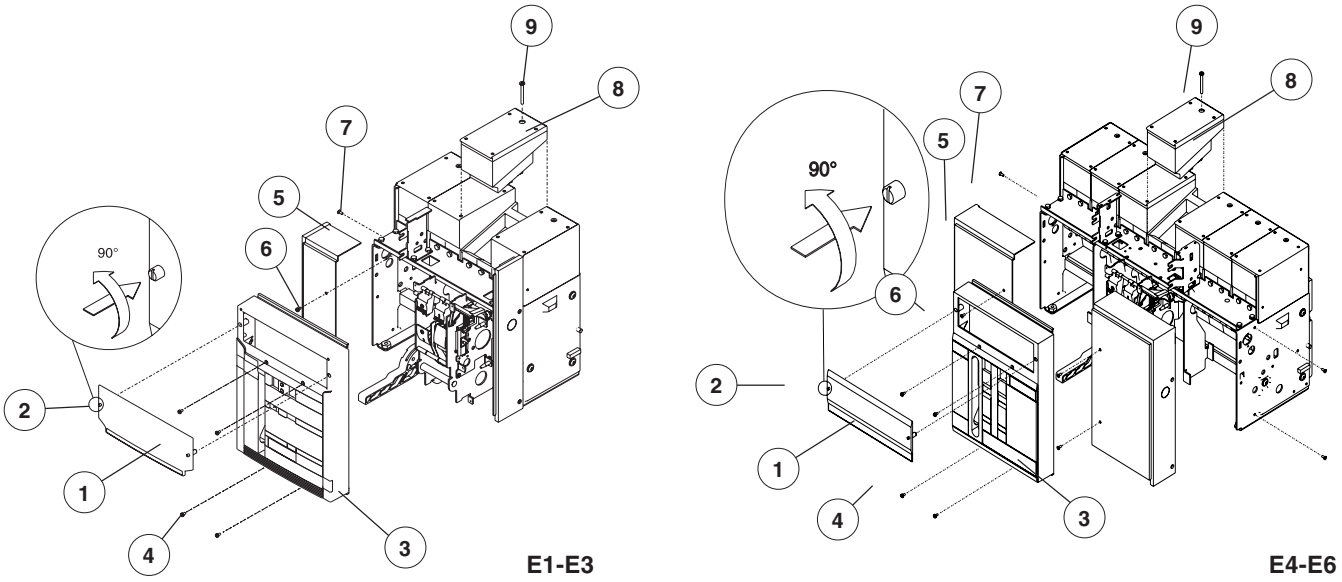

Fig. 32

8.3.2 General inspection of the circuit-breaker

Item to be inspected	Problem found	Remedy
1 Operating mechanism/Electrical accessories	– Presence of dust on the internal parts – Springs deformed or rusty – Safety rings out of place, nuts or screws loose – Wires and straps detached	– Clean with brushes or dry cloths – Replace damaged springs – Put the rings back in place and tighten screws and nuts appropriately – Replace the straps and connect the detached wires correctly
2 Arcing and main contacts	– Traces of wear – Incorrect adjustments: distance A - Fig. 33 is less than 1 mm for E1-E2-E3 or less than 0.8 mm for E4-E6	– Smooth the contacts with emery cloth – Adjust according to the paragraph 8.3.3
3 Arcing chambers	– Presence of fumes or dust – Presence of cracks on the external plastic structure – Excessive difference in wear between the first and last arc extinguishing plate	– Remove with compressed air and remove the fumes and any slag with a brush – Replace the arcing chamber – Replace the arcing chamber
4 Main circuit - Busbars - Insulating contacts	– Presence of dust or dirt on the insulating parts – Safety rings out of place, screws or nuts loose – Deformation or cracks in the insulating parts – Insulating contacts oxidized (only for withdrawable circuit-breaker) – Signs of wear or overheating or crews loose on the connections to the circuit-breaker terminals (only for fixed circuit-breaker)	– Clean with a brush or dry cloths – Put the rings back in place and tighten screws and nuts appropriately – Ask ABB SACE to replace the damaged parts – Remove the shutters and clean with a rough – Tighten the screws suitably
5 Earthing contacts (only for withdrawable circuit-breaker)	– Presence of rust or loose nuts	Clean with a rough cloth soaked in a suitable solvent and lubricate moderately with neutral grease. Tighten the nuts completely
6 Earth connection (only for fixed circuit-breaker)	Presence of rust or loose nuts	Clean with a rough cloth soaked in a suitable solvent, fully tighten the earth connection and cover with neutral grease again
7 Auxiliary circuit power supply voltage	Check the power supply voltage of the electrical accessories of the operating mechanism	The releases and locking devices must operate normally for values between 85% and 110% of the corresponding rated voltage
8 Operating and control parts	The operating tests, which must be carried out as shown in paragraph 6.1, have shown defects in the components	Replace the defective parts or those with a faulty operation (if necessary, ask ABB SACE)

8.3.3 Checking contact wear

In order to ensure the gap A indicated in the table, you can adjust the position of the shaft and of the operating mechanism.

1) Open the circuit-breaker
2) Remove the arcing chamber
3a) Adjust the distance of the moving contacts for E1-E2-E3:
   - loosen the screws in pos.1 and the nuts in pos. 3 (FIG 33 a)
   - proceed in the same way on the screws in pos. 2
   - bring the bushes of the operating mechanism (pos. 5) to rest on the shaft, taking action on the nuts in pos. 4
   - tighten the screws in pos.1 and the nuts in pos. 3 and 4
   - close the circuit-breaker and check the gap A
3b) Adjust the distance of the moving contacts detachment for E4-E6:
   - loosen the screws in pos.1 and 6, the nuts in pos 3. and 8 (FIG 33 a and 33 b)
   - proceed in the same way on the screws in pos. 2
   - bring the bushes of the operating mechanism (pos. 5) and the bushes of the intermediate abutments (pos. 9) to rest on the shaft, taking action on the nuts in pos. 4 and the screws in position 7
   - tighten the screws in pos.1 and 6, and the nuts in pos. 3, 4 and 8
   - close the circuit-breaker and check the gap A
4) If the gap A is not correct, open the circuit-breaker again and repeat the procedure indicated in item 3a or 3b
5) If the gap A is correct, open the circuit-breaker again, seal with yellow paint and re-install the arcing chambers.

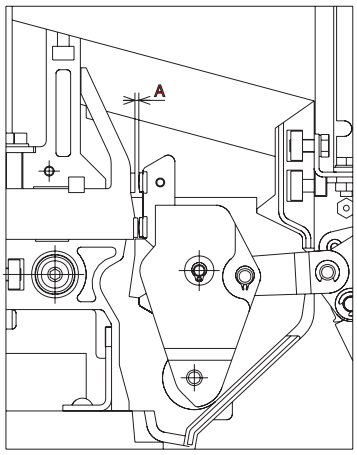

Circuit-breaker	A
E1 - E2 - E3	1 ÷ 1.9 mm 0.039 ÷ 0.075 inch
E4 - E6	0.8 ÷ 1.5 mm 0.031 ÷ 0.059 inch

Fig. 33

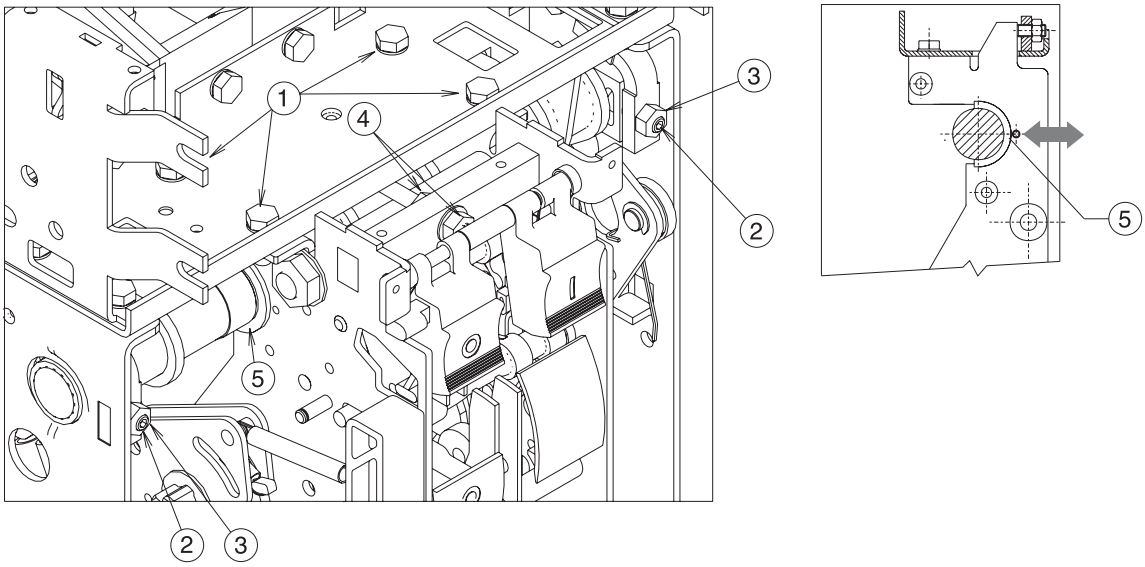

Fig. 33a

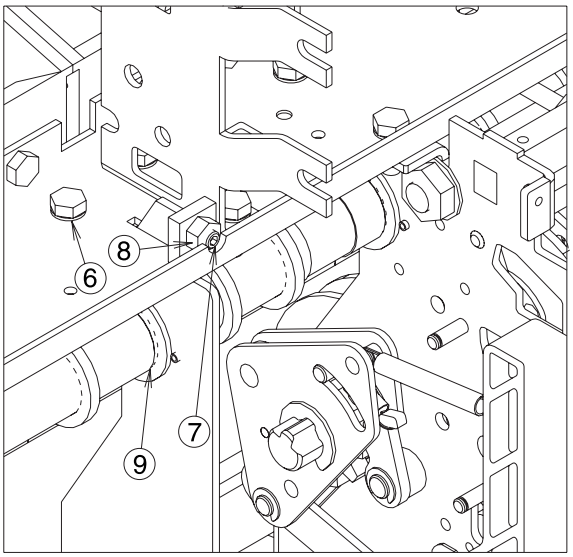

Fig. 33b

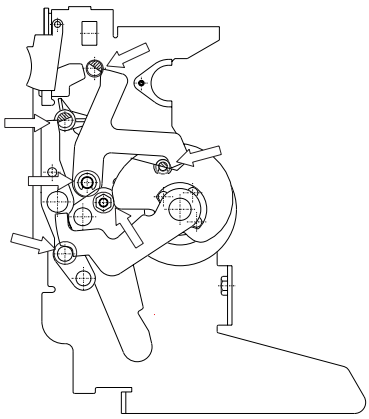

Fig. 33c

8.3.4 Operating mechanism maintenance

– Carry out the checks and take the action listed under item 1 of the table in paragraph 8.3.2.
– Lubricate the bearings of the drive shaft with MU-EP1 (AGIP) grease, including those on the sides of the circuit-breaker. Equivalent greases: ESSO Beacon EP1 - BP LTX1 - SHELL AVANIA GREASE R1 - KLUBER LUBRIFICATION CENTO PLEX 2P
– Lubricate the small opening and closing shafts and the hooks with 5 RX MOLY (OLEOTECNICA) grease (Fig. 33c). Equivalent grease: KLUBER LUBRIFICATION GRAFLOSCON A-G 1 ULTRA.
– Replace operating mechanism springs every 10000 operations for E1, E2, E3 or every 5000 operations for E4, E6.

8.3.5 Circuit breaker maintenance

After 10000 operations for E1, E2, E3 or after 5000 operations for E4, E6 replace:
– arc chambers
– protections
– geared motor
– operating mechanism springs.

9. Measures to be taken for any operating anomalies

Anomalies									
Pressing the i-Test pushbutton on the PR122/PR123 does not cause circuit-breaker opening									
The WARNING or ALARM led on the PR121/PR122/PR123 release lights up									
Release coils interrupted or burnt out, geared motor winding interrupted									
The shunt opening release or shunt closing release does not energize sufficiently									
The shunt opening release or shunt closing release does not energize sufficiently									
The moving part does not rack into the fixed part									
The moving part does not rack out of the fixed part									
The circuit-breaker does not close									
The circuit-breaker does not open									
								Possible causes	**Checks and remedies**
●								Connector XO not inserted correctly Coil of the opening release YO1 interrupted	Check and insert connector XO correctly Replace the YO shunt opening release
●								Defect in the electronic circuits of the microprocessor release	Put the circuit-breaker out of service and check the release with the test apparatus
	●							The possible causes of tripping are listed in the part of the manual relating to the releases	Take action according to the cause: in particular, if contact wear is higher than 80% (WARNING led lit up), the circuit-breaker can remain in service, but replacement of the circuit-breaking parts must be scheduled within a short time. If contact wear reaches 100%, the circuit-breaker must be put out of service immediately. Ask ABB SACE about replacement procedures for the circuit-breaking parts.
						●		Protections not reset	Press the mechanical pushbutton for signalling protection tripping
				●				Operating mechanism or consent contacts blocked in closing position	Check the state of the contacts in series with the release circuit
●			●			●	●	Auxiliary circuit power supply voltage too low	Measure the voltage: it must not be less than 85% of the rated voltage
●		●	●					Different power supply voltage from the one indicated on the rating plate of the releases	Check the rating plate voltage of the releases
				●		●	●	Operating circuit faulty	Check connections, fuses, interlock, protection circuit-breakers and consent contacts
			●			●	●	Wire tightening screws loose	Check tightness of the screws connecting the wires
				●		●	●	Incorrect electrical connections in the power supply circuit	Check the connections with the corresponding circuit diagram
						●	●	Release coils interrupted	Replace the coils
		●				●	●	Operating mechanism blocked	Operate by hand. If the fault persists contact ABB SACE
						●		Key not inserted in the opening mechanism lock	Insert and turn the key
						●		Circuit-breaker in intermediate position between connected and disconnected	Complete the operation
						●		Undervoltage release not energized	Check the corresponding power supply circuit
						●		Shunt opening release remains energized	Check the power supply circuit
					●	●		Racking-in or out operation not carried out correctly	See paragraph 7.3

10. Accessories

10.1 Electrical accessories

Opening/closing release (YO - Y02 - YC)

This allows remote opening or closing control of the apparatus. Given the characteristics of the circuit-breaker operating mechanism, opening (with the circuit-breaker closed) is always possible, whereas closing is only possible when the closing springs are loaded. Most of the releases can operate with either direct or alternating current. This release carries out an instantaneous service (*), but can be supplied permanently (**). In uses where the shunt closing release is supplied permanently, to carry out the circuit-breaker reclosing operation after opening, it is necessary to momentarily de-energize the shunt closing release (the circuit-breaker operating mechanism reclosing is, in fact, fitted with an antipumping device).

(*) In the case of instantaneous service, the minimum duration of the current impulse must be 100 ms.

(**) In the case of permanent power supply to the shunt opening release, you must wait for at least 30 ms before giving the opening control to the shunt closing release.

Reference figures in the electrical circuit diagrams: YO (4) - YC (2) - YO2 (8)

Power supply (Un)	24 V DC
	30 V AC/DC
	48 V AC/DC
	60 V AC/DC
	110-120 V AC/DC
	125-127 V AC/DC
	220-240 V AC/DC
	240-250 V AC/DC
	380-400 V AC
	440 V AC

Operating limits	(YO-YO2) : 70…110% Un
	(YC) : 85…110% Un
Inrush power consumption (Ps)	DC = 200 W
Inrush power time ~100 ms	AC = 200 VA
Continuous power (Pc)	DC = 5 W
	AC = 5 VA
Opening time (YO - YO2)	(max) 60 ms
Closing time (YC)	(max) 80 ms
Insulation voltage	2500V 50 Hz (for 1 min.)

Undervoltage release (YU)

The undervoltage release opens the circuit-breaker in the case of a considerable drop or lack of its power supply voltage. It can be used for remote tripping (by means of normally closed type pushbuttons), as a lock on closing or to control the voltage in the primary and secondary circuits. The release power supply is therefore branched on the supply side of the circuit-breaker from an independent source. Circuit-breaker closing is only allowed with the release powered (the closing lock is carried out mechanically). Most of the releases can operate with either direct or alternating current.

Power supply (Un)	24 V DC
	30 V AC/DC
	48 V AC/DC
	60 V AC/DC
	110-120 V AC/DC

Power supply (Un)	120-127 V AC/DC
	220-240 V AC/DC
	240-250 V AC/DC
	380-400 V AC
	440 V AC

WARNING:

The undervoltage release (YU) is incompatible with the Fail Safe device (preventing withdrawal when the spring is loaded)

If a Fail Safe device is present, remove it as indicated in Fig. 34a-b-c-d.

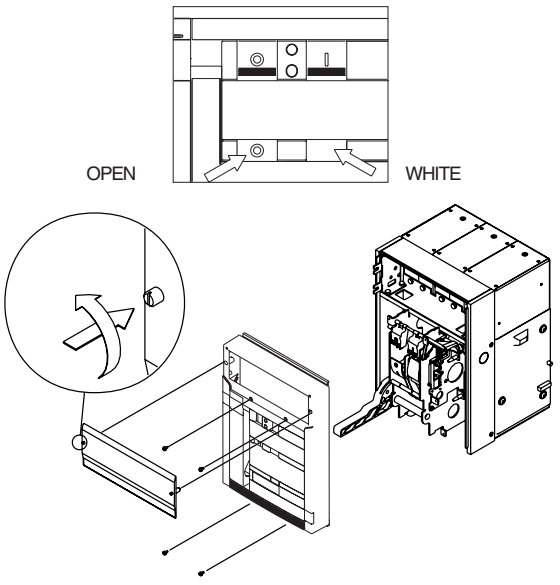

Fig. 34a

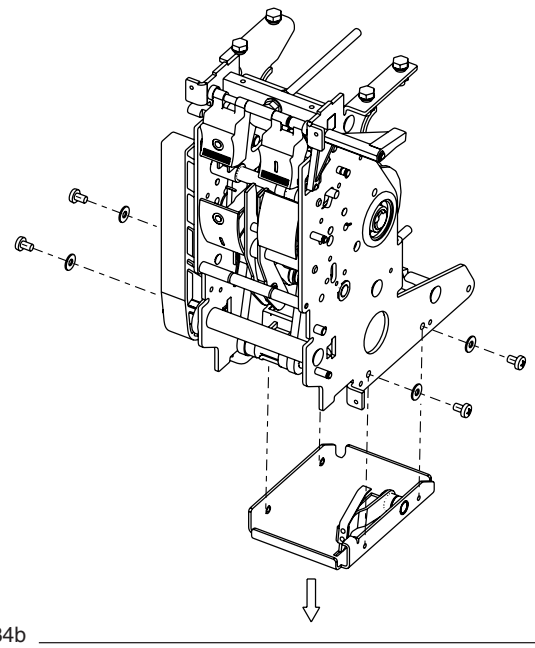

Fig. 34b

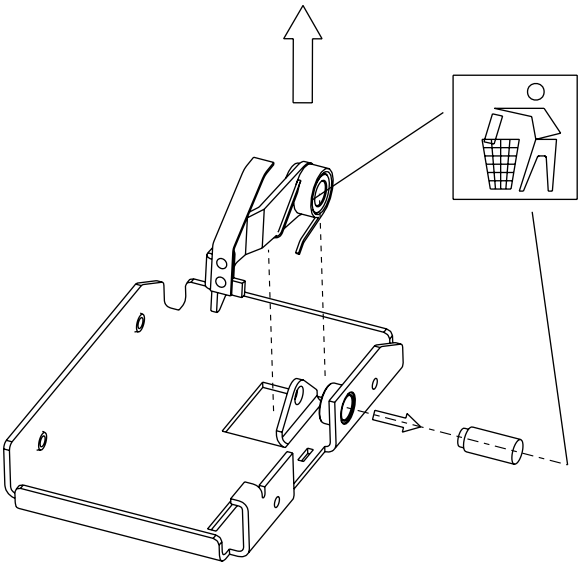

Fig. 34c

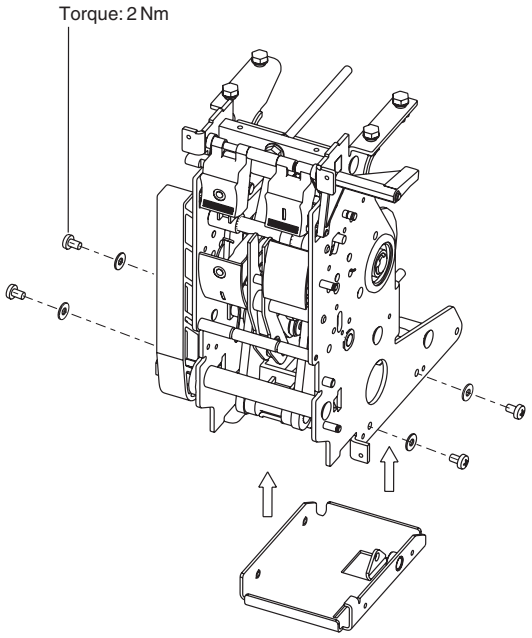

Fig. 34d

Circuit-breaker opening takes place with power supply voltage values of the release equivalent to 30 - 60% Un.
Circuit-breaker closing is possible with power supply voltage of the release equivalent to 85-110% Un.

It can be fitted with a signalling contact for undervoltage release energized (C. aux YU). Reference figures in the electrical circuit diagram: YU 6

Time delay device for undervoltage release (D)

The undervoltage release can be combined with an electronic time-delay device for installing outside the circuit-breaker, which enables a delay in the tripping of the release with preset, adjustable times. The use of the delayed undervoltage release is recommended when the power supply network of the release can be subject to power cuts or short-lived voltage drops, in order to avoid trips.
When it is not supplied, circuit-breaker closing is prevented.
The time-delay device has to be combined with an undervoltage release with the same voltage as the time-delay device.

Reference figures in the electrical circuit diagrams: YD + D7

Inrush power consumption (Ps):	DC = 200 W
	AC = 200 VA
Continuous power (Pc):	DC = 5 W
	AC = 5 VA
Opening time (YU):	30 ms
Insulation voltage	2500V 50 Hz (for 1 min.)

The characteristics of the time-delay device are:

Power supply (D):	24-30 V AC/DC
	48 V AC/DC
	60 V AC/DC
	110-127 V AC/DC
	220-250 V AC/DC
Adjustable opening time (YU+D):	0.5-1-1.5-2-3 s

Geared motor for automatic closing spring loading (M)

This automatically loads the circuit-breaker operating mechanism closing springs. After circuit-breaker closing, the geared motor immediately sees to reloading the closing springs.
When there is no power supply or during maintenance work, the closing springs can still be loaded manually (by means of the special lever on the operating mechanism).

Power supply	24-30 V AC/DC
	48-60 V AC/DC
	100-130 V AC/DC
	220-250 V AC/DC
Operating limits:	85…110% Un

Inrush power consumption (Ps):	DC = 500 W
	AC = 500 VA
Rated power (Pn):	DC = 200 W
	AC = 200 VA
Inrush time	0.2 s
Loading time:	4-5 s
Insulation voltage	2500V 50 Hz (for 1 min.)

It is always supplied with limit contacts and microswitch for signalling closing springs loaded.

Reference figure in the electrical circuit diagrams: M (1)

Mechanical and electrical trip signalling for overcurrent releases

The following signals are available following tripping of the overcurrent release:

a) Mechanical trip signalling for overcurrent releases

This enables a visual signalling on the operating mechanism by pushing the trip pushbutton in when the circuit-breaker has been opened following tripping of an overcurrent release. The circuit-breaker can only be closed again by putting the pushbutton back into its normal position.

b) Electrical and mechanical trip signalling for overcurrent releases

This enables a visual signalling on the operating mechanism (mechanical) and remotely (electrically by means of a changeover switch) of the circuit-breaker being opened following a trip of the overcurrent releases. To reset the circuit-breaker, it is necessary to reset the mechanical indicator pushbutton.

Reference figure in the electrical circuit diagram: S51 13.

Auxiliary contacts

Auxiliary contacts installed on the circuit-breaker are available to enable an indication of the circuit-breaker's status (a version with gold plated contacts is also available for digital signals).

Un	In max	T
125 V DC	0.3 A	10 ms
250 V DC	0.15 A	10 ms

Un	In max	cosφ
250 V AC	5 A	0.3

The versions available are:

a) Electrical signalling for circuit-breaker open/closed

It is possible to have electrical signalling of the circuit-breaker status (open/closed) 4,10 or 15 auxiliary contacts. The auxiliary contacts can have the following configurations:
– 4 break/make contacts for PR121 (2 normally open + 2 normally closed)
– 4 break/make contacts for PR122/ PR123 (2 normally open + 2 normally closed + 2 for the release)
– 10 break/make contacts for PR121 (5 normally open + 5 normally closed)
– 10 break/make contacts for PR122/ PR123 (5 normally open + 5 normally closed + 2 for the release)
– 15 supplementary break/make contacts which can be mounted outside the circuit-breaker.

The basic configuration described above can be modified by the user to indicate normally open or normally closed by repositioning the rapid connector on the microswitch. When 10 contacts for PR122/ PR123 are required, zone selectivity and the PR120/K module are not available.
Reference Fig. in the electrical circuit diagrams: Q/1÷10 (21-22)

b) Electrical signalling for circuit-breaker connected/test isolated/disconnected

In addition to mechanical signalling of the position of the circuit-breaker, it is possible to have electrical signalling by means of 5 or 10 auxiliary contacts which are installed on the fixed part.
Only available for circuit-breakers in withdrawable versions for installing on the fixed part.
The auxiliary contacts can have the following configurations:
– 5 contacts; group consisting of 2 connected signalling contacts, 2 disconnected signalling contacts and 1 test position signalling contact (main contacts isolated, but sliding contacts connected)
– 10 contacts; group consisting of 4 connected signalling contacts, 4 disconnected signalling contacts and 2 test position signalling contacts (main contacts isolated, but sliding contacts connected).
Reference figure in the electrical circuit diagrams: S75I (31-32) – S75T (31-32) – S75E (31-32)

c) Contact for signalling closing springs loaded

This consists of a microswitch which allows remote signalling of the state of the circuit-breaker operating mechanism closing springs. (The contact is always supplied with the spring loading geared motor).
Reference figure in the electrical circuit diagrams: S33 M/2 (11)

d) Contact for signalling undervoltage release energized (C.aux YU)

The undervoltage releases can be fitted with a contact (preferably, normally closed or open) for signalling undervoltage energized for remote signalling of the state of the undervoltage release.
Reference figure in the electrical circuit diagrams: (12)

Current sensor for the neutral conductor outside the circuit-breaker

The sensor allows neutral protection by means of connection to the overcurrent release and is available only for three-pole circuit-breakers. It is supplied on request.
Reference figure in the electrical circuit diagrams: UI/N

Homopolar toroid for the earthing conductor (star center of the transformer)

PR122 and PR123 microprocessor-based electronic releases may be used in combination with an external toroid located on the conductor, which connects the star center of the MV/LV transformer (homopolar transformer) to earth: in this case, the earth protection is defined as Source Ground Return.
The In of the toroid can be regulated to 100 A, 250 A, 400 A, 800 A by using different combinations of the connections.
Reference figure in the electrical circuit diagrams : UI/0.

10.2 Mechanical accessories

Mechanical operations counter

This is connected to the operating mechanism by means of a simple lever mechanism. It indicates the number of circuit-breaker mechanical operations. The indication is visible on the front of the circuit-breaker from the outside.

Mechanical locks

a) Lock in open position

Different mechanisms are available which enable the circuit-breaker to be locked in the open position.
These devices can be controlled by:
– a key: a special circular lock with different keys (for a single circuit-breaker) or with the same keys (for several circuit-breakers). In the latter case, up to four different key code numbers are available.
– padlocks: up to 3 padlocks (not supplied): Ø 4 mm.

b) Circuit-breaker lock in connected - test isolated - disconnected position

This device can be controlled by a special circular lock with different keys (for a single circuit-breaker) or with the same keys (for several circuit-breakers available up to four different key code numbers) and by padlocks (up to 3 padlocks, not supplied - Ø 4 mm).
Only available for circuit-breakers in withdrawable versions for installing on the moving part.

c) Accessories for lock in test isolated - disconnected position

In addition to the circuit-breaker lock in the connected - test isolated - disconnected position, this allows locking only in the disconnected or test isolated positions. Only available for circuit-breakers in withdrawable versions for installing on the moving part.

d) Accessories for shutter padlocks

They enable the shutters to be padlocked (installed on the fixed part) in the closed position. Only available for circuit-breakers in withdrawable versions for installing on the fixed part.

e) Mechanical lock on compartment door

This prevents the compartment door from being opened when the circuit-breaker is closed (and connected in the case of withdrawable circuit-breakers) and prevents circuit-breaker closing with the compartment door open.

f) Lock in open position with Kirk lock (internal or on front door)

This makes it possible to lock the circuit breaker in the open position using a Kirk key lock (not supplied).
For use on fixed circuit breakers, the accessory must be ordered together with the interlock plate for fixed circuit breakers.

g) Fail Safe device (to prevent extraction while the spring is loaded)

This makes it impossible to withdraw the mobile part of the circuit breaker from a withdrawable model if the closing springs are loaded.
The accessory is supplied standard for all withdrawable circuit breakers.
It is also available for withdrawable versions to be installed on the mobile part.

WARNING:
This is incompatible with undervoltage releases (YU)

Transparent protection covers

a) Protection covers for opening and closing pushbuttons

These protection covers, applied over the opening and closing pushbuttons, prevent the corresponding circuit-breaker operations except by using a special tool.

b) IP54 door protection (NEMA 3/3S/13)

This is provided by means of a transparent plastic escutcheon plate which fully protects the front of the circuit-breaker and ensures a degree of protection to IP54. Mounted on hinges, it is fitted with a key lock.

Interlock between circuit-breakers

This mechanism makes the mechanical interlock between two or three circuit-breakers (even of different sizes and in any fixed/withdrawable version) by means of a flexible cable. The electrical circuit diagram for the electrical changeover by means of a relay (to be provided by the customer) is supplied with the mechanical interlock. The circuit-breakers can be installed vertically or horizontally.
4 types of interlock are available:
type A: between 2 circuit-breakers (power supply + emergency)
type B: between 3 circuit-breakers (2 power supplies + emergency)
type C: between 3 circuit-breakers (2 power supplies + bus-tie)
type D: between 3 circuit-breakers (3 power supplies / a single closed circuit-breaker)

10.3 Spare parts

The spare parts available are:
- Shields and front escutcheon plate
- Opening solenoid for the PR121 / PR122 / PR123 overcurrent release
- Arcing chamber
- Closing springs
- Jaw-type isolating contact for fixed part of the withdrawable circuit-breaker
- Sliding earth contact (for withdrawable version)
- Fixed part shutters
- Complete pole
- Operating mechanism

- Current sensors and connection cables with the release
- Transparent protection for releases PR121, PR122 and PR123
- SACE PR030/B power supply unit
- Tool case
- Front escutcheon plate for Ronis-type key lock

For further details, ask for the ABB SACE spare parts catalogue.

11. Protection releases - General characteristics

Emax, the range of ABB air circuit breakers, now has a new range of electronic relays.

These are called PR121, PR122 and PR123, and they substitute the previous range PR111, PR112 and PR113.
The new protection releases integrate all the functions of their predecessors, adding new and interesting technical features that are useful for satisfying every current and future system installation need.
Every operational requirement is now met thanks to the different performance levels of the new relays and of the additional modules that can be fitted inside them (PR120/V, PR120/K, PR120/D-M, PR120/D-BT).

A table can best illustrate the technical features and the mix and matchability of the three relays.

Function/Unit	PR121	PR122	PR123
Current protections (L, S, I, G)	**S**	**S**	**S**
Additional protections (U, OT)	**-**	**S**	**S**
Voltage protections (D, UV, OV, RV, RP, UF, OF)	**-**	**S** (4)	**S**
Harmonics analysis	**-**	**-**	**S**
Temperature protection	**-**	**S**	**S**
Local bus for separate auxiliary units	**S**	**S**	**S**
Cable communication (RS485)	**-**	**S** (3)	**S** (3)
Radio communication (wireless Bluetooth)	**S** (1)	**S** (1,2)	**S** (1,2)
Data Logger	**-**	**S**	**S**
Compatibility with SD.Pocket	**S**	**S**	**S**
Compatibility with SD.Testbus	**S**	**S**	**S**
Compatibility with PR010/T	**S**	**S**	**S**
PR120/V Measuring (internal voltages module)	**-**	**O**	**S**
PR120/K Signalling (internal signalling module)	**-**	**O**	**O**
PR120/D-M Com (internal communication module)	**-**	**O**	**O**
PR120/D-BT WL-Com (internal Bluetooth communication module)	**-**	**O**	**O**
PR021/K (separate signalling unit)	**O**	**O**	**O**
HMI030 (separate graphics interface)	**O**	**O**	**O**
PR030/B (separate power supply unit)	**O**	**S**	**S**
BT030 (separate Bluetooth communication unit)	**O**	**O**	**O**

Key:
S : standard function/unit,
O : optional function/unit,
- : function/unit unavailable.

Notes:
1. : with separate BT030 unit (for temporary connection),
2. : with internal PR120/D-BT module,
3. : with PR120/D-M module,
4. : with PR120/V module.

The main features and improvements of the new relay PR12x with respect to the earlier PR11x are (depending on the combination of relay-modules):
1. High current reading accuracy (1.5%) and numerous other functions.
2. The PR120/V module for measuring line voltages up to 690 V, is integrated in the relay, making a separate voltage transformer unnecessary.
3. Double settings for the protection functions.
4. Input can be combined with actions selectable by the user (with PR120/K).
5. Four power outputs fully-configurable by the customer in terms of status, delay and type (with PR120/K).
6. Wireless Bluetooth connection to PDA and/or PC (with PR120/D-BT).
7. Freely available software for relay testing and maintenance.
8. High-performance data logger with 8 analogue signals and 4 digital signals, which can be synchronized with hundreds of events/situations of the user's choice.
9. Relay powered even with the circuit-breaker open, using the busbar voltages (with PR120/V).
10. New residual-current function (Rc).
11. Double protection G function, with simultaneous reading from two sensors (PR123).
12. Continuous control of the connection of the current sensors and trip coil (all relays).
13. Analysis up to the 40th harmonic.
14. Cause of trip is memorized even in self-powered mode (all relays).
15. PR121 with serial link for separate PR021/K and HMI030 module.
16. Extended neutral selection.
17. Double protection S (PR123).
18. Date and time in "real time" (all relays).

11.1 Safety notes

WARNING: this symbol gives information about operations, actions or circumstances that can cause injuries to the personnel, damage to the unit or economic losses.
Read this manual carefully and completely .
The use of this device should be reserved for qualified and expert personnel only.
If in doubt about its safe usage, the unit must be put out of service to prevent any accidental use.

You must assume that safe usage is impossible if:
1. the unit shows visible signs of damage
2. the unit does not function (for example with autotest or with the trip test unit)
3. the unit has been damaged in transit.

The circuit breaker must be opened before doing any action or substitution.
Remove also all the connected supply.

11.1.1 Notes for dielectric stiffness tests

Dielectric stiffness tests on the releases' inputs and outputs are not permitted.

11.2 Abbreviations and notes

11.2.1 Abbreviations

Abbreviations	Meaning
BA	Opening coil
BC	Closing coil
BT030	Wireless communication unit
CB	Circuit Breaker (for example Emax)
CS	Current Sensor (current transformer)
PDA	Pocket Pc with Bluetooth
Emax	Series of ABB SACE air circuit-breakers
HMI 030	Human Machine Interface
HW	Hardware
In	Rated current of the Rating Plug installed in the circuit breaker
MT	Thermal memory
Pn	Circuit-breaker rated power
Pnphase	Phase rated power
PR120/K	Internal signalling unit of alarms and trips on the circuit-breaker
PR120/V	Measuring module
PR021/K	Signalling unit
PR120/D-M	Communication module
PR120/D-BT	Wireless communication module
PR010/T	ABB SACE unit test
PR121/P	Protection relay for CB Emax
PR122/P	Protection relay for CB Emax
PR123/P	Protection relay for CB Emax
PR030/B	ABB SACE power supply unit
Relay	also called "protection unit" or "protection release"
RMS	Root mean square value
TC	Trip Coil (opening solenoid)
SdZ	Zone selectivity
SGR	External toroid
SW	Software
i-Test	"Info/test" button on the front of the relay
Trip	CB opening, generated by the release
VT	Voltage transformer (see also VS)
Un	Rated voltage of the voltage transformers installed (phase voltage)
Vaux	Auxiliary power supply
VS	Voltage Sensor (see also VT)
ZS	Zone selectivity

11.2.2 Notes

A. Use the "Belden 3105A"- type two-wire cable for instance (not supplied by ABB SACE).

B. Use the "Belden 3106A"- type three-wire cable for instance (not supplied by ABB SACE).

C. The unit has a "backup-protection" function; if the first command to the opening solenoid does not open immediately the circuit-breaker (TC partially fault), TRIP commands are repeatedly sent until the circuit-breaker opens (providing a Vaux is present) or the current disappears (if self-power supplied). The "backup" condition can be signalled by configuring the unit relays; using the "YO back" selection, it is possible to command the "opening coil (YO)" accessory as another opening device if TC does not work.

12. SACE PR121/P Release - Identification

The PR121/P units available, in accordance with the IEC standards, together with the various protections and the various standard and optional modules, are illustrated in the following figure:

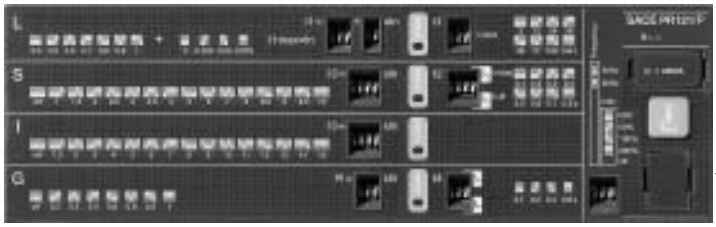

	PR121/P	PR121/P	PR121/P
Protections	L I	L S I	L S I G

Optional modules available

BT030	Opt.

12.1 Standard

The PR121/P has been designed to work in accordance with the international standard:
Low voltage AC and DC power circuit breakers used in ANSI/UL 1066 enclosures.

12.2 Specifications

12.2.1 General

The PR121/P unit is a high-performance self-supplied protection unit with Protection functions for the ABB SACE 'Emax' range of 3-pole and 4-pole low voltage air circuit-breakers. The unit's user interface also enables parameter setup and complete pre-alarm and alarm management with LED warning/alarm indicators for the protection and watchdog functions.

Depending on the version, the protections available are as follows:

Symbol	Protection against
L	overload with inverse long time delay
S	short-circuit with adjustable delay
I	instantaneous short-circuit
G	earth fault with adjustable delay

The PR121/P can be installed on 3-pole CBs with and without an external neutral, or on 4-pole CBs.

It should be noted that the reference current for the PR121/P is the In (the rated current defined by the Rating Plug) and not the Iu (the uninterrupted rated current of the CB itself).
Example: the CB E1B800 with a 400A Rating Plug has an Iu of 800A and an In of 400A.

The unit opens the circuit breaker in which it is installed by means of the TC, which takes effect directly on the device's mechanical leverism.

The unit is made using digital microprocessor technology and interfaces with the user by means of DIP switches. The unit's protection parameters and general operating mode can be set entirely by the user.

12.2.2 Electrical characteristics

Rated operating frequency	50/60 Hz ±10%
Pass band	3000 Hz max
Peak factor	6.3 max @ 2 In
MTBF (MIL-HDBK-217E)	15 years @ 45°C

12.2.2.1 Self-supply

The unit requires no outside power source for the protection and alarm signal functions. It is self-supplied by the current sensors installed on the circuit breaker. For it to function, it simply needs the current defined below to be flowing in at least one phase. An outside power source can, however, be connected to enable other functions and particularly for its connection to the separate devices: HMI030 and PR021/K.
The characteristics of the busbar current are given in the table below:

Characteristics	E1 - E2 - E3	E4 - E6
Minimum single-phase busbar current for the complete activation of release protection function.	70 A	140 A

12.2.2.2 Auxiliary power supply

The external auxiliary power supply is provided using a galvanically-separated power pack.

Since the auxiliary voltage needs to be isolated from the ground, "galvanically separated converters" in accordance with the IEC standard 60950 (UL 1950) or the equivalent IEC 60364-41 and CEI 64-8 have to be used to guarantee a current in common mode or leakage current (as defined in IEC 478/1 and CEI 22/3) no greater than 3.5mA.

The presence of the auxiliary power supply enables the relay unit to be used even with the circuit breaker open.
The characteristics of the power pack are given in the table below.

Characteristics	Version PR121/P
Auxiliary voltage (galvanically separated)	24V DC ±20%
Maximum ripple	5%
Inrush current @ 24 V	~10A for 5ms
Rated power @ 24 V	~2W

12.2.3 Environmental characteristics

Operating temperature	-25°C ... +70°C
Storage temperature	-40°C ... +90°C
Relative humidity	0% ... 98% with condensation
Degree of protection (with PR121/P installed in the CB)	IP 30

12.2.4 Communication bus

Local internal bus on rear connector; RS485 physical interface, ABB SACE protocol.

12.2.5 Protection functions

The PR121/P protection unit carries out 5 independent protection functions. In particular:
1. protection against overload with inverse time "**L**";
2. protection against short-circuit with adjustable delay "**S**";
3. protection against instantaneous short-circuit "**I**";
4. protection against earth fault with adjustable delay "**G**";
5. protection against instantaneous short circuit at high currents "**linst**".

The PR121/P unit allows current signal processing of the neutral pole with different relationships relative to the value of the phases.
N.B.: Beyond 15.5xIn of current on the Ne, the protection is considered as being set to 100%.

A timing indication ("alarm" LED) is provided on the front of the unit, which is enabled during an alarm for each protection. It is disabled when the alarm condition ceases or when the protection has been tripped.
The unit also has a "backup protection" function. If the circuit breaker does not open immediately the first time the Trip Coil is hit (partial TC failure), TRIP commands are sent repeatedly until the circuit breaker opens.
For the inverse-time protections, the relationship between trip time and overcurrent is given by the formula: $t=k/I^2$.
For the fixed-time protections with an adjustable delay, the relationship adopted is as follows: $t=k$.

12.2.5.1 Rms and peak calculation

All the protection functions do their respective processing on the basis of the real rms value of the currents (the protection G is disabled for current values greater than 8 In [where $I_4 \geq 0,8In$], greater than 6In [where $0,5In \leq I_4 < 0,8In$] and greater than 4 In [where $I_4 < 0,5In$]).
For currents higher than 6xIn, and for the "I" function, processing takes into account the peak value divided by $\sqrt{2}$ (so the sinusoidal wave form is considered); this is due to incompatibility between the trip time and the rms value calculation time.
If the waveform has a deformation beyond the declared limit (6.3@2 In), the tolerance for the calculation of the true rms value will increase.

12.2.5.2 Watchdog

The PR121/P unit provides some watchdog functions able to guarantee the proper management of relay malfunctions. These functions are as follows:

- ❑ Rating PLUG validity
- ❑ Watchdog for proper current sensor connection (CS). Any anomalies are indicated by the LED coming on, as explained in par. 12.7.1.
- ❑ Watchdog for proper opening solenoid connection (TC). Any anomalies are indicated by the LED coming on, as explained in par. 12.7.1.
- ❑ Watchdog for protection against Hw Trip. If the sensors are disconnected or there is a Rating Plug error, a CB opening command is issued due to the TC being activated.

12.2.6 Description of the protection functions

12.2.6.1 Protection "L"

The "L" is the only protection that cannot be disabled because it is for self-protection against overloading of the relay itself.
The type of curve that can be set is $t=k/I^2$.
The inverse-time protection trip time is given by the expression

$$\max\left[\frac{9 \cdot t_1}{(I_f / I_1)^2}, 1\right] \text{ where } I_f \leq 12In, \text{ 1s where } I_f > 12In$$

I_f is the fault current and I_1 the protection threshold, established by the user.
NB: Time expressed in seconds

12.2.6.2 Protection “S”

This protection can be disabled; it can be of the fixed time (t=k) or dependent time ($t=k/I^2$) type; In the latter case, the trip time is given by the expression:

$$\max\left[\ \frac{100\cdot t_2}{(I_f)^2},\ t_2\ \right]\quad \text{where } I_f > I_2$$

I_f is the fault current and I_2 the protection threshold, established by the user.
NB: Time expressed in seconds.

12.2.6.3 Protection “I”

This protection can be disabled; it is of the fixed time (t=k) type, and is designed for a nil intentional delay.

12.2.6.4 Protection "G"

This protection can be disabled; it can be of the fixed time (t=k) or inverse time ($t=k/i^2$) type. In the latter case, the trip time is given by the expression:

$$\max\left[\ \frac{2}{I^2},\ t_2\ \right]\quad \text{where } I = I_f / I_4$$

I_f is the fault current and I_4 the protection threshold, established by the user.
NB: Time expressed in seconds.

The PR121/P unit can provide earth fault protection, achieved inside the relay by vectorially adding together the phase and neutral currents. The fault current is defined by the following formula:

$$\overrightarrow{I_G} = \vec{I}_1 + \vec{I}_2 + \vec{I}_3 + \vec{I}_N$$

If the circuit reveals no faults, the module of the sum of these currents is always nil; vice versa, the value of the fault current takes on a larger and larger value depending on the entity of the fault.

12.2.6.5 Protection against instantaneous short-circuit “Iinst”

This function has a single fixed-time protection curve.
When the protection is tripped, the circuit breaker is opened by the opening solenoid (TC).

12.2.7 Summary table of protections

Protection	Disabling	Trip threshold	Trip time	Trip threshold tolerance	Trip time tolerance
L ($t=k/I^2$)	☐	**I1 =** 0.4 - 0.425 - 0.45 - 0.475 - 0.5 - 0.525 - 0.55 - 0.575 - 0.6 - 0.625 - 0.65 - 0.675 - 0.7 - 0.725 - 0.75 - 0.775 - 0.8 - 0.825 - 0.85 - 0.875 - 0.9 - 0.925 - 0.975 - 1 x In	t1 = 3 - 12 - 24 - 36 - 48 - 72 - 108 - 144 s [1] @ 3 I1	Release between 1.05 and 1.2 x I1	± 10% $I_f \leq 6$ x In ± 20% $I_f > 6$ x In
S ($t=k$)	☒	**I2 =** 1 - 1.5 - 2 - 2.5 - 3 - 3.5 - 4 - 5 - 6 - 7 - 8 - 8.5 - 9 - 9.5 - 10 x In	where I > I2 t2 = 0.1 - 0.2 - 0.3 - 0.4 s	± 7% $I_f \leq 6$ x In ± 10% $I_f > 6$ x In	The best of the two data: ± 10% or ± 40 ms
S ($t=k/I^2$)	☒	**I2 =** 1 - 1.5 - 2 - 2.5 - 3 - 3.5 - 4 - 5 - 6 - 7 - 8 - 8.5 - 9 - 9.5 - 10 x In	t2 = 0.1 - 0.2 - 0.3 - 0.4s @ 10 In	± 7% $I_f \leq 6$ x In ± 10% $I_f > 6$ x In	± 15% $I_f \leq 6$ x In ± 20% $I_f > 6$ x In
I ($t=k$)	☒	**I3 =** 1.5 - 2 - 3 - 4 - 5 - 6 - 7 - 8 - 9 - 10 - 11 - 12 - 13 - 14 - 15 x In	≤ 30 ms	± 10%	
G ($t=k$)	☒	**I4 =** 0.2 - 0.3 - 0.4 - 0.6 - 0.8 - 0.9 - 1 x In	where I > I4 t4 = 0.1 - 0.2 - 0.4s	± 7%	The best of the two data: ± 10% or ± 40 ms
G ($t=k/I^2$)	☒	**I4 =** 0.2 - 0.3 - 0.4 - 0.6 - 0.8 - 0.9 - 1 x In	t4 = 0.1 s @ 4,47 I4 0,2 s @ 3,16 I4 0,4 s @ 2,24 I4	± 7%	± 15%
I inst	☐	Automatic, defined by SACE	Instantaneous	± 5%	+1ms

(1) The minimum value of this trip is 1s regardless of the type of curve set (self-protection).

(2) These tolerances apply in the following conditions:
- self-powered relay at full power (without start-up)
- presence of auxiliary power supply
- two-phase or three-phase power supply
- Preset trip time ³100ms

I4 threshold	Inhibition G threshold
I4 < 0,5 In	4 In
0,5 In ≤ I4 < 0,8 In	6 In
I4 ≥ 0,8 In	8 In

For all cases not covered by the above hypotheses, the following tolerances apply:

Protections	Trip threshold	Trip time
L	Release between 1.05 and 1.25 x I1	± 20%
S	± 10%	± 20%
I	± 15%	≤ 60ms
G	± 10%	± 20%
Others	± 20%	

12.2.8 Measurements

The PR121/P protection unit can take the various types of measurement shown in the following table with the corresponding tolerances.

Type of measurement	Tolerance	
	Range	%
Phase and neutral current	0.3 ... 6 In	1.5
Earth fault current	0.3 ... 4 In	1.5

12.2.9 Trip curves

The trip curves provided are merely for guidance and only show a sub-group of the possible selections (see par. 12.2.7).

12.2.9.1 Trip curves for functions L-I

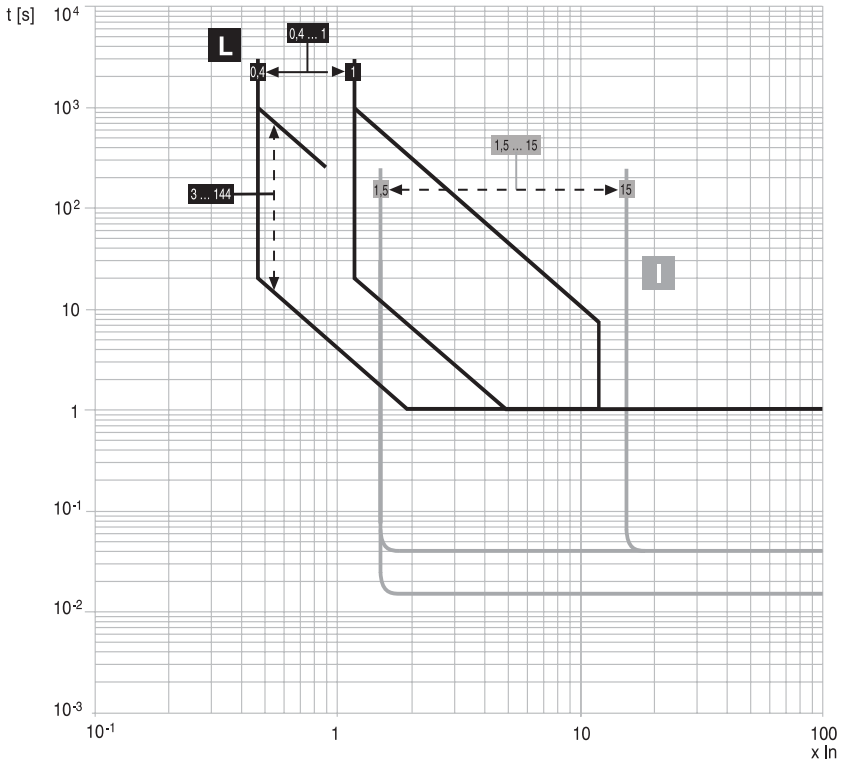

12.2.9.2 Trip curves for functions L-S(t =k/I²)-I

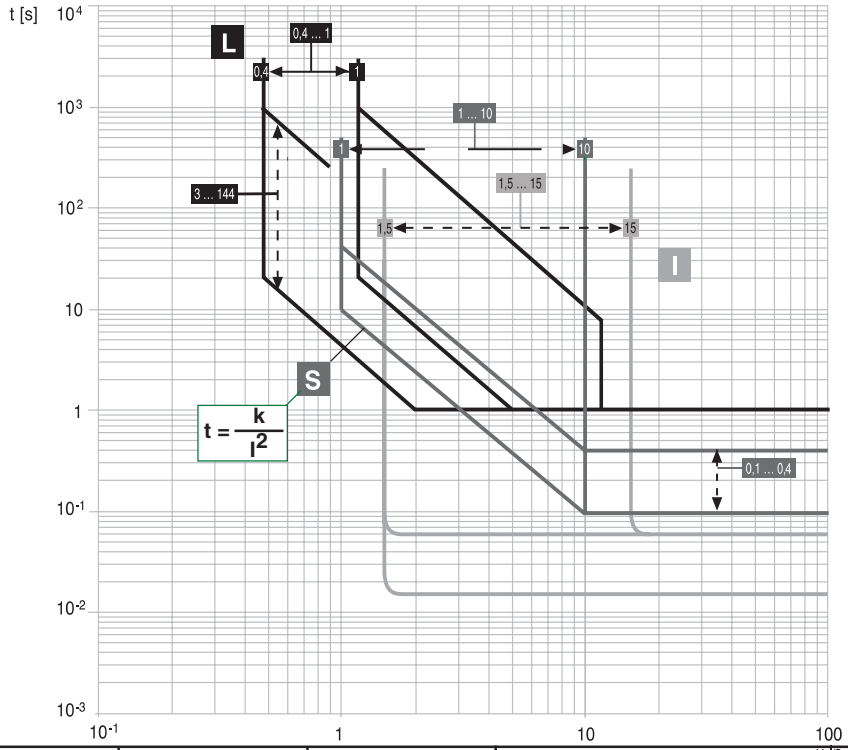

12.2.9.3 Trip curves for functions L-S(t=k)-I

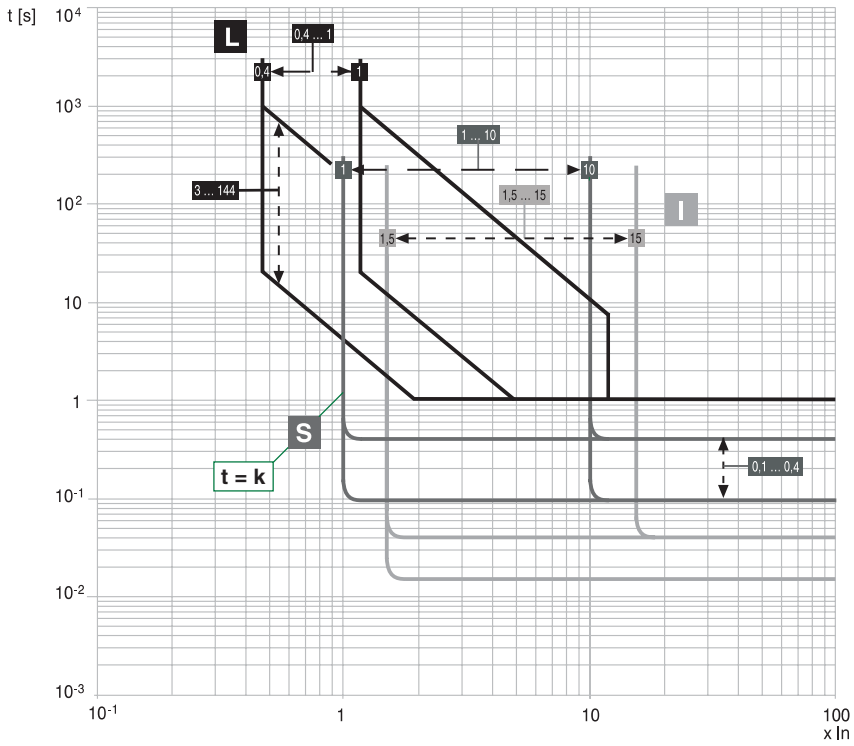

12.2.9.4 Trip curves for function G

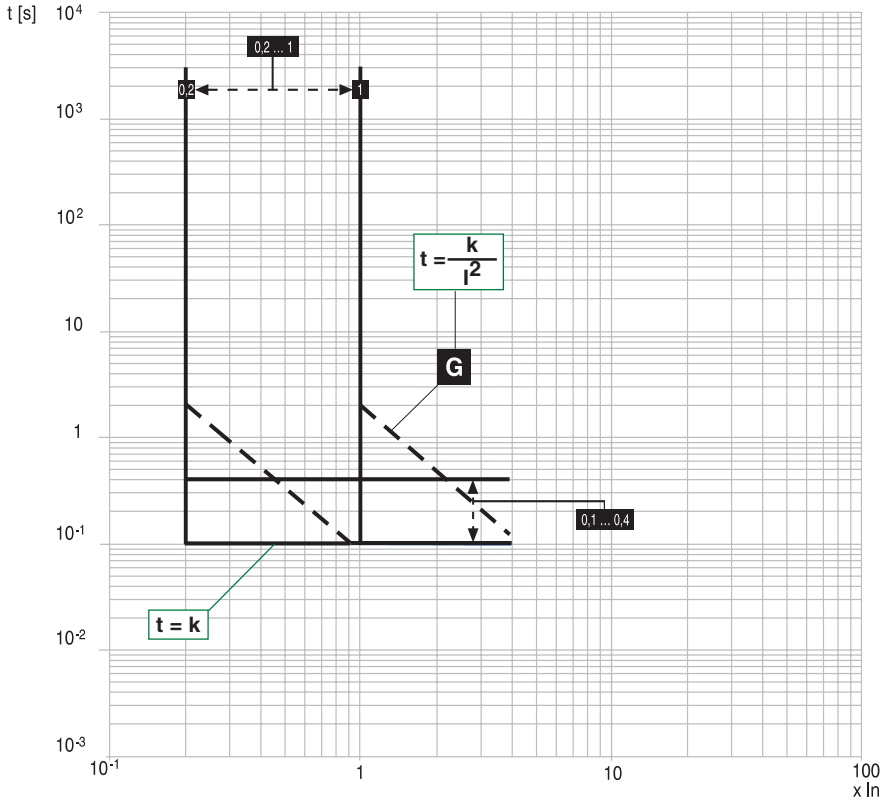

12.3 Other functions

12.3.1 Indication of the cause of the trip and trip test button

Using the "i Test" button, you can retrieve the information stored in the past 48 hours. You can also perform a trip test by pressing and holding the button for 7 seconds with Vaux and/or a current to the phases, and an Autotest by pressing and holding the button for 3 seconds, again with the PR030/B battery unit connected.

12.4 Putting into service

12.4.1 Connections

For the connections provided by the user, it is recommended that you comply strictly with the recommendations contained in this document.
This will enable us to satisfy all the international reference standards and guarantee perfect operation of the relay even under severe environmental and electromagnetic conditions. Take particular care with the earthing connections.

12.4.2 CS and TC connection check

If the PR121/P has been installed by the user, it is advisable (with the CB open and Vaux or the PR030/B) to check the proper connection of the TC and/or CS cables before putting the circuit breaker into service; if this has not been done, make the right connections. If any of the red LEDs come on, this means an error in the connection of the CS and/or TC. See par. 12.7.1.

12.4.3 Current sensor connection for external neutral

If you want to connect the current sensor for the external neutral conductor to a three-pole circuit breaker, remember to set InN accordingly (see par 12.5, ref. 14).
During this procedure, the circuit breaker must be open and preferably isolated.

12.5 User interface

Captions on the front of the PR121/P unit:

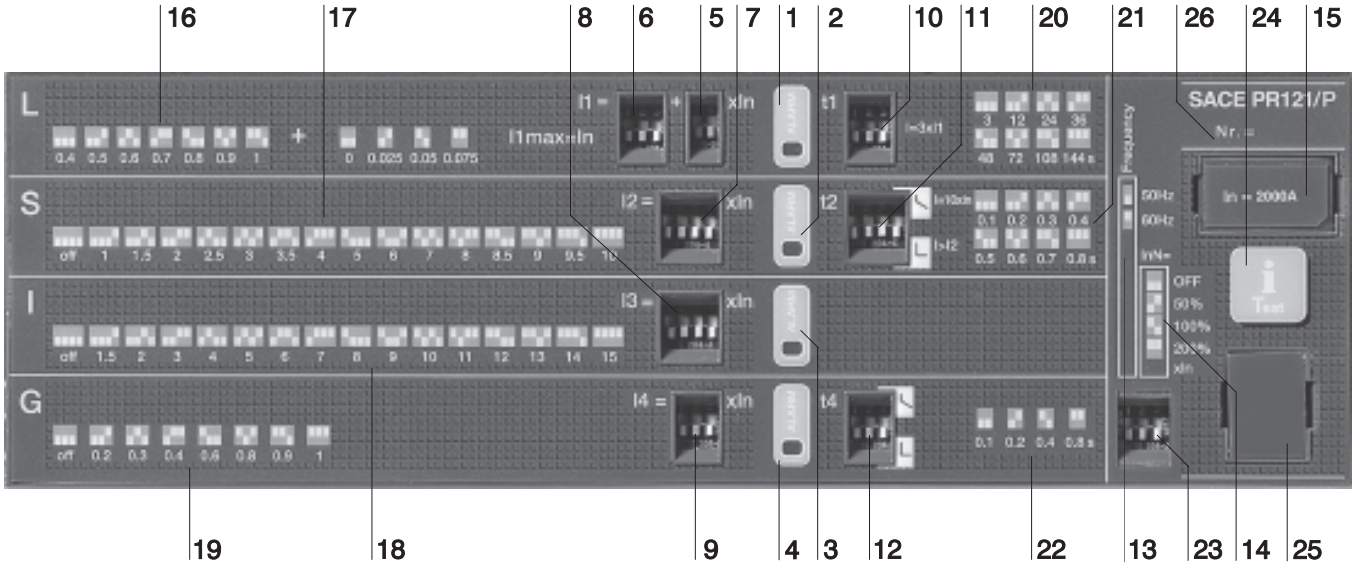

Ref.	Description
1	Alarm indicator LED for protection function L
2	Alarm indicator LED for protection function S
3	Alarm indicator LED for protection function I
4	Alarm indicator LED for protection function G
5	DIP switch for fine-setting of current threshold I1
6	DIP switch for the main setting of the current threshold I1
7	DIP switch for setting current threshold I2
8	DIP switch for setting current threshold I3
9	DIP switch for setting current threshold I4
10	DIP switch for setting trip time t1

Ref.	Description
11	DIP switch for setting trip time t2 and type of curve
12	DIP switch for setting trip time t4 and type of curve
13	Position indicator for the DIP switches for the mains frequency
14	Position indicator for the DIP switches for setting the neutral protection
15	Rating plug
16	Position indicator for the DIP switches for setting the threshold I1
17	Position indicator for the DIP switches for setting the threshold I2
18	Position indicator for the DIP switches for setting the threshold I3
19	Position indicator for the DIP switches for setting the threshold I4
20	Position indicator for the DIP switches for setting the time t1
21	Position indicator for the DIP switches for setting the time t2
22	Position indicator for the DIP switches for setting the time t4
23	DIP switch for setting the mains frequency and adjusting the neutral protection
24	"i Test" test and info button
25	Test connector for connecting or testing the release using an external device (PR030/B battery unit, BT030 wireless communication unit and SACE PR010/T unit)
26	Serial number of the PR121/P protection release

12.5.1 Trip Test

Before you start, it is advisable to run a test ("Trip test") on the whole TC chain by pressing and holding the button "i Test" for at least 7 s. A positive outcome is shown by the circuit-breaker opening (see Watchdog). To be able to do the test, you need to connect the PR030/B battery unit.

12.5.2 Initial settings

ABB SACE will see to applying the adhesive labels on the PR121/P for all the variables relating to the circuit breaker (e.g. Type of circuit breaker, Rating Plug size, etc.)
It should be noted that ABB SACE provides a sensible definition for each possible setting (see par. 12.5.4).

Before putting the PR121/P into service, it is nonetheless absolutely essential for the user to carefully define each parameter that can be changed.

12.5.3 Changing protection functions

This paragraph explains how to set the protection functions implemented in the PR121/P unit. Only the setting methods and which values can be selected are explained here. For all other information on the technical characteristics of the protection functions, see par.12.2.5.

No parameter settings can be made if the PR121/P unit is in alarm conditions.

12.5.3.1 Example of setting

In the diagrams on the front plate (see par. 12.5) relating to the settings, the position of the DIP switch is indicated by the white part.

An example of how to set the DIP switch for the protection function L is given below, where I_n = 2000A:

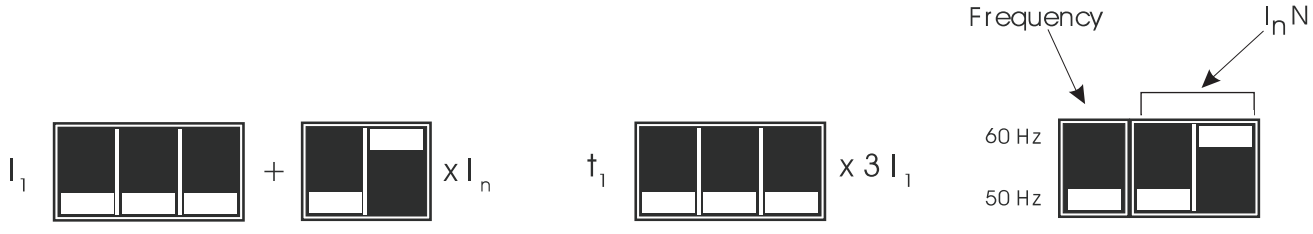

I1 = 0,4 + 0.025 x In
I1 = 850A

t1 = 3s@2.550A (3*I_1)

Frequency = 50 Hz
I_nN = 50%

A faulty configuration of the dip-switches generates an inconsistency setting error which is signalled by means of a LED (see par.12.7.1). You must respect this rule: I1< I2 < I3. For example: if I1=1In and I2=1In, the protection release indicates an "inconsistency setting error". The same led signalling appears if I2=5In and I3=4In.

12.5.4 PR121/P unit default settings

The PR121/P is supplied by ABB SACE with the following preset parameters:

#	Protection	Thresholds	Time
1	**L**	1 In	144 s
2	**S**	Off	0.1 s
3	**I**	4 In	–
4	**G**	Off	0.1 s
15	**Net Frequency**	50 Hz	
18	**Neutral sel.**	*	

*= OFF for three-pole versions

*= 50% for four-pole versions

*= 100% for full-size versions

12.6 Operating instructions / Operation in service

12.6.1 Adjusting the neutral

The neutral protection is normally set to a current value 50% of the adjustment made on the phases.
In some installations, where particularly high harmonics occur, the current circulating on the neutral may be higher than that of the phases.

In the SACE PR121/P release, this protection can be set for the following values: I_nN =0 - 50% - 100% - 200% * I_n.
The table below shows the values that can be set adjusting the neutral in the various possible combinations between types of circuit-breaker and adjustment of the threshold I_n.

With three-pole circuit breakers with no external neutral, the adjustment of the neutral must be set to OFF.

12.6.2 Table of neutral adjustments

Adjustments of the threshold I_1 (protection L)		
Circuit breaker size	**$I_1 \leq 0.5$**	**$I_1 > 0.5$**
E1	50-100-200%	50-100%
E2	50-100-200%	50-100%
E3	50-100-200%	50-100%
E4	50-100%	50%
E4/f	50-100-200%	50-100%
E6	50-100%	50%
E6/f	50-100-200%	50-100%

Note 1: The $I_1 = 1 I_n$ setting is intended as the maximum adjustment of the protection against overload. The actual maximum allowable adjustment must take into account any temperature derating, the terminals used and the altitude.

Failure to comply with the setting limits for "I_1" and "I_nN" can damage the circuit breaker, with consequent risks to the operator too.

The relay records any erroneous setting between I_1 and the neutral setting and signals this by means of a LED (see par. 12.7.1).

12.6.3 Replacing an electronic release

To complete the procedure for installing a PR121/P unit take the following steps:

1. With the circuit breaker open and possibly disconnected, install the protection unit on the circuit breaker.
2. Power the unit with the PR030/B ONLY.
3. If there are no errors other than the configuration error (flashing orange LED), press and hold the "i Test" button for a few seconds until all the red LEDs start to flash to confirm that installation is complete.
4. Remove the PR030/B.
5. Power the relay from any supply (Vaux, PR030/B, PR010/T).
6. Make sure there are no configuration errors (all LEDs off).
7. Circuit breaker and release can now be put into service.

12.6.4 Uninstalling the electronic release

To complete the procedure for uninstalling a PR121/P unit, follow the steps below:

1. Ensure the circuit breaker is in the open position and preferably isolated.
2. Power the unit with the PR030/B ONLY.
3. Press and hold the "i Test" button for a few seconds until all the red LEDs begin to flash on and off to confirm that the unit has been uninstalled.
4. Remove the release.

12.7 Definition of the alarms and signals for the PR121/P unit

12.7.1 Optical signals

The following table shows how the LEDs are managed in accordance with the IEC standard 60073 (and clause 4.2.3.2 in particular).
The LED alerts you to the status of the function set on its zone; e.g. in the figure in par. 12.5 the LED referenced as 1 identifies the status of the function L.

Type of information	Flashing slowly (0.5Hz)	Flashing fast (2Hz)			LED flashing with two 0.5 sec pulses every 2 sec		LED flashing with one pulse every 3 sec	LED on permanently		
	All LEDs	All LEDs	Single LED		All LEDs	Single LED	Single LED	All LEDs	Single LED	
	RED	RED	RED	ORANGE	RED	ORANGE	ORANGE	RED	RED	ORANGE
TC error		☒								
CS error	☒									
Rating Plug error					☒					
Protection timing alarm			☒							
Last trip (1)									☒	
Test button pressed and no failure detected (2)								☒		
Hardware Trip (3)									☒(4)	☒
L prealarm										☒
Configuration error (5)				☒						
Settings inconsistency						☒				
Normal relay operation (6)							☒			

(1) Information on the "Last trip" is displayed when the LED relating to the protection unit that has been tripped comes on. The LED remains on for 2 sec, or permanently if an outside power supply (from the PR030/B) is being used.
(2) The information is displayed with all the LEDs on for as long as the test button is pressed and held, or for 2 sec.
(3) Hardware trip, which causes CB opening in 1 sec, is activated when "Error CS" or "Error Rating Plug" occurs, or when Ne protection is set "ON" with 3p CB without Ne ext ("Configuration error"). In presence of Vaux and/or PR030/B (connected during the event) trip cause is shown (Error Cs, Error Rating Plug). In absence of Vaux and/or PR030/B, generic "HW trip" warning is shown, by means of "I-test" button push.
(4) Leds L (orange) and I (red)lighted.
(5) Installed valves are different from keyplug.
(6) If other signals aren't present, the unit's operating mode is indicated 3 sec after the unit has been turned on.

12.7.2 Troubleshooting

The following table lists a series of typical service conditions, to help you understand and solve hypothetical faults or malfunctions.

N.B.:
1. Before consulting the following table, check for a few seconds for any optical signals provided by the LEDs.
2. FN indicates the normal operation of the PR121/P.
3. If the following suggestions fail to solve the problem, please contact the ABB SACE customer support service.

N°	Situation	Possible causes	Suggestions
1	The trip test cannot be run	1. The busbar current is > 0. 2. The TC is not connected	1. FN 2. Check TC connection (see par.12.4.2)
2	Trip times lower than expected	1. Threshold too low 2. Curve too low 3. Incorrect neutral selection	1. Correct threshold 2. Correct curve 3. Correct neutral adjustment
3	Trip times higher than expected	1. Threshold too high 2. Curve too high 3. Curve type "t=k/I²" 4. Incorrect neutral selection	1. Correct threshold 2. Correct curve 3. Select curve type "t=k" 4. Correct neutral adjustment
4	Rapid trip, with I3=Off	Iinst tripped	FN short-circuit with high I
5	Earth fault current beyond threshold, but no trip occurs	G function automatically inhibited	FN
6	Expected trip does not happen	Function OFF	FN enable protection function if necessary

7	Led irregular lighting	see 12.7.1	
8	Unexpected trip	see 12.7.1	
9	L led flashing	Normal relay operation	FN

12.7.3 In the case of a fault

If the PR121/P is suspected of being faulty, there are signs of malfunctions or it has generated an unexpected trip, we advise you to strictly follow the recommendations below:

1. Press the "i Test" button (within 48 hours of opening the CB) and make a note of which LED is on, also recording the type of CB, the number of poles, any connected accessories, the In, and the serial number (see par. 12.5).
2. Prepare a brief description of the opening (when did it happen?, how many times?, was it always under the same conditions? what type of load? what current? is the event reproducible?)
3. Send/communicate all the information collected, together with the circuit diagram for the circuit-breaker, to your nearest ABB Customer Support service.

The more the information given to the ABB Customer Support service is complete and accurate, the easier the technical analysis on the problem encountered will be, enabling us to take all action to help the user without delay.

12.8 Accessories

12.8.1 ABB SACE PR010/T test and configuration unit

Testing with the SACE PR010/T unit enables you to monitor the proper operation of thresholds and trip times of the protection functions "L", "S","I", and "G". The test unit is wired to the relay by a dedicated connector (see ref. 25 par.12.5).

12.8.2 BT030 communication unit

Using the BT030 wireless communication unit, the PR121/P can be connected by radio to a hand-held PC (PDA) or normal PC, thus extending the amount of information available to the user. In fact, using the SD-Pocket communication software by ABB SACE, you can read the values of the currents flowing through the circuit breaker, the value of the last 20 currents broken and the protection settings.

12.8.3 PR021/K and HMI030 units

The PR121/P can also be connected to the optional PR021/K external signalling unit (see par. 16), for the signalling by means of no-potential power contacts of alarms and tripped protections, and to the HMI030 unit to view various kinds of information on the display.

12.8.4 PR030/B power supply unit

The PR030/B power supply unit is a separate unit for powering the relay, auto test and trip test.

13. SACE PR122/P Release - Identification

The PR122/P units available, in accordance with the IEC standards, together with the various protections and the various standard and optional modules, are illustrated in the following figure.

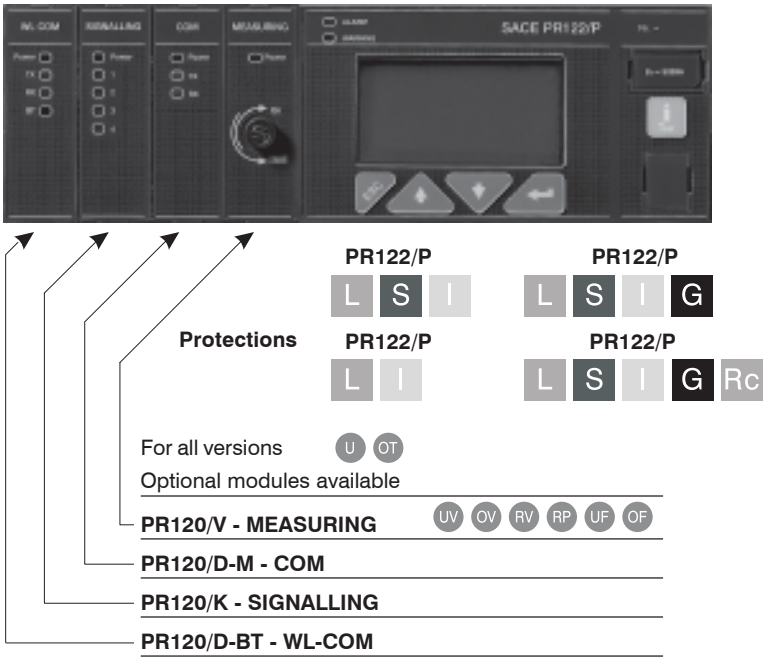

13.1 Standard

The PR122/P has been designed to work in accordance with the international standard:
Low voltage AC and DC power circuit breakers used in ANSI/UL 1066 enclosures.

13.2 Specifications

13.2.1 General

The PR122/P is a high-performance self-supplied protection unit with **Protection, Measurement, Data storage, Communication (optional), Self-test, Load control** and **Zone selectivity** functions for the ABB SACE 'Emax' range of 3- and 4-pole low-voltage air circuit breakers. The unit's user interface also enables parameter setup and complete the prealarm and alarm management for the protection and watchdog functions.

The protections available are:

Symbol	Protection against
L	overload with inverse long time delay
S	short-circuit with adjustable delay
I	instantaneous short-circuit
G	earth fault with adjustable delay
U	phase unbalance
OT	temperature out of range

The PR122/P can be installed on 3-pole CBs with and without an external neutral, or on 4-pole CBs.
It should be noted that the reference current for the PR122/P is the In (the rated current defined by the front Rating Plug) and not the Iu (the uninterrupted rated current of the CB itself). Example: the CB E1B800 with a 400A Rating Plug has an Iu of 800A and an In of 400A

The unit opens the circuit breaker in which it is installed by means of the TC, which takes effect directly on the device's mechanical leverism.
The protection unit is self-supplied by current sensors and primary voltages if the PR120/V module is installed.
The unit is made using digital microprocessor technology and interfaces with the user by means of a graphic display and keyboard.

With the optional PR120/V module, the PR122/P also assures the following protections:

Symbol	Protection against
UV	undervoltage
OV	overvoltage
RV	residual voltage
RP	reverse active power
UF	underfrequency
OF	overfrequency

13.2.2 Electrical characteristics

Rated operating frequency	50/60 Hz ±10%
Pass band	3000 Hz max
Peak factor	6.3 max @ 2 In
MTBF (MIL-HDBK-217E)	15 years @ 45°C

13.2.2.1 Self-supply

The self-supply enables the protection unit to be powered with the busbar current using current transformers.
Using this supply mode, the unit's protection functions are assured, however, not the accessory functions regarding the modules. The characteristics are given in the table below:

General characteristics	E1 - E2 - E3	E4 - E6
Minimum single-phase busbar current the complete activation of release protection function	70 A	140 A

13.2.2.2 Auxiliary power supply

The external auxiliary power supply is provided using a galvanically-separated power pack.

Since the auxiliary voltage needs to be isolated from the ground, "galvanically separated converters" in accordance with the IEC standard 60950 (UL 1950) or the equivalent IEC 60364-41 and CEI 64-8 have to be used to guarantee a current in common mode or leakage current (as defined in IEC 478/1 and CEI 22/3) no greater than 3.5mA.

The presence of the auxiliary power supply enables the relay unit to be used even with the circuit breaker open, as well as powering all the modules, with the exception of the PR120/V module, which is powered by means of a connection to the busbars.
The characteristics of the power pack are given in the table below.

Characteristics	Version PR122/P
Auxiliary voltage (galvanically separated)	24V DC ±20%
Maximum ripple	5%
Inrush current @ 24 V	~10A for 5ms
Rated power @ 24 V	~3W

13.2.2.3 Powered by the PR120/V module

For a full explanation of the features of the PR120/V, see par. 15.1.

13.2.3 Environmental characteristics

Operating temperature	-25°C ... +70°C
Storage temperature	-40°C ... +90°C
Relative humidity	0% ... 98% with condensation
Degree of protection (with PR122/P installed in the CB)	IP 30

13.2.4 Description of inputs/outputs

13.2.4.1 Binary opto-insulated inputs

– **K51/SZin:** Zone selectivity: input for protection S (only with Vaux)
– **K51/Gzin:** Zone selectivity: input for protection G (only with Vaux)

13.2.4.2 Binary opto-insulated outputs

– **K51/SZout:** Zone selectivity: input for protection S (only with Vaux)

– **K51/GZout:** Zone selectivity: input for protection G (only with Vaux)

13.2.5 Communication bus

Local internal bus on rear connector; RS485 physical interface, ABB SACE protocol.
External system bus, RS 485 physical interface, Modbus RTU protocol, baud rate 9600-19200 bps.

13.2.6 Protection functions

The PR122/P protection unit carries out 7 independent protection functions. In particular:

1. protection against overload with inverse time "**L**";
2. protection against short-circuit with adjustable delay "**S**";
3. protection against instantaneous short-circuit "**I**";
4. protection against earth fault with adjustable delay "**G**";
5. Protection against instantaneous short circuit at high currents "**Iinst**";
6. Protection against phase unbalance "**U**";
7. Protection against overtemperature "**OT**".

The PR122/P unit allows current signal processing of the neutral pole with different relationships relative to the value of the phases.
N.B.: Beyond 15.5xIn of current on the Ne, the protection is considered as being set to 100%.

A timing indication (message + "alarm" LED) is provided on the unit's display, which is activated during a protection alarm. It is disabled when the alarm condition ceases or when the protection has been tripped. When the circuit breaker opens, the page with the "Trip" data is displayed(when "i Test" is pressed, or automatically in the presence of Vaux).

With the optional PR120/V module, the PR122/P unit also has the following protection functions:

8. Protection against undervoltage "**UV**";
9. Protection against overvoltage "**OV**";
10. Protection against residual voltage "**RV**";
11. Protection against reverse active power "**RP**";
12. Underfrequency "**UF**";
13. Overfrequency "**OF**";

13.2.6.1 Rms and peak calculation

All the protection functions do their respective processing on the basis of the real rms value of the currents and voltages (the protection G is disabled for current values greater than 8 In (where $I_4 \geq 0.8In$), greater than 6In (where $0.5In \leq I_4 < 0.8In$) and greater than 4In (where $I_4 < 0.5In$)).
If the waveform has a deformation beyond the declared limit ($6.3@2I_n$), the tolerance for the calculation of the true rms value will increase. With the optional PR120/V module, the UV, OV, RV voltage protections always work on the basis of the true rms value of the voltages.

13.2.6.2 Mains frequency

The PR122/P unit constantly measures the frequency of the mains voltages it is connected to.

If the frequency goes out of the permitted range by ±10% in relation to the rated frequency selected (50 or 60Hz), the "warning" LED comes on and the warning message is displayed (see par. 13.6.3).
The signal can be combined with a relay of the PR120/K module or with those of the PR021/K unit.

13.2.6.3 Harmonic distortion

The PR122/P unit signals that a peak factor of 2.1 has been exceeded with a warning message and the "warning" LED lighting up (remember that the IEC 60947-2 standard annex "F" establishes that the protection unit must function regularly with a peak factor ≤ 2.1, up to 2x In).
The signal can be combined with a relay of the PR120/K module or with those of the PR021/K unit.

13.2.6.4 Circuit-breaker state

If an auxiliary supply is used, or it is powered from the optional PR120/V, the PR122/P unit records the state of the circuit breaker by means of specific wiring on the circuit breaker. In the case where the presence of current is determined with the circuit-breaker in the "OPEN" state, a state error is signaled by a warning message being displayed (see par. 13.6) and the "warning" LED lighting up.
The signal can be combined with a relay of the PR120/K module or with those of the PR021/K unit.

13.2.7 Measurement functions

The current measuring (ammeter) function is available on all versions of the SACE PR122/P unit.
The display shows histograms with the currents of the three phases and of the neutral on the main page. In addition, the current of the phase under the greatest load is given in numerical form. Where applicable, the earth fault current is displayed on a separate page.
The ammeter functions both in self-supply mode and with an auxiliary supply. In the latter case, the display is backlit and the ammeter is always active. The tolerance for the ammeter measuring chain (current sensor plus relay) is described in paragraph 13.2.9.11.2.

- Currents: three phases (L1, L2, L3), neutral (N), earth fault;
- Instantaneous current values over a given time interval (data logger);
- Maintenance: number of operations, percentage of contact wear, opening data storage (latest 20 trips and 20 events).

When the optional PR120/V is connected, the following additional measurement functions are provided:
- Voltage: phase-phase, phase-neutral, residual voltage;
- Instantaneous voltage values over a given time interval (data logger);
- Power: active, reactive, apparent;
- Power factor;
- Frequency and peak factor;

- Energy: active, reactive, apparent, meter;
- Maintenance: number of operations, percentage of contact wear, opening data storage.

13.2.8 Watchdog

The PR122/P unit provides some watchdog functions able to guarantee the proper management of relay malfunctions. These functions are as follows:

- ❑ Watchdog for presence of Auxiliary power supply with "plug" icon displayed.
- ❑ Rating PLUG validity
- ❑ Watchdog for proper connection of the current sensors (CS). Any anomalies are indicated by a special alarm message and the "alarm" LED coming on, and the circuit breaker opens after 1s.
- ❑ Watchdog for proper connection of the Trip Coil (TC). Any anomalies are indicated by a special alarm message and the "alarm" LED coming on; if the PR120/D-M module is installed, this activates the coil opening command (YO), thus opening the CB.
- ❑ Watchdog for protection against Hw Trip. If the sensors are disconnected or there is a Rating Plug error, a CB opening command is issued due to the TC being activated.

13.2.9 Description of the protection functions

13.2.9.1 Protection “L”

The "L" is the only protection that cannot be disabled because it is for self-protection against overloading of the relay itself. The types of trip curves settable are divided into two groups according to the standard they refer to.

Standard trip curve according to IEC 60947-2

Only one type of curve is settable ($t=k/I^2$) as defined by the IEC standard 60947-2.
The protection trip time - inverse time - is given by the expression:

$\frac{9 \cdot t_1}{(I_f / I_1)^2}$ where $I_f \leq 12In$ and 1s where $I_f > 12In$ where I_f is the fault current and I_1 the protection threshold

NB: Time expressed in seconds.

13.2.9.1.1 Thermal memory "L"

The thermal memory function can be enabled for cable protection. It is based on the “τL” parameter defined as the trip time of the curve (t1) selected at 1.25xI1.
The release trip time is certainly 100% of the one selected, after an interval τL has passed since the last overload or since the last trip. Otherwise, the trip time will be reduced, depending on the overload which has occurred and on the time that has elapsed.

The PR122/P is fitted with two instruments to make up this thermal memory. The first is only effective when the release is powered (it also records overloads that have not lasted long enough to trip the release), while the second works even when the release is not powered, reducing any trip times in the case of an immediate reclosing and is enabled as soon as the CB is tripped.
It is the PR122/P release that automatically decides which of the two to use, according to the various situations.
NB: The thermal memory function can only be set if the type of curve selected is the standard one ($t=k/I^2$) (see par. 13.2.9.1).

13.2.9.2 Protection “S”

This protection can be disabled; it can be of the fixed time ($t=k$) or inverse time ($t=k/i^2$) type; In the latter case, the trip time is given by the expression
NB: Time expressed in seconds.

$\max\left[\frac{100 \cdot t_2}{(I_f)^2}, t_2 \right]$ where $I_f > I_2$ where I_f is the fault current and I_2 the protection threshold

13.2.9.2.1 Thermal memory "S"

The thermal memory function can be enabled for cable protection in the case where the curve with inverse time is selected. This is based on the "tS" parameter defined as the trip time of the curve (t2) selected at 1.5xI2. The other characteristics are the same as those for thermal memory "L" (see par.13.2.9.1.1).

13.2.9.2.2 Start-up threshold “S”

The start-up function can be selected in the case where the curve with fixed time is selected.
The function can be disabled and it is a setting characteristic of the single protection units.

The start-up function enables the protection threshold (S, I and G) to be changed during a time interval lasting "ts", starting from "start-up". The latter must be intended as follows:
– Turning on of the relay, under self-supply;
– Passage of the peak value of the maximum current over 0.1xIn. A new start-up is possible after the current has dropped below 0.1xIn.

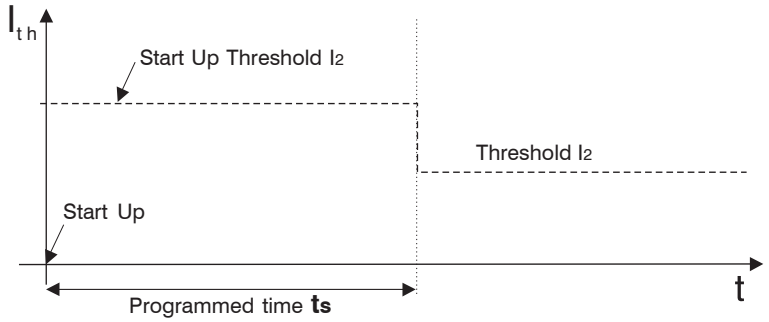

- **Start-up time**

The start-up time is common to all the protections involved.
Range: 0.1 s ... 1.5 s, with steps of 0.01 s.

13.2.9.2.3 Zone selectivity “S”

The zone selectivity function, guaranteed only if an auxiliary voltage is provided, enables the area of the fault to be isolated, only isolating the part of plant nearest to the fault, while keeping the rest of the plant operational.
This is done by connecting all the zone selectivity outputs of the releases belonging to the same zone to one another (ZSO=K51/SZout) and taking this signal to the zone selectivity input (ZSI=K51/SZin) of the next release on the supply side. If the wiring has been done correctly, all the zone selectivity inputs of the last circuit-breakers in the chain and all the outputs of the circuit-breakers at the head of each chain must be empty.

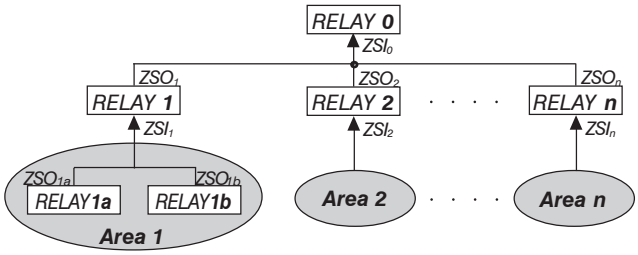

As a practical example, the figure above shows a fault on the load side of the "Relay 1a" isolated by the latter without the "Relay 1" or the "Relay 0" being affected; a fault immediately downstream from the "Relay 1" will be isolated by the latter without the "Relay 0" being affected, thus ensuring that the Areas 2...n remain operational.

The ZSO output can be connected to a maximum of 20 ZSI relays on the supply side in the selectivity chain.

The maximum length of cable for zone selectivity, between two units, is 300 meters.
Use corded shielded two-wire cable (see note A to par. 11.2.2).
The shield must only be earthed on the circuit-breaker of the supply-side relay (ZSI side).

Wiring and enabling zone selectivity "S" is an alternative to using protection "D" (if any) and operation is only guaranteed when there is an auxiliary voltage.
The following logical table is implemented to manage the Zone Selectivity Input (ZSI) and Zone Selectivity Output (ZSO) signals:

Zone selectivity	Imax > I_2	ZSI signal	ZSO signal	Trip T
Excluded	NO	0	0	No trip
Excluded	NO	1	0	No trip
Excluded	SI	0	0	t_2 programmed
Excluded	SI	1	0	t_2 programmed
Inserted	NO	0	0	No trip
Inserted	NO	1	1	No trip
Inserted	SI	0	1	$t_{selectivity}$
Inserted	SI	1	1	t_2 programmed

The time t_2 must be set at a value corresponding to at least $t_{selectivity}$ +50 ms.

13.2.9.3 Protection “I”

The protection is enabled/disabled from the menu.
In the case where zone selectivity "S" is active, during the trip of the relay for "I", the ZSO (or DFW and BFW) output signal is activated in any case to guarantee correct operation of the relay on the supply side (and on the load side).

13.2.9.3.1 Start-up threshold “I”

The start-up function can be selected.
The function can be enabled from the menu on the protection "I" page.
The function behaves in exactly the same way as the protection "S" (see par. 13.2.9.9.2).

13.2.9.4 Protection "G"

This protection can be disabled; it can be of the fixed time (t=k) or inverse time ($t=k/i^2$) type. In the latter case, the trip time is given by the expression.

$\max\left(\frac{2}{I^2}, t_4\right)$ where $I=I_f/I_4$, I_f is the fault current and I_4 is the protection threshold.

NB: Time expressed in seconds.

It is possible to disable the trip control of the protection ("EnableTrip: Off").
For the whole duration of the earth fault, circuit-breaker opening does not take place, but only the alarm condition is signaled ("Alarm" LED lit and alarm message).

The PR122/P unit can provide two different types of earth fault protection:

Internal protection G
This is provided inside the release by vectorially summing the phase and neutral currents. The fault current is defined by the following formula:

$$\vec{I}_G = \vec{I}_1 + \vec{I}_2 + \vec{I}_3 + \vec{I}_N$$

If the circuit reveals no faults, the module of the sum of these currents is always nil; vice versa, the value of the fault current takes on a larger and larger value depending on the entity of the fault. This operating mode is enabled by default.
N.B.: it can be used also with CS for an external neutral.

***Protection G with external toroid* "*Source Ground Return*"**
Also called "Source Ground return", this can be carried out when there is the need to check operation of a machine (transformer, generator or motor etc.) which has star-configured windings.
The protection is assured by physically positioning an external toroid on the cable connected from the star center of the machine to the earthing connection point.
The induced current on the winding of the toroid is proportional to the fault current which, in this case, only transits in the above-mentioned toroid.
To work in this mode, "Ground protection" must be selected on the Circuit breaker Settings menu.

The external toroid must be connected to the PR122/P by means of a corded shielded two-wire cable (see note A in par. 11.2.2) with a length not exceeding 15 m.
The shield must be earthed both on the circuit-breaker side and on the toroid side.

It is indispensable for the star center to be connected openly to earth and for it not to be used as a neutral conductor too (as in the TNC system), making a protection according to the TT system.
The protections G and Gext can be enabled simultaneously.

13.2.9.4.1 Start-up threshold “G”

The start-up function can be selected in the case where the curve with fixed time is selected.
The function can be enabled and disabled on the protection "G" page.
The function behaves in exactly the same way as the protection "S" (see par. 13.2.9.2.2).

13.2.9.4.2 Zone selectivity "G"

The zone selectivity function can be enabled providing the fixed time curve, the wiring and the zone selectivity "G" enabling alternative to the one for "D" have been selected and the function is assured only if auxiliary voltage is provided.

Zone selectivity "G" can be active at the same time as zone selectivity "S".
The behavior and wiring of the function are identical to those indicated for zone selectivity "S" (see par. 13.2.9.2.3).

13.2.9.5 Protection against phase unbalance "U"

The protection with fixed time, which can be excluded, trips in the case when, for a time greater than or the same as the time **t6** set, an unbalance is determined between two or more phases higher than the set threshold **I6**.

The percentage of unbalance is therefore calculated $\%Unb = \frac{I_{max} - I_{min}}{I_{max}} \cdot 100$ where I_{max} is the maximum and I_{min} is the minimum phase current.

It is possible to disable the trip control of the protection ("Enable Trip: Off").
In that case, for the whole duration of the unbalance the CB will not be opened, but only the condition will be signaled by means of the "warning" LED lit up and a warning message.
When the value of the phase current is above a 6xIn, the function "U" excludes itself because, in this case, the other protections intervene because the fault is considered as a phase fault.
The protection is not enabled for maximum phase current values lower than 0.3xIn.

13.2.9.6 Protection against overtemperature inside the relay, "OT"

There is a sensor inside the PR122/P unit that monitors the temperature of the unit.
This enables the signalling of any abnormal temperature conditions, which could cause temporary or continuous malfunctions of the unit's electronic components.

This protection has two states of operation:

State of "**WARNING TEMPERATURE**" with and the "WARNING" LED flashes | ***–25°C < temp. < -20°C*** | *or* | ***70°C < temp. < 85°C*** | : the display is turned off

State of "**ALARM TEMPERATURE**" with | ***temp. < –25°C*** | or | ***temp. > 85°C*** | : the display is turned off,

the "WARNING" led remains on and the Trip is activated (if enabled, by means of the "Over Temper. Trip = On" parameter).

N.B.:
- In the event of Warning and Alarm, the display is momentarily turned off, to preserve its functionality.
- The monitored temperature is not visible on the display.

The protection is always active, both with auxiliary supply and in self-supply.

Disabling the Trip control of the protection means that the PR122/P unit could work, with the circuit-breaker closed, in a range of temperatures where correct operation of the electronics is not guaranteed.

13.2.9.7 Load control function

Single loads can be enabled/disabled on the load side before the overload protection L intervenes and trips the circuit breaker on the supply side. This is done by contactors or switch-disconnectors (wired outside the release), controlled by the PR122/P by means of contacts on the PR120/K module or on the PR021/K external unit.

The current thresholds are lower than those available with the protection L, so that the load control can be used to prevent tripping due to overloads.
The function is active when an auxiliary power supply is present, or supply from PR120/V (see par. 15.1.4).
The operating logic involves the activation of three contacts when the preset thresholds LC1, LC2 and I_w are exceeded.
Thresholds LC1 and LC2 are expressed as a percentage of I_1 (current threshold specified for protection L) while the "warning current" I_w is expressed as an absolute value. The allowable values are given in the following table:

Warning current Iw	0.30 ÷ 3.00 step 0.05xIn
Threshold LC1	50% ÷ 100% step 1% xI_1
Threshold LC2	50% ÷ 100% step 1% xI_1

From the PR122/P you can associate each of the PR120/K or PR121/K contacts with a configuration (NO or NC), a delay and the eventual latch.

13.2.9.8 Voltage protections "UV", "OV", "RV" (PROTECTIONS AVAILABLE ONLY WITH THE ADDITIONAL PR120/V MODULE)

The PR122/P unit provides 3 voltage protections, which can be disabled, with fixed adjustable time (t = k), active both with self-supply and with auxiliary supply:
- Undervoltage "UV"
- Overvoltage "OV"
- Residual voltage "RV"

The protections work on the voltages. The threshold voltages indicated refer to the line voltage.

Apart from the normal timing and "Trip" operation, the voltage protections can be in a state defined as "alarm" (with the "emergency" led on and an alarm message displayed) providing there is an auxiliary or PR120/V module power supply. In fact, in the case where the circuit-breaker is open and no current is detected, the timing leads to the "alarm" state and not to "TRIP". This is because the fault linked to the voltages can persist even with the circuit-breaker open and the unit would therefore always be under "timing". When the circuit-breaker is closed or the passage of a current is detected, you pass immediately from the state of "alarm" to "TRIP" without timing (see par. 13.3.2).

13.2.9.8.1 Protection “UV”

When the minimum phase voltage drops below the set threshold U_8 the protection counts down the preset time interval t_8 and then opens.

13.2.9.8.2 Protection “OV”

When the maximum phase voltage exceeds the set threshold U_9 the protection counts down the preset time interval t_9 and then opens.

13.2.9.8.3 Protection “RV”

When the residual voltage exceeds the set threshold U_{10} the protection counts down the preset time interval t_{10} and then opens.

The residual voltage U_0 is calculated by vectorially summing the phase voltages. It is therefore defined by the following formula.

$$\overrightarrow{U_0} = \overrightarrow{U_1} + \overrightarrow{U_2} + \overrightarrow{U_3}$$

13.2.9.9 Reverse active power protection "RP" (AVAILABLE ONLY WITH THE ADDITIONAL PR120/V MODULE)

The PR122/P unit provides protection (which can be disabled) with an adjustable fixed time (t = k), against reverse active power, active both with self-supply and auxiliary supply.

When the total reverse active power (sum of the power of the 3 phases) exceeds the set reverse active power threshold P_{11}, the protection counts down the preset time interval t_{11} and then opens.
The minus sign ('-') in front of the threshold and power indicates reverse power. The threshold is indicated as a percentage of "Pn", where "Pn" is the rated power of the circuit-breaker (3 Vn*In).

13.2.9.10 Frequency protections "UF", "OF" (AVAILABLE ONLY WITH THE ADDITIONAL PR120/V MODULE)

The frequency protections record the mains frequency variations above an adjustable threshold (f_{12}, t_{12}) or below (f_{13}, t_{13}), generating an alarm or the opening of the circuit breaker.

13.2.9.11 Summary table of the protection function settings for the PR122/P

Protection	Disabling	Disabling of TRIP only	Zone selectivity	Start-up threshold	Thermal memory	Trip threshold	Trip time	Trip threshold tolerance (2)	Trip time tolerance (2)
L ($t=k/i^2$)	☐	☐	☐	☐	☒	0.4xIn $\le I_1 \le$ 1xIn step 0.01xIn	3s $\le t_1 \le$ 144s(1), step 3s at I=3xI_1	Release between 1.05 and 1.2 x I1	± 10%, $I_f \le$ 6In ± 20%, $I_f >$ 6In
S ($t=k$)	☒	☐	☒	☒	☐	0.6 xIn $\le I_2 \le$10xIn step 0.1xIn 0.6 xIn $\le I_{2\ start\text{-}up} \le$10xIn step 0.1xIn	Min, 0.05s $\le t_2 \le$ 0.4s, step 0.01s 0.10s $\le t_{2\ start\text{-}up} \le$ 1.5s, step 0.01s 0.04s $\le t_{2\ sel} \le$ 0.20s, step 0.01s	± 7%, $I_f \le$ 6 In ± 10%, $I_f >$ 6 In	The best of the two data ± 10% or 40 ms
S ($t=k/i^2$)	☒	☐	☐	☐	☒	0.6xIn $\le I_2 \le$10xIn step 0.1xIn	0.05s $\le t_2 \le$ 0.4s, step 0.01s at 10xIn	± 7%, $I_f \le$ 6 In ± 10%, $I_f >$ 6 In	± 15%, $I_f \le$ 6In ± 20%, $I_f >$ 6In
I ($t=k$)	☒	☐	☐	☒	☐	1.5xIn $\le I_3 \le$ 15xIn step 0.1xIn	≤ 30 ms	± 10%	
G(4) ($t=k$)	☒	☒	☒	☒	☐	0.20xIn $\le I_4 \le$1xIn (5) step 0.02xIn	For I>I4 0.1s $\le t_4 \le$ 0.4s, step 0.05s 0.1s $\le t_{4\ start\text{-}up} \le$ 1.5s, step 0.01s 0.04s $\le t_{4\ sel} \le$ 0.2s, step 0.01s	± 7%	The best of the two data ± 10% or 40 ms
G(4) ($t=k/i^2$)	☒	☒	☐	☐	☐	0.20xIn $\le I_4 \le$1xIn (5) step 0.02xIn	0.1s $\le t_4 \le$ 0.4s, step 0.05s @I=4xI_4	± 7%	± 15%
Gext ($t=k$)	☒	☒	☒	☒	☐	0.20xIn $\le I_4 \le$1xIn (5) step 0.02xIn 0.20xIn $\le I_4 \le$1xIn step 0.02xIn	0.1s $\le t_4 \le$ 0.4s, step 0.05s 0.1s $\le t_{4\ start\text{-}up} \le$ 1.5s, step 0.01s 0.04s $\le t_{4\ sel} \le$ 0.2s, step 0.01s	± 7%	The best of the two data ± 10% or 40 ms
Gext ($t=k/i^2$)	☒	☒	☐	☐	☐	0.20xIn $\le I_4 \le$1xIn (5) step 0.02xIn	0.1s $\le t_4 \le$ 0.4s, step 0.05s @I=4xI_4	± 7%	± 15%
U ($t=k$)	☒	☒	☐	☐	☐	5% $\le I_6 \le$ 90% %Unb. step 5%	0.5s $\le t_6 \le$ 60s, step 0.5s	± 10%	The best of the two data ± 10% or 40 ms
OT (temp=k)	☐	☒	☐	☐	☐	fixed, defined by SACE	Instantaneous	± 1°C	- - -
Iinst	☐	☐	☐	☐	☐	Automatic, defined by SACE	Instantaneous	± 5%	+1mS
Load control LC1/LC2	☒	☐	☐	☐	☐	50%÷100% step 0.05xI_1			
Warning Iw	☒	☐	☐	☐	☐	0.30÷3.00% step 0.05xI_n			

(1) The minimum value of this trip is 1s regardless of the type of curve set (self-protection).

(2) These tolerances are based on the following assumptions:
- self-powered relay at full power (without start-up)
- presence of auxiliary power supply
- two-phase or three-phase power supply
- preset trip time ≥ 100ms

(3) no-trip time

(4) the protection G is disabled for current values greater than 4In, where I4 < 0.5 In, greater than 6 In, where 0.5 In ≤ I4 < 0,8 In and greater than 8 In where I4≥ 0.8 In.

(5) ABB meets all the NEC standards, guaranteeing that the maximum earth fault current (I4) selectable does not exceed 1200A. The allowable adjustment range for the threshold I4 is reduced automatically, depending on the type of circuit breaker selected, so as to fulfil the following condition: I4xIn=1200A.

For all cases not covered by the above hypotheses, the following tolerance values apply:

Protections	Trip threshold	Trip time
L	Release between 1.05 and 1.25 x I1	± 20%
S	± 10%	± 20%
I	± 15%	≤60ms
G	± 10%	± 20%
Others		± 20%

13.2.9.11.1 Summary of the additional protection functions for the PR122/P with the optional PR120/V module

Protection	Disabling	Disabling of TRIP only	Zone selectivity	Start-up threshold	Thermal memory	Threshold Range	Time Range	Threshold tolerance (2)	Time tolerance (2)
UV (t=k)	☒	☒	☐	☐	☐	0.5xUn ≤ U ≤ 0.95xUn step 0.01xUn	0.1s ≤ t_8 ≤ 5s, step 0.1s	± 5%	± 20%
OV (t=k)	☒	☒	☐	☐	☐	1.05xUn ≤ I_9 ≤ 1.2xUn step 0.01xUn	0.1s ≤ t_9 ≤ 5s, step 0.1s	± 5%	The best of the two data ± 10% or 40 ms
RV (t=k)	☒	☒	☐	☐	☐	0.1xUn ≤ I_{10} ≤ 0.4xUn step 0.05 Un	0.5s ≤ t_{10} ≤ 30s, step 0.5s	± 5%	The best of the two data ± 10% or 40 ms
RP (t=k)	☒	☒	☐	☐	☐	- 0.3xPn≤ P_{11} ≤-0.1xPn step 0.02 Pn	0.5s ≤ t_{11} ≤ 25s, step 0.1s	± 10%	The best of the two data ± 10% or 40 ms
UF	☒	☒	☐	☐	☐	0.9fn ≤ f ≤ 0.99fn step 0.01 fn	0.5s ≤ t_{12} ≤ 3s, step 0.1s	± 5%	The best of the two data ± 10% or 40 ms
OF	☒	☒	☐	☐	☐	1.01fn ≤ f ≤ 1.1fn step 0.01 fn	0.5s ≤ t_{13} ≤ 3s, step 0.1s	± 5%	The best of the two data ± 10% or 40 ms

13.2.9.11.2 Table of measurements

Type of measurement	Tolerance	
	Range	%
Phase and neutral currents	0.3 ... 6 In	1.5
Internal ground fault current (internal source ground return)	0.3 ... 4 In	1.5
External ground fault current (external source ground return)	0.3 ... 4 In	1.5
Phase-to-phase and phase voltages (measured at the module's input and thus independent of the precision relating to the use of any VT)	50 $V_{phase\text{-}to\text{-}phase}$ ... 1.1x690 $V_{phase\text{-}to\text{-}phase}$	1
Residual voltage (for systems with neutral only)	50 $V_{phase\text{-}to\text{-}phase}$ ... 1.1x690 $V_{phase\text{-}to\text{-}phase}$	1
Peak factor	0.3 ... 6 In	1.5
Total power factor	0.5 ... 1	2.5
Mains frequency	35 ... 80 Hz	± 0.2
Instantaneous active power on the single phase and total system	0.3 ... 6 Pn	2.5
Instantaneous reactive power on the single phase and total system	0.3 ... 6 Pn	2.5
Instantaneous apparent power on the single phase and total system	0.3 ... 6 Pn	2.5
Active energy	0.3 ... 6 Pn	2.5
Reactive energy	0.3 ... 6 Pn	2.5
Apparent energy	0.3 ... 6 Pn	2.5

13.2.10 Trip curves

The trip curves given are for guidance and only show a sub-group of the possible selections (see par.13.2.9.11).

13.2.10.1 Trip curves for functions L-I

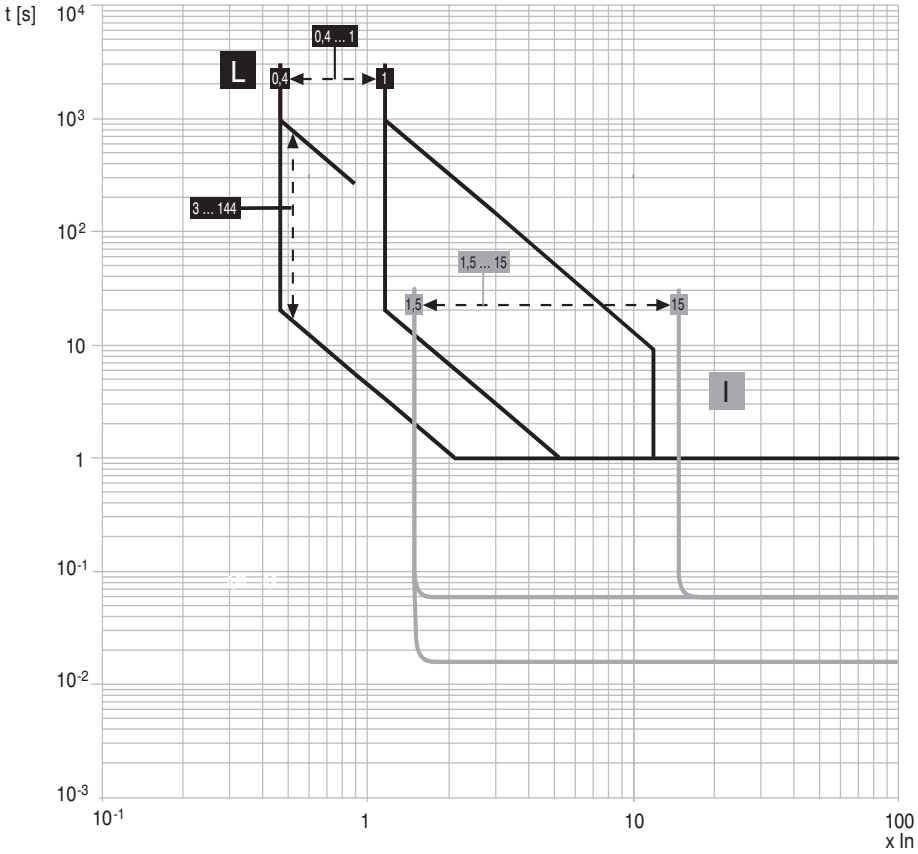

13.2.10.2 Trip curves for functions L-S(t=k/i²)-I

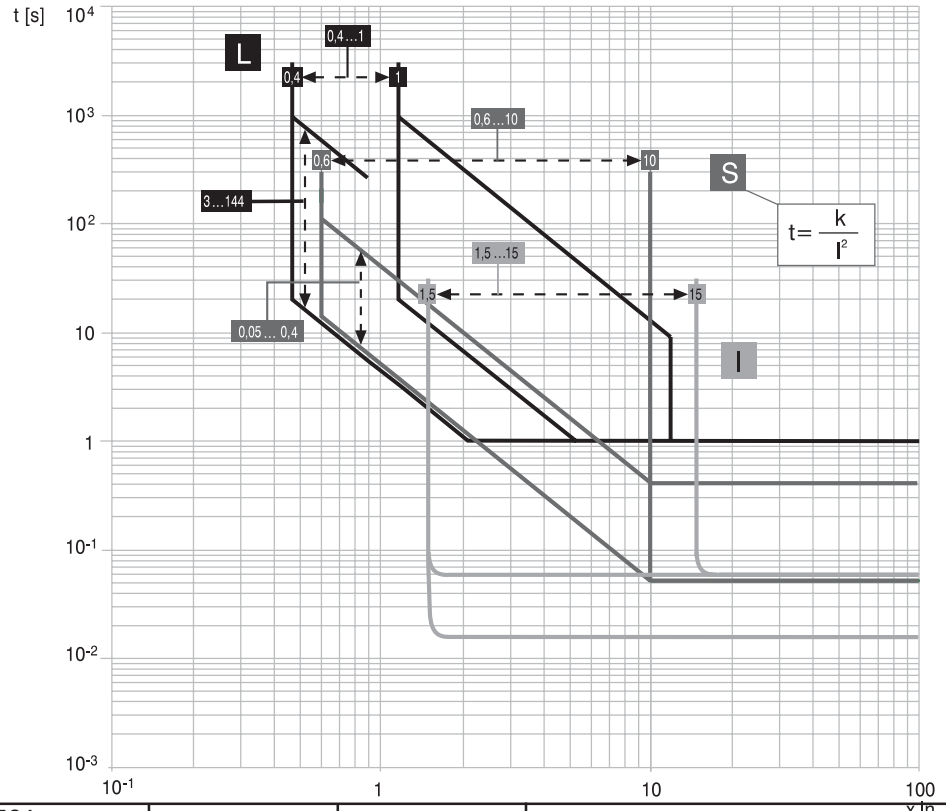

13.2.10.3 Trip curves for functions L-S(t=k)-I

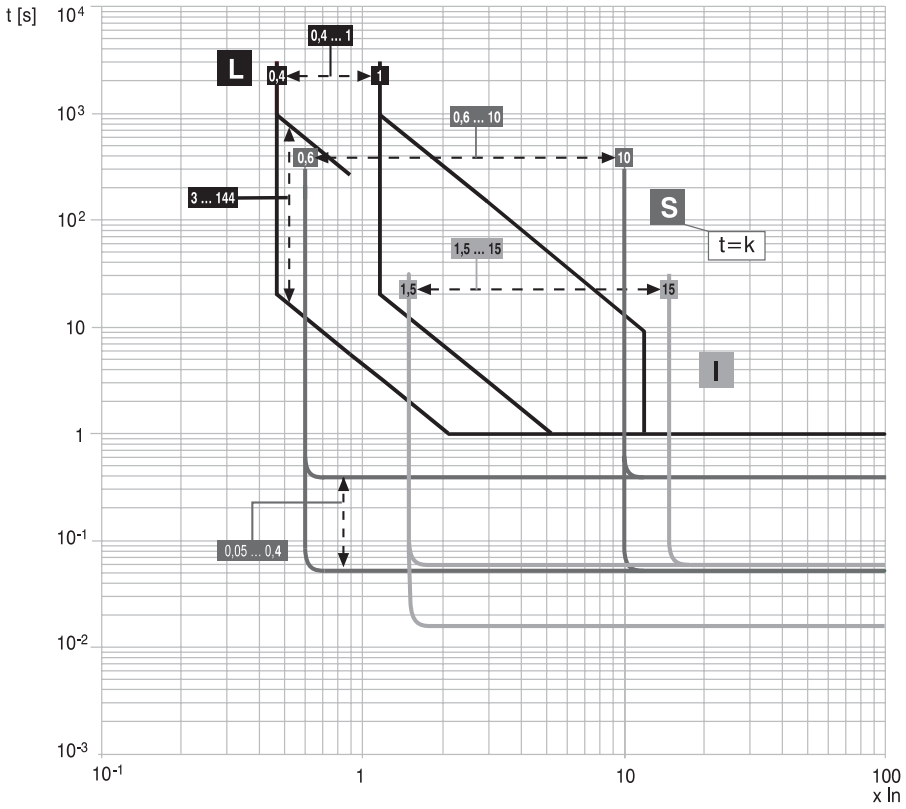

13.2.10.4 Trip curves for function G

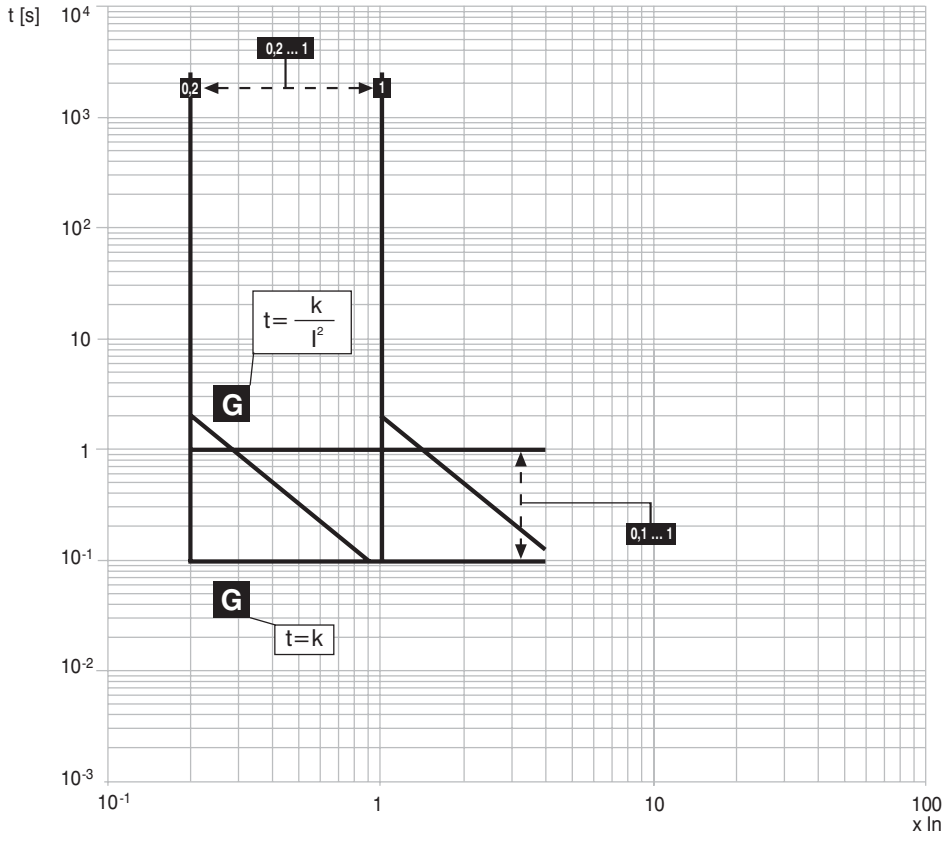

13.2.10.5 Trip curves for function U

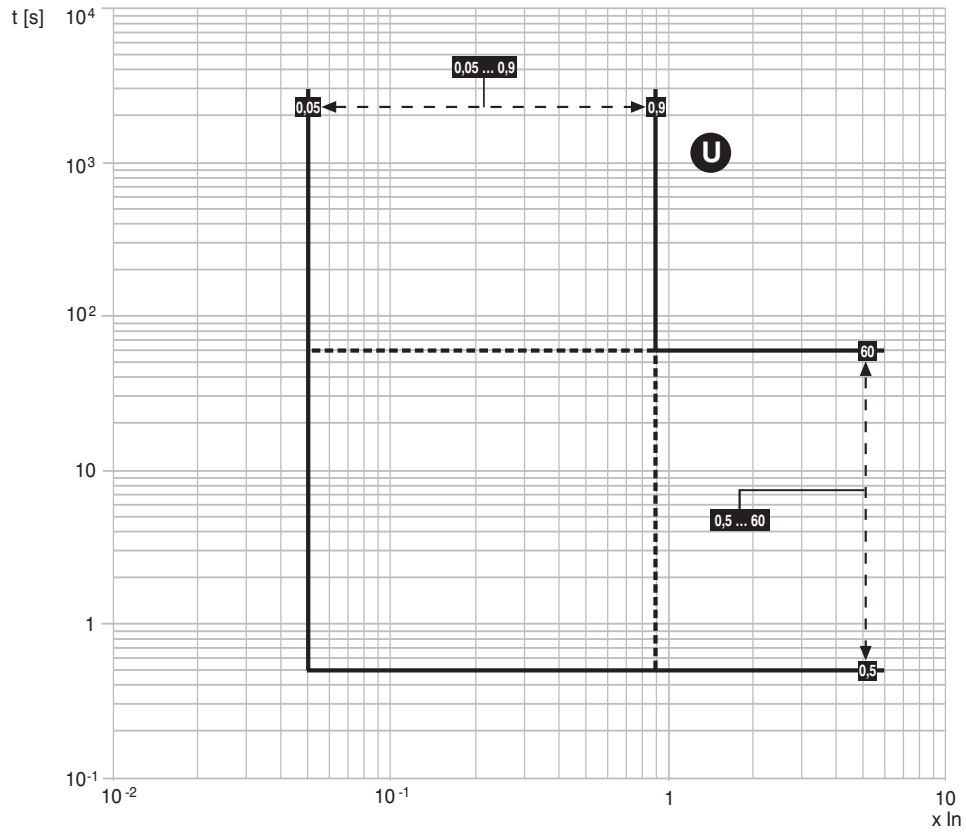

13.2.10.6 Trip curves for function UV

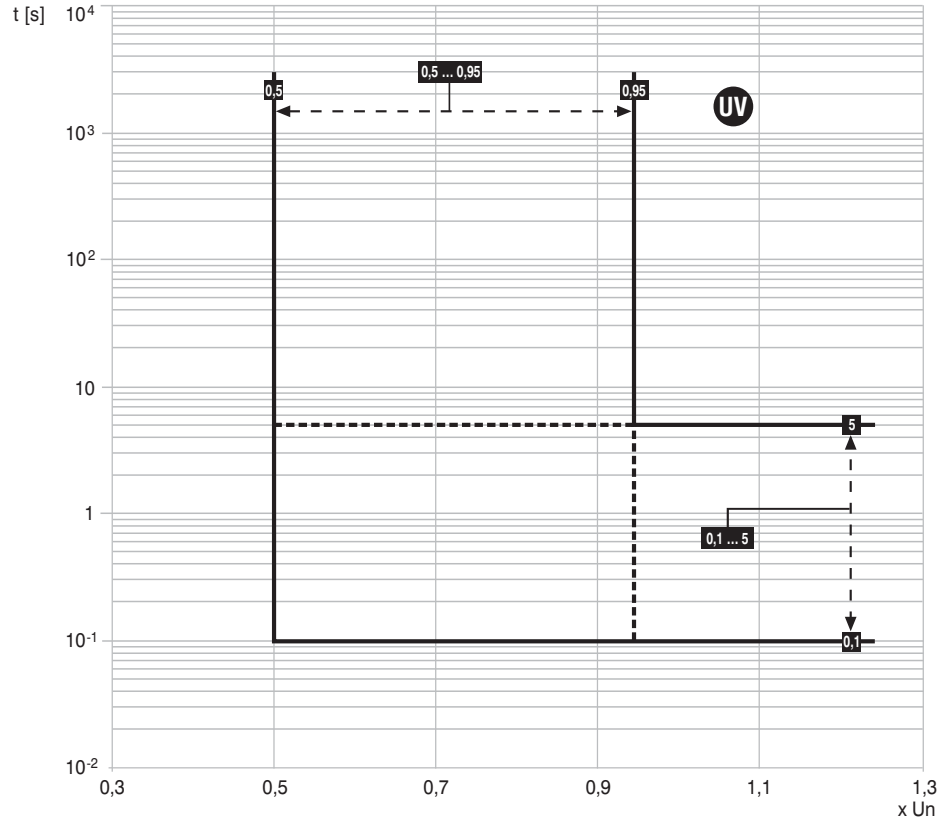

13.2.10.7 Trip curves for function OV

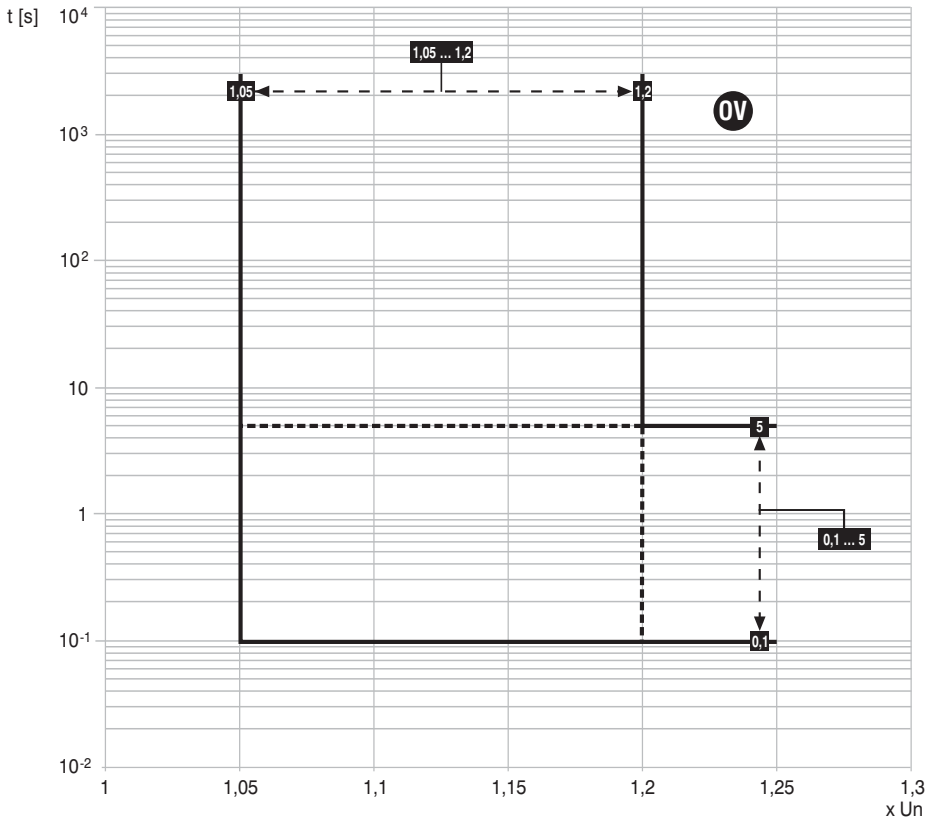

13.2.10.8 Trip curves for function RV

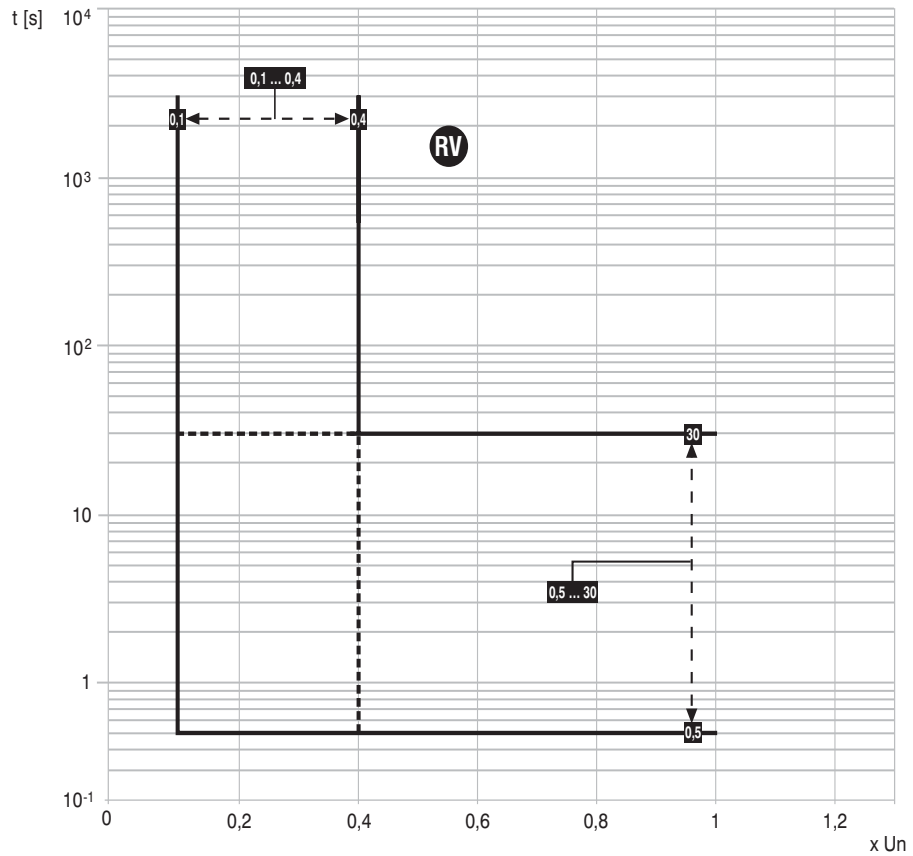

13.2.10.9 Trip curves for function RP

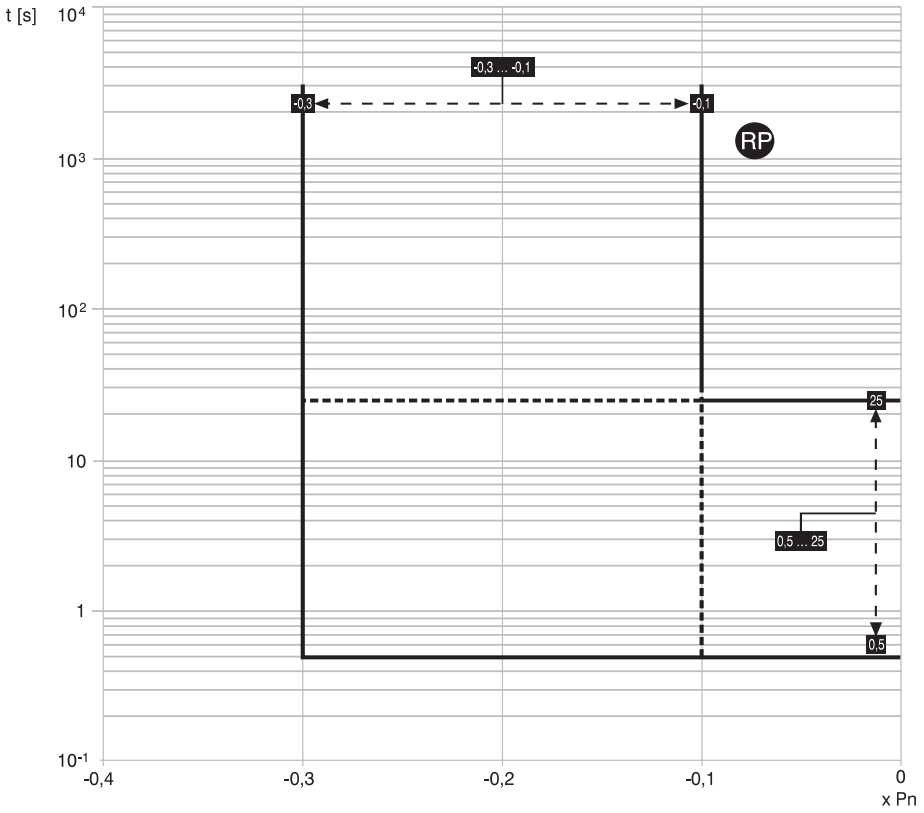

13.3 Putting into service

13.3.1 Connections

For the connections provided by the user, it is recommended that you comply strictly with the recommendations contained in this document.
This will enable us to satisfy all the international reference standards and guarantee perfect operation of the relay even under severe environmental and electromagnetic conditions.
Pay particular attention to the types of cable, the connections to earth and the recommended maximum distances.

The maximum length of the VT - PR120/V wiring must not exceed 15 meters.
Use corded shielded two-wire cable (see note A to par. 11.2.2).
The shield must be connected to earth on both sides.

Use VTs with a shield, connected to earth (see standard VT par.13.3.2).
The VTs should only be used for voltages > 690V; for lower voltages the presence of the PR120/V module connected to the lower or higher busbars will be sufficient.

13.3.1.1 Current sensor connection for external neutral

If you want to connect the current sensor for the external neutral conductor to a three-pole circuit breaker, remember to set I_nN accordingly. During this procedure, the circuit breaker must be open and preferably isolated.

13.3.2 VT connections

Dielectric strength tests are not allowed on the inputs and outputs of the releases or on the secondary lines of any connected VTs.

The following is a summary table of standard VT connections according to the type of plant.

VT Standard (A): Single standard transformers, see par. 15.1.7.
The VTs must have a performance coming between the values of 10 and 20 VA inclusive, 4 kV insulation between the primary and secondary.

Installation system	"VT Standard" type transformer (Star/Star)	"VT Standard" type transformer (Delta/Delta)
	Application diagram	Application diagram
TN-C	**B**	**A**
TN-S	**B**	**A**
IT with neutral	**B**	**A**
IT	**n.c**	**A**
TT with neutral	**B**	**A**
TT without neutral	**n.c**	**A**

Note:
- for TN-C systems the connection must be made to PEN
- for TN-S systems the connection must be made to N for configurations with neutral or PE for configurations without neutral; if the PE is used, the current thereon could be around a dozen mA. If a customer considers this value too high or has a residual current protection which risks being tripped, then application diagram A must be used
- for IT and TT systems with neutral, the connection must be made to N

Application diagram A

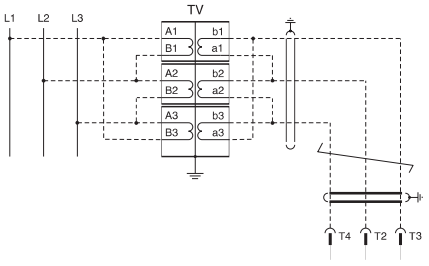

Application diagram B

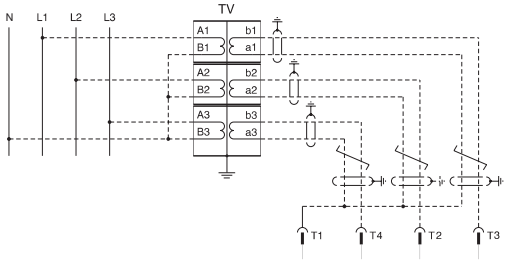

13.3.3 CS and TC connection check

If the PR122/P was installed by the user, it is important, before closing the CB, to check the last line on the display when the relay is turned on for the first time via a PR030/B battery unit. No CS and/or TC disconnected messages must appear; if they do, do not close the circuit-breaker immediately and make the correct connections.

13.3.4 Test

Before putting into service, a test can be conducted by means of the specific "Auto test" function which can be activated on the PR122/P. A positive result is shown on the display.
Then a test can be conducted on the whole TC chain, again using the specific function (Trip test). A positive outcome is shown by the circuit-breaker opening.
Check the open or closed state of the circuit-breaker on the same "PR122/P Test" screen, by checking "CB Status".

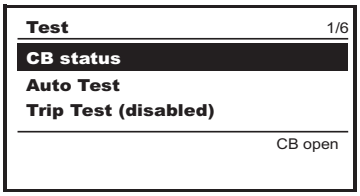

13.3.5 Initial settings

If the PR122/P is supplied ready installed in the circuit-breaker, it is up to ABB SACE to set all the variables referring to the circuit-breaker or the specific application correctly (e.g. type of circuit breaker, Rating Plug size, mains frequency ...).
Vice versa, if the PR122/P is supplied separately, it will be up to the user to set all the necessary parameters correctly.
Note that ABB SACE defines each possible setting according the content of the paragraph on the default parameters (see par. 13.4.4).

Apart from this, it is absolutely indispensable for the user to modify the password and carefully define each modifiable parameter, before putting the PR122/P into service.

13.3.6 Password management

Specify a password? [0*]**

To enter "EDIT" mode it is necessary to enter a four-figure numerical password. The values attributable to the password go from 0000 to 9999. For the default password see par.13.4.4.
Select the value of the first figure (between '0' and '9') by means of the ↑ and ↓ keys and press ↵ to confirm the figure and then move on to enter the next one.
After entering the fourth figure, check the password you have entered. If the password is correct, you go from the "READ" state to the "EDIT" state.

If the password is wrong, the message

Wrong password

appears and remains until the **ESC** key is pressed (or until an interval of 5 seconds has elapsed).

It is also possible to interrupt the password entry procedure by pressing the **ESC** key.

The password is valid for a maximum of two minutes from the last time a key was pressed. It is immediately reset in the case of a high priority alarm or when the unit is reset.

On entering a page with no modifiable parameters, the state of the protection is put on "READ". If the password is still valid, to enter "EDIT" mode (on a page with modifiable parameters) simply press the ↵ key.

Disabling the Password.
By setting the value of the password to [0000] (on the "Unit configuration" menu) the password prompt is disabled. It is therefore always possible to switch from "READ" to "EDIT".

To enter a new password, select the "New Password" item on the "Settings/System" menu.

13.3.7 Replacing an electronic release

13.3.7.1 Installation

To complete the procedure for installing a PR122/P unit, follow the steps below:

1. With the circuit breaker open and preferably isolated, install the protection unit on the circuit breaker
2. Power the unit ONLY from the PR030/B
3. If there are no other errors, the display will show the message Configuration (configuration error) accompanied by the yellow led coming on permanently (warning)
4. Enter the unit's "*Settings*" menu
5. Select "*Circuit breaker*"
6. Select "*Unit installation*"
7. Input the password
8. Select "*Install*" and press "*ENTER*"
9. When the red led flashes on and off and the message Installation (installation error) is displayed, remove the PR030/B
10. Power the relay from any other source

Check for the absence of configuration errors.

13.3.7.2 Uninstalling

To complete the procedure for uninstalling a PR122/P unit, follow the steps below:

1. With the circuit breaker open and/or isolated power the unit from the PR030/B
2. Enter the unit's "*Settings*" menu
3. Select "*Circuit breaker*"
4. Select "*Unit installation*"
5. Input the password
6. Select "*Uninstall*" and press "*ENTER*"
7. If there are no error messages, remove the PR030/B
8. Remove the PR122/P unit from the circuit breaker
9. To remove the TC connector, proceed as indicated in the figure alongside.

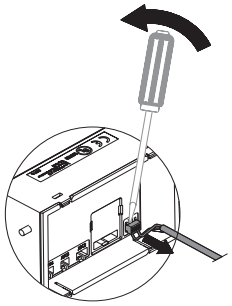

It is strongly advised to complete the uninstalling procedure, because this enables the parameters relating to the circuit breaker, such as contact wear and others, to be saved in the "*KEY PLUG*", otherwise these data would be lost. The data in question are then transmitted to the new PR122/P unit installed on the same circuit breaker.

13.4 User interface

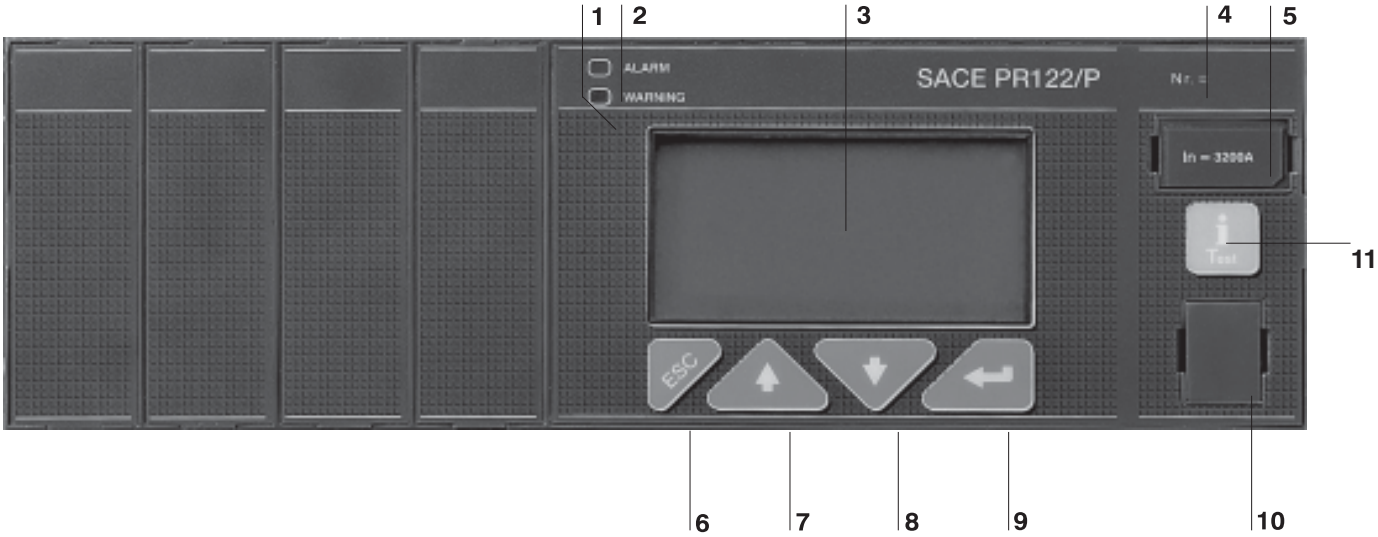

Ref.	Description
1	Pre-alarm indicator LED
2	Alarm indicator LED
3	Graphic display (the word ABB in the bottom left-hand corner indicates normal operation)
4	Serial number of the PR122/P
5	Rating plug
6	Pushbutton for exiting the sub-menus or for canceling (ESC)
7	Button for the cursor (UP)
8	Button for the cursor (DOWN)
9	ENTER key for confirming the data or changing the page
10	TEST connector for connecting or testing the release by means of an external device (PR030/B battery unit, BT030 wireless communication unit and PR010/T test unit)
11	"i Test" test and info button

Description of icons that appear on the display

Icon	Description
	Remote control
A	Dual setting of protection activated and indication of the active set
D	fix icon shows Datalogger activated blink icon shows trigger verified
	Vaux is present
	change settings

The Graphic Display is of the LCD type with 128x64 pixels and it is backlit when there is an auxiliary voltage or a self-supply from a PR120/V module. The display is always lit when there is a Vaux or, in self-supply mode with a minimum busbar current or powered from the PR120/V module as defined in par. 13.2.2.1.
You can adjust the contrast on the display by means of the specific function available on the user interface settings menu (par. 13.5.4.1).

13.4.1 Use of pushbuttons

The modifiable fields can be filled in using the ↑ or ↓ keys and confirming with the ↵ key. Once you have entered the page you need, you can move from one value to another by using the ↑ or ↓ keys. To change a value, position the cursor over the value (the modifiable field will appear in reverse, i.e. white on a black background), and use the ↵ key.

To confirm the programming of the previously configured parameters, press the **ESC** key once only. A check will be carried out on the parameters entered and then the programming confirmation page will be displayed. To return to the main menu, press the ESC key twice.

The "**i Test**" key must be used to perform the Trip test to view the information page and to see the last trip within 48 hours of the CB opening in self-supply mode.

13.4.2 Read and Edit modes

The menus map (see par. 13.5.1) shows all the pages which can be obtained and how to move between them from the keyboard, in the "READ" mode (just to read the data) or in the "EDIT" mode (to set the parameters).

Starting from any page displayed, two different functions can be obtained according to the state of the unit:
1. "READ": the default page will be displayed automatically after about 120 seconds (see par. 13.5.1).

2. "EDIT": the default page will be displayed automatically after about 120 seconds.

The allowable functions depending on the state are:
"READ":
- ✓ Consultation of the measurements and of the historical data
- ✓ Consultation of the unit configuration parameters
- ✓ Consultation of the protection parameter

"EDIT":
- ✓ Everything allowed in READ mode
- ✓ Configuration of the unit
- ✓ Programming of the parameters relative to the protections
- ✓ TEST Functions of the unit

To access the "EDIT" mode, it is necessary to press the? key on a page with fields which can be edited. A password will then be required to enable you to switch to the editing mode.

The use of the keys is summarized in the following table:

Key	Function
	Move between pages Move within menu Change parameter values
	End setting phase and confirm result Choose menu item
	Access to surfing menus from the default pages Return to previous level when surfing within the menus, until you return to the default pages Exit the parameter changing phase, aborting the change
	This key is used to re-enable the display after it has gone off within 48 hours of the opening of the circuit breaker in self-supply mode. Can be used jointly with the other keys for special combinations that enable access to reserved pages.

13.4.3 Changing parameters

Moving within the Main Menu you can reach al the pages relating to the configurations and parameter settings with the opportunity to change the values specified for the parameters.
After any programming, you need to Confirm/Cancel/Change any changes you have made. This procedure is not applicable to all the programming activities.
Two examples are provided below: one concerns the case in which no confirmation is needed for the changes you have made, while in the other a confirmation window appears.

Procedure not requiring the confirmation of any programming
For instance, to set the System Date, the correct sequence is as follows:

From the default page press ESC
to access the Main Menu

From the Main Menu, select SETTINGS

press the ↵ key (enter)

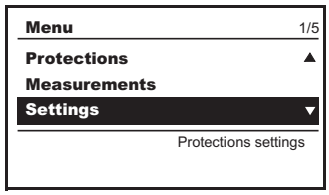

Select SYSTEM

press the ↵ key (enter)

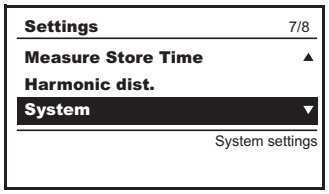

Select the menu item DATE to change

press the ↵ key (enter)

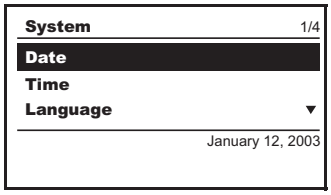

You will be prompted to input a Password
complete the password entry procedure (par.13.3.6)

press the ↵ key (enter)

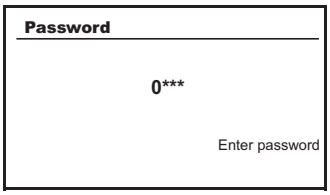

Change the date using the ↓ keys (arrow down)

↑ (arrow up) and confirm by pressing the ↵ key (enter).

Press ESC twice to return to the Main Menu

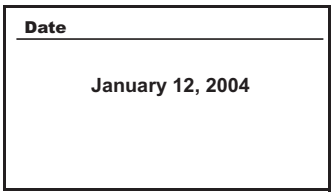

Procedure requiring the confirmation of any programming

For instance, to change the Curve of the Protection L, the correct sequence is as follows:

From the default page press ESC
to access the Main Menu

From the Main Menu select the item PROTECTIONS

press the ↵ key (enter)

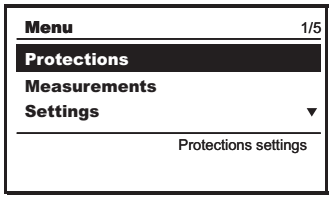

From the Protections Menu select the item PROTECTION L

press the ↵ key (enter)

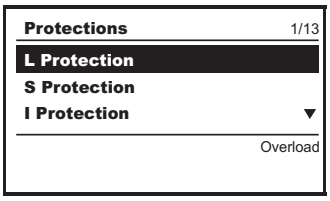

From the Protection L Menu select the item CURVE

press the ↵ key (enter)

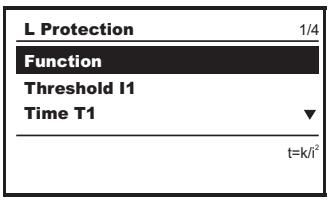

You will be prompted to input a Password (par.13.3.6)

complete the password entry procedure

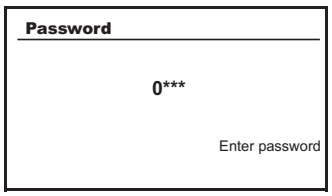

Select the value you want from the list
and confirm pressing the ↵ key (enter).

Press ESC twice

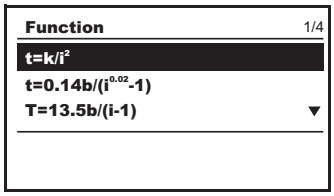

Before accessing the Main Menu, the following box will appear:

Accept the new configuration
Reject the new configuration (the previous configuration is retained)
Change the previously input values.

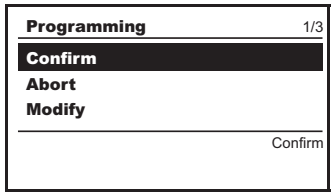

To select the required option use the ↓ (arrow down), ↑ (arrow up) keys, and press ↵ (enter) to confirm.

13.4.3.1 Modification of basic configuration

No parameter settings can be made if the PR122/P unit is in alarm conditions.

The configuration of the unit must be done in EDIT mode.

Following the instructions given in par. 13.4.3, view the following on the display:

Change system date
Change system time
Select system language

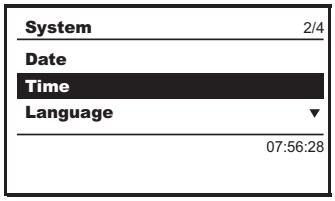

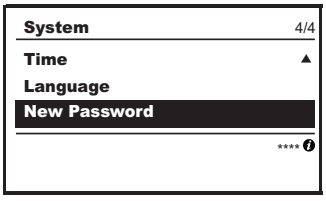

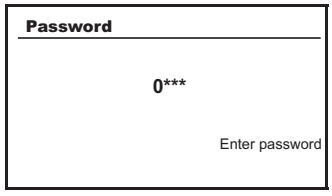

To change the system password, select the relevant menu item and press ↵ (enter); then you will be prompted to enter the OLD password, and afterwards you can input the new one twice.
Press ESC twice to return to the Main Menu

Before accessing the Main Menu, the following box will appear:

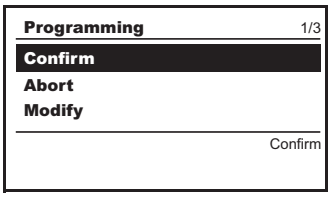

Accept the new configuration
Reject the new configuration (the previous configuration is retained)
Change the previously input values.

To select the required option use the ↓ (arrow down), ↑ (arrow up) keys, and press ↵ (enter) to confirm.

Note: for setting system language you must check:
- the relay is set in locally control
- the circuit breaker is open
- Vaux or PR120/V supplied or PR030/B is present

If one of the conditions above is not respected, it's not possible to change the language.

13.4.4 Default settings

The PR122/P is supplied by ABB SACE with the following predefined parameters:

#	Protection	On/Off	Thresholds	Time	Curve	T.M.	ZS	Trip
1	**L**	–	1 In	144 s	I^2t	Off	–	–
2	**S**	Off	6 In	50 ms	K	–	Off: 0.04s	–
3	**I**	On	4 In	–	–	–	–	–
4	**G**	Off	0.2 In	0.4 s	K	–	Off: 0.04s	On
5	**U**	Off	50 %	5 s				Off
6	**OT**	–						Off
7	**K LC1**	Off	50 % I_1					
8	**K LC2**	Off	75 % I_1					
9	**UV**	Off	0.9 Un	5 s				Off
10	**OV**	Off	1.05 Un	5 s				Off
11	**RV**	Off	0.15 Un	15 s				Off
12	**RP**	Off	- 0.1 Pn	10 s				Off
13	**UF**	Off	0.9 Fn	3 s				Off
14	**OF**	Off	1.1 Fn	3 s				Off
15	**Language**	–	Engl					
16	**Net Frequency**	–	50 Hz					
17	**PR021/K**	Off						
18	**Neutral sel.**	–	*					
19	**Toroid Selec.**	–	None					
20	**Ext. ground tor.**	Off	100 A					
21	**Rated Voltage**	–	380 V					
22	**S startup**	Off	6 In	100 ms				
23	**I startup**	Off	4 In	100 ms				
24	**G startup**	Off	1 In	100 ms				
25	**Password**	–	0001					
26	**Measuring inteval**	–	60 min					
27	**Iw**	Off	3 In					
28	**Power direction**	–	top → bottom					
29	**Harmonic distortion warning**	Off						

*= OFF for three-pole versions *= 50% for four-pole versions *= 100% for full-size versions

13.5.1 Menu

As seen previously, the PR122/P uses the display to show messages, diagrams and menus. These are organized in a logical and intuitive way. The following is a general layout showing how to access the main menu pages.

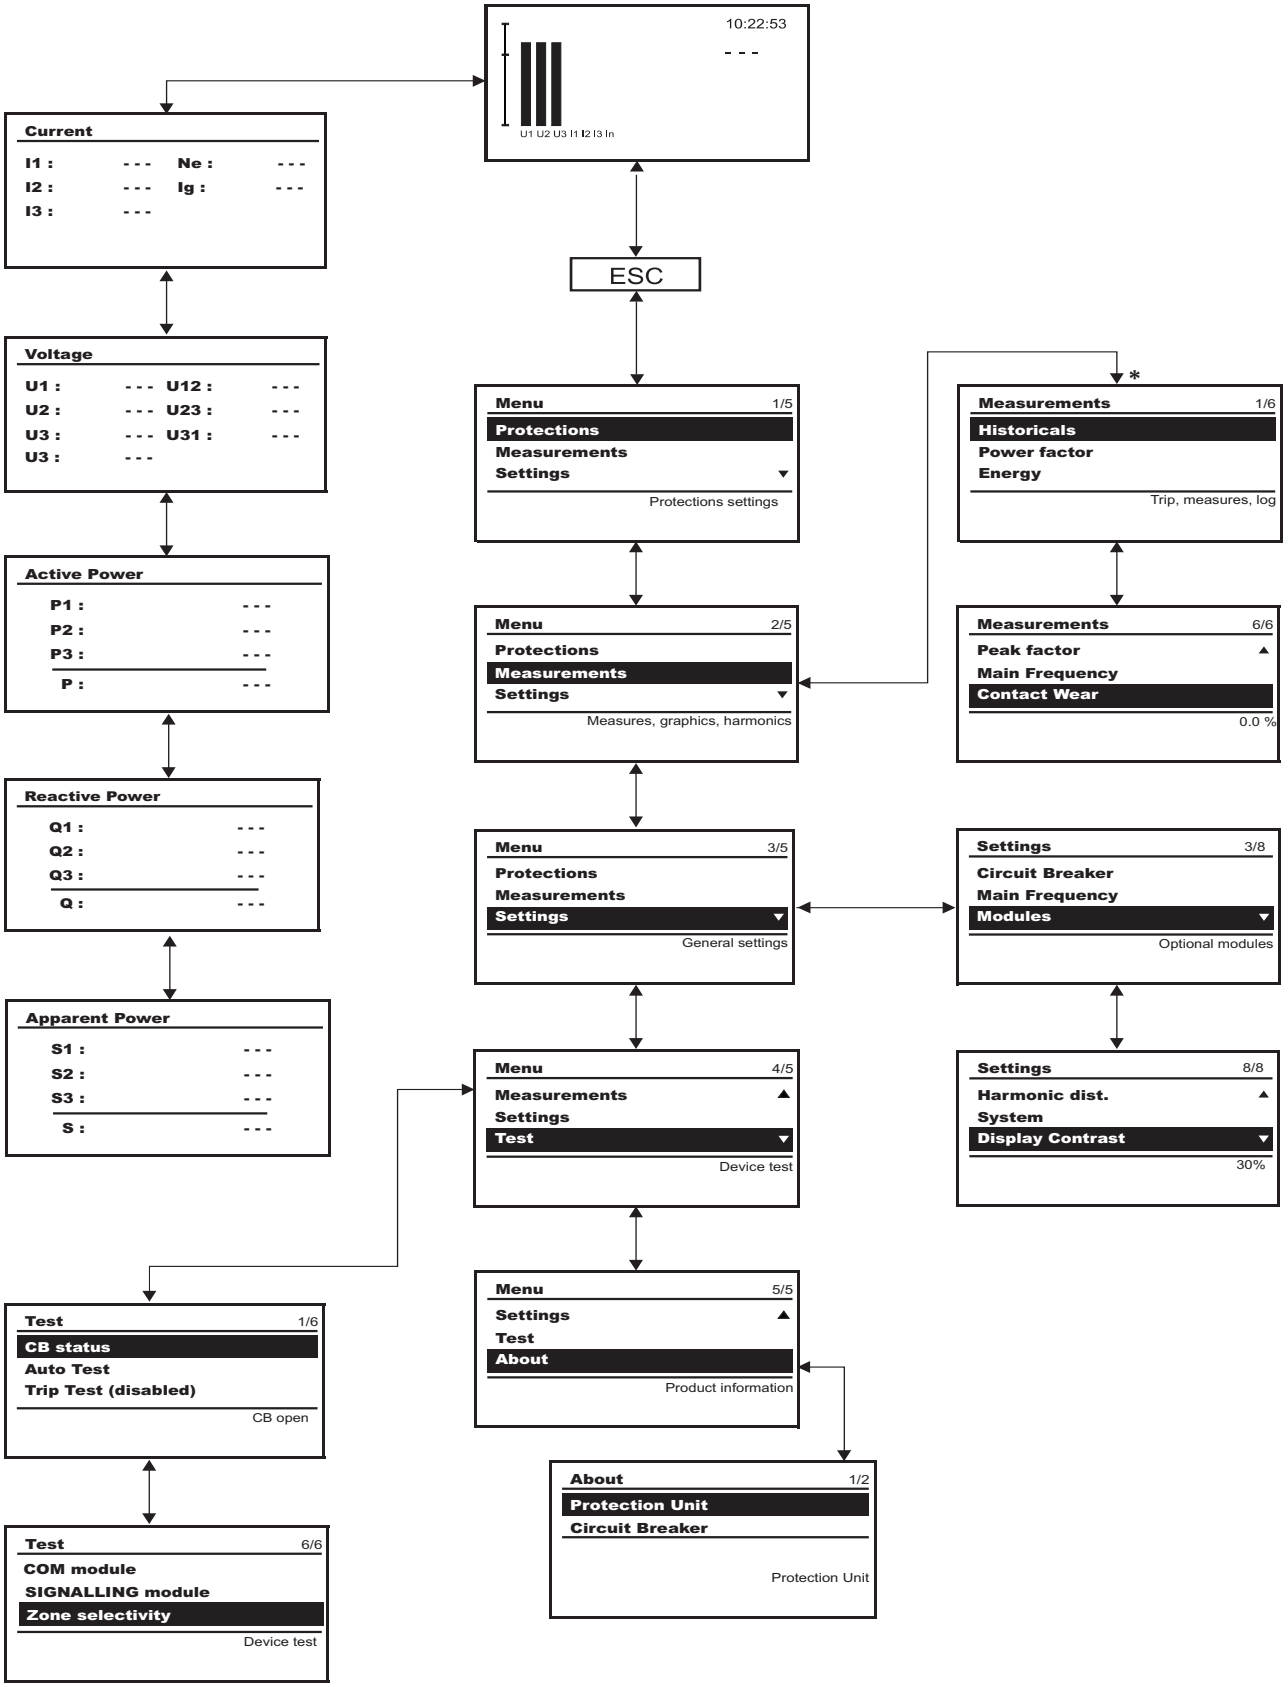

* Menu displayed with the optional PR120/V module installed in the relay.

Each time the unit is turned on, or after more than 2 minutes of inactivity on the keyboard, the display indicates the following page (default):

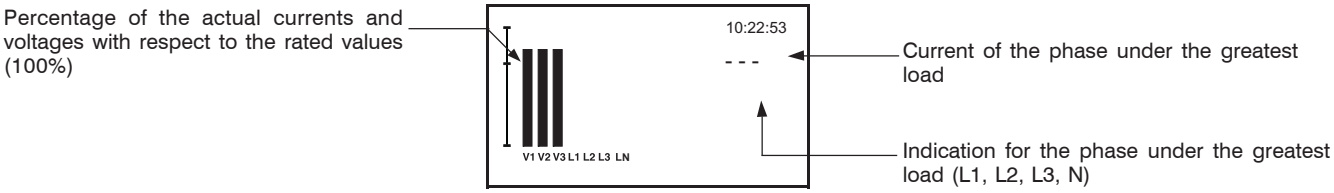
Percentage of the actual currents and voltages with respect to the rated values (100%)
10:22:53
- - -
V1 V2 V3 L1 L2 L3 LN
Current of the phase under the greatest load
Indication for the phase under the greatest load (L1, L2, L3, N)

13.5.2 Protections menu

From the interface you can press ENTER to access the menu of the various protections available on the display.

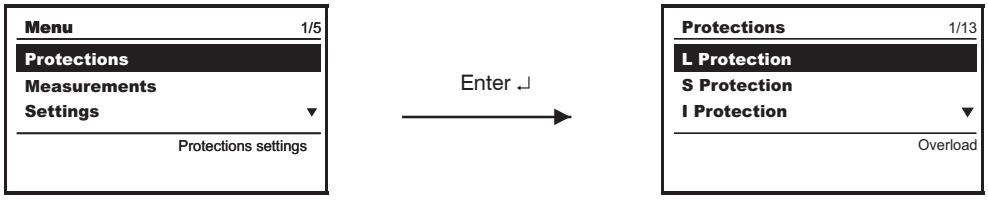

Using the "arrow UP" and "arrow DOWN" you can view the various protections.
On the whole, the data that you can display when the optional additional PR120/V module is installed concern the protections: L, S, I, G, U, UV, OV, RV, RP, UF, OF, OT, LOAD PROTECTION.

Example of surfing the Protections menu

From the Protection main page you can press ENTER to go to the Protection L Menu.
You can use "arrow UP" and "arrow DOWN" to select the items on the menu and confirm by pressing ENTER. Pressing this key triggers a Password prompt, then you can select the functions associated with the protection L (as in the example).

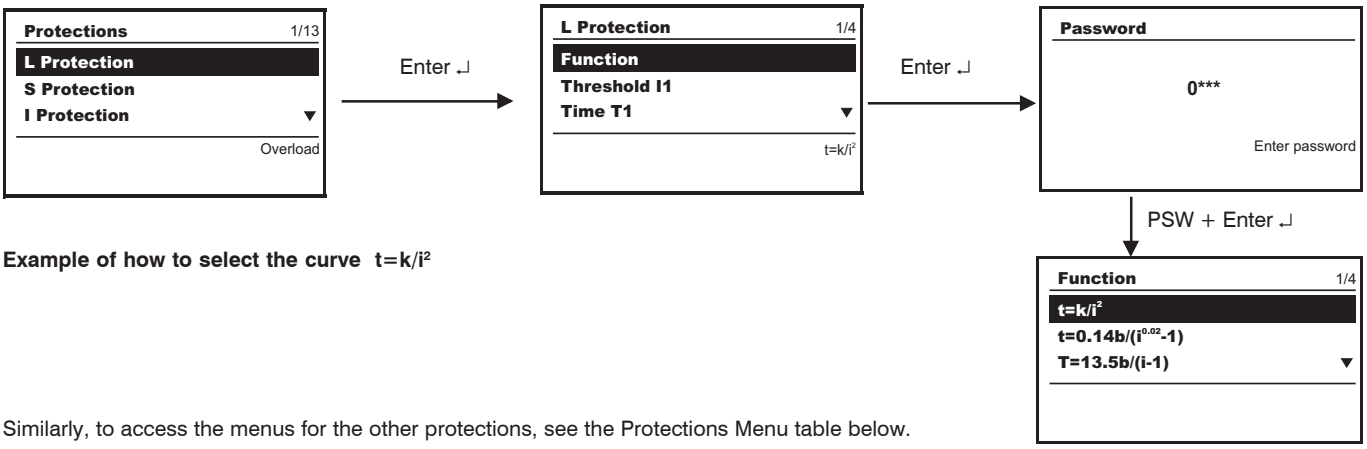

Example of how to select the curve t=k/i²

Similarly, to access the menus for the other protections, see the Protections Menu table below.

13.5.2.1 Protections menu table

Protection	Parameter / Function	
L	Curve	
	Threshold I1	
	Time t1	
	Thermal memory	ON / OFF
S	Enable	ON / OFF
	Curve	
	Threshold I2	
	Time t2	
	Zone selectivity	ON / OFF
	Selectivity time	

Protection	Parameter / Function	
	Enable StartUp	ON / OFF
	StartUp threshold	
	StartUp time	
I	Enable	ON / OFF
	Threshold I3	
	Enable StartUp	ON / OFF
	StartUp threshold	
	StartUp time	
Gext	Enable	ON / OFF
	Curve	
	Threshold I4	
	Time t4	
	Enable Trip	ON / OFF
	Zone selectivity	ON / OFF
	Selectivity time	
	Enable StartUp	ON / OFF
	StartUp threshold	
	StartUp time	
U	Enable	ON / OFF
	Threshold I6	
	Time t6	
	Enable Trip	ON / OFF
UV	Enable	ON / OFF
	Threshold U8	
	Time t8	
	Enable Trip	ON / OFF
OV	Enable	ON / OFF
	Threshold U9	
	Time t9	
	Enable Trip	ON / OFF
RV	Enable	ON / OFF
	Threshold U10	
	Time t10	
	Enable Trip	ON / OFF
RP	Enable	ON / OFF
	Threshold P11	
	Time t11	
	Enable Trip	ON / OFF

Protection	Parameter / Function	
UF	Enable	ON / OFF
	Threshold f12	
	Time t12	
	Enable Trip	ON / OFF
OF	Enable	ON / OFF
	Threshold f13	
	Time t13	
	Enable Trip	ON / OFF
OT	Enable Trip	ON / OFF
Load control		
	Threshold 1 Enable Threshold	ON / OFF
	Threshold 2 Enable Threshold	ON / OFF
	Threshold Iw Enable Threshold	ON / OFF

Note: for an explanation of the characteristics of the single protections and their settings and corresponding curves, see par. 13.2.9.

13.5.3 Measurements Menu

For a complete description of the functions of the PR120/V module, see par. 15.1.
The following is a summary of the parameters accessible from the menu in the PR122/P unit.

13.5.3.1 Measurements Menu table

Setting	Parameter / Function	Values	Notes
Historicals			
	Trips		Last trip
	Events		Events log
	Measurements		
	I Max		Current
	Reset measurements		
Peak factor			
Contact wear			Percentage of wear on CB contacts

13.5.4 Settings Menu

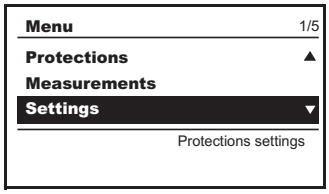

The configuration parameters in the Settings menu are password protected. Among the most significant values you can select, note the neutral threshold (values 50%, 100%, 150%, 200%), the external toroid size (values 100 A, 250 A, 400 A, 800 A), the mains frequency at the installation (values 50 Hz, 60 Hz). For a more detailed description of the settings for the modules, refer to the documentation on the modules (ch. 15).

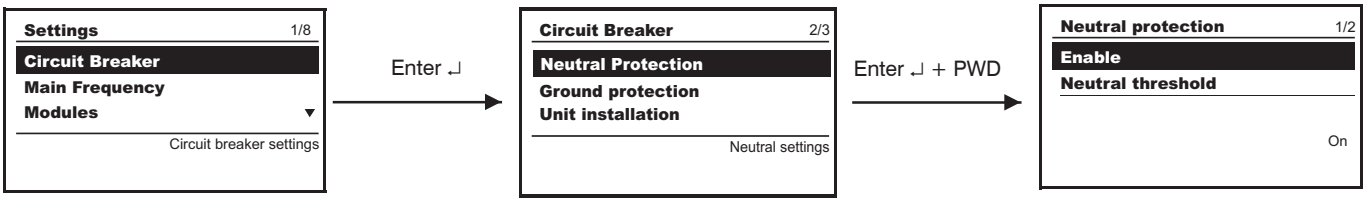

13.5.4.1 Settings Menu table

	Parameter / Function	Values	Notes
Circuit breaker	Neutral protection		
	Enable	ON/OFF	
	Neutral threshold	50%-100%-150%-200%	
	Ground protection		Said protection is provided only in the event of an external toroid being used
	External toroid	Absent,SGR,R	
	Toroid size SGR		
	Toroid size Rc	Idn = 1A, 10A	
Mains frequency		50 Hz - 60Hz	
Modules	Module		
	PR120/V - Measuring	if any	see par. 13.5.4.4.1
	PR120/D-M - COM	if any	see par. 13.5.4.4.2
	PR120/K - Signalling	if any	see par. 13.5.4.4.3
	Local Bus unit	Absent - Present	
Data logger	Enable	ON/OFF Sampling frequency Stop Event Stopping delay Restart Stop	
Measurement interval		from 5 to 120 min, step 5 min	
Harmonic distortion		ON/OFF	The warning indicates that the distortion exceeds factor 2.1

	Parameter / Function	Values
System	Date Time Language New password	English/Italiano/Francais/Deutsch/Español
Display	Contrast	

The summary table relates to the surfing of the pages dedicated to the PR120/K module (see par. 15.3) and to the PR021/K unit (see par. 16.1).

13.5.4.2 Neutral adjustment

The neutral protection is normally set to a current value 50% of the adjustment made on the phases.
In some installations, where particularly high harmonics occur, the current circulating on the neutral may be higher than that of the phases.
In the SACE PR122/P release, this protection can be set for the following values: I_nN= 50% - 100% - 150% - 200% * I_n.
The values that can be used to adjust the neutral are given in the table below for the various possible combinations between types of circuit-breaker and adjustment of the threshold I_n.

13.5.4.2.1 Neutral adjustments table

Adjustment for the threshold I_1 (L Protection)			
Circuit breaker size	**$I_1 \leq 0.5$**	**$0.5 < I_1 \leq 0.66$ (1)**	**$I_1 > 0.66$**
E1	50-100-150-200%	50-100-150%	50-100%
E2	50-100-150-200%	50-100-150%	50-100%
E3	50-100-150-200%	50-100-150%	50-100%
E4	50-100%	50%	50%
E4/f	50-100-150-200%	50-100-150%	50-100%
E6	50-100%	50%	50%
E6/f	50-100-150-200%	50-100-150%	50-100%

Note 1: The adjustment I_1=1 In is meant as the maximum adjustment of the overload protection. The actual maximum allowable adjustment must take into account any temperature derating, the terminals used and the altitude.
Note 2: With three-pole circuit breakers with no external neutral, the adjustment of the neutral must be set to OFF.

Failure to comply with the setting limits for "I_1" and "I_nN" can cause circuit breaker damage with consequent risks even for the operator.

In any case, the relay records any setting error between I_1 and the Neutral setting and it signals this by means of the warning (see par. 13.6.3).

13.5.4.3 Mains frequency settings

In the Mains frequency menu, you can choose between the frequency values: 50, 60 Hz.

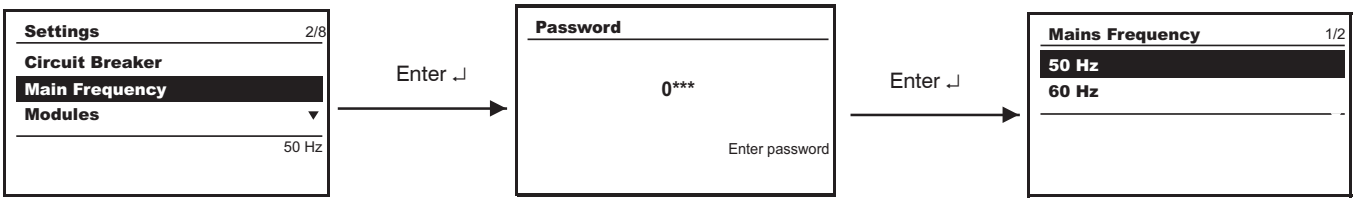

13.5.4.4 Modules

When you access the Settings menu, there is a set of menus available relating to the modules.

13.5.4.4.1 PR120/V - MEASURING module

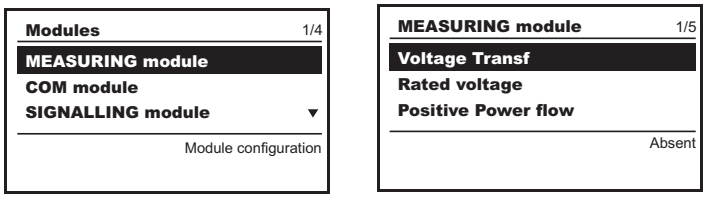

In the measuring module you must enter a password and can then opt for the absence or presence of the voltage transformer. Moreover, you can select the values of the primary voltage (100, 115, 120, ... 1000V) and secondary voltage (100, 110,..,230V). The power flow can be LOW -> HIGH or HIGH-> LOW. After entering a password you can choose whether the neutral connection is to be Absent or Present. The phase sequence and cosφ signal can be enabled and disabled (ON /OFF) and the corresponding threshold values can be selected (see par. 15.1).

13.5.4.4.2 PR120/D-M COM module

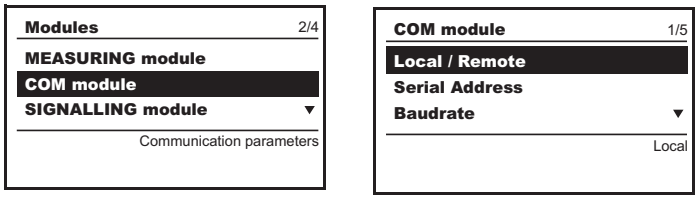

The local or remote modes can be selected after entering a password. The serial address can be displayed after entering a password. The Baud Rate can be set on the values 9600 and 19200 bit/s. The physical protocol provides for the options: (8,E,1), (8,0,1), (8,N,2), (8,N,1). The addressing can be selected as standard Modbus or ABB. For further information on the PR120/D/M communication module, see paragraph 15.2 in this manual.

13.5.4.4.3 PR120/K - SIGNALLING module

For a thorough examination of the signalling module, refer to the corresponding section of the module, paragraph 15.3.

13.5.4.4.4 PR120/D - WL-COM module

This module is for wireless communication based on the Bluetooth standard between the PR122/P protection release and a hand-held PC (PDA) or a laptop with a Bluetooth port. For further information, see the description of the module in paragraph 15.4.

13.5.4.4.5 Settings for the Local Bus unit

If the PR021/K unit is connected, you need to enable the local bus by selecting present.

13.5.5 Test Menu

Access to the Test menu is password protected.

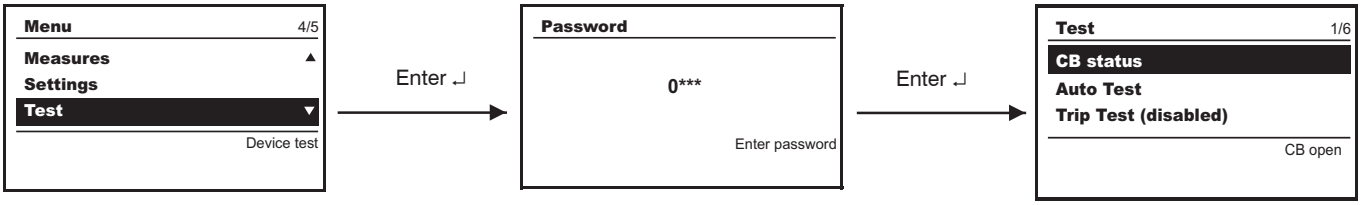

The menu shows the state of the CB, in the dialog module (COM module) the state of the springs and the position of the CB, and in this submenu you can make the CB open or close.
Using the "Trip Test" function lets you view the disabling/enabling of the Trip. If it is enabled, the circuit breaker is opened. The function is only available with a busbar current of nil (use Vaux, PR030/B or PR010/T).
On the page, only with Vaux, you can also see the state of the circuit breaker "STATUS", and thus make sure that the input is correctly wired.

The surfing path is summarized in the following table:

13.5.5.1 Test Menu table

	Parameter / Function	Values	Notes
CB status		Open/Closed Indefinite	
Auto Test			
Trip Test		Enabled / Disabled	
PR120/D-M Module	State of springs Position of CB Open CB Close CB	Loaded / Unloaded Isolated / Withdrawn	
PR120/K Module	Input Auto Test	ON - - -	
Zone selectivity	Protection S (status) Input Force Output Release Output Protection G (status) Input Force Output Release Output	 ON/OFF ON/OFF	

13.5.6 Information Menu

The Information Menu enables you to view the data relating to the protection unit and the type of circuit breaker.

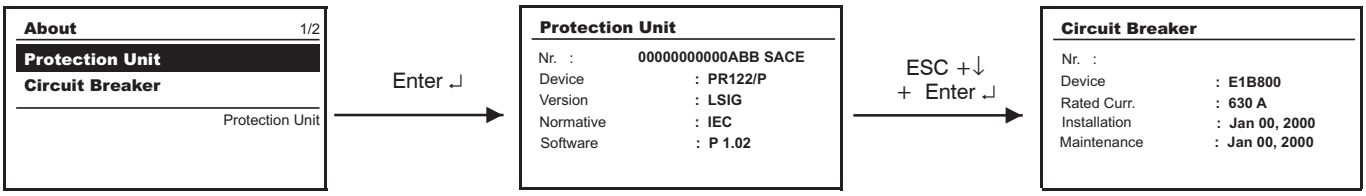

13.5.6.1 Information on the trip and opening data

The PR122/P unit saves all the information relating to the type of protection tripped, the opening data, the date and time. Using the "i Test" key makes the release show all these data directly on the display. There is no need for an auxiliary power supply for this function. With an auxiliary power supply, the information is shown immediately on the display without the need to press the "i Test" key and remains displayed indefinitely until you press the key.
The information remains available for 48 hours with the circuit breaker open or without any current flowing in the busbars. The data relating to the last 20 trips are stored in the unit's memory. By connecting a PR030/B battery unit or a BT030 wireless communication unit, you can retrieve the information relating to the last 20 trips recorded.
Access to view the opening data is via the Historicals submenu in the Measurements menu. The following is an example of the information provided:

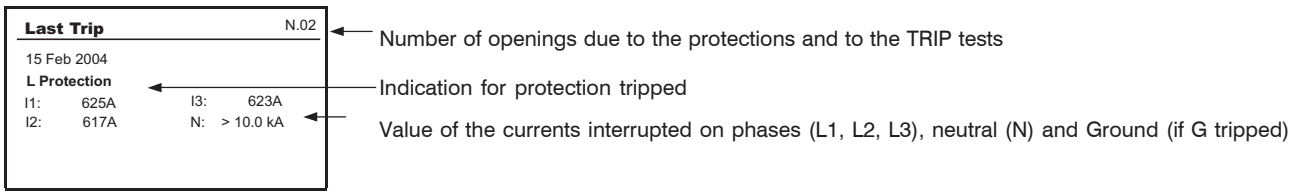
Last Trip N.02
15 Feb 2004
L Protection
I1: 625A
I2: 617A
I3: 623A
N: > 10.0 kA
Number of openings due to the protections and to the TRIP tests
Indication for protection tripped
Value of the currents interrupted on phases (L1, L2, L3), neutral (N) and Ground (if G tripped)

Again in the Measurements menu, you can view the percentage of contact wear, which is an indication of the electrical life of the electrical contacts in the circuit breaker.
In any case, functionality of the relay is in no way modified by the presence of the wear messages.
The prealarm message (wear > 80%, "warning" LED lighting up) indicates that the wear has reached a high value. The alarm message (100% wear, "alarm" LED lighting up) indicates that it is necessary to check the state of contact wear. The percentage of wear depends on the number of openings carried out by the circuit-breaker and by the absolute current interrupted during each of them.

13.6 Definition of alarms and signals in the PR122/P unit

13.6.1 Optical signals

Signalling	Description
Warning (yellow) led	• The prealarm threshold has been exceeded; one or more phases with current values in the range $0.9xI_1 < I < 1.05xI_1$ (on the Ne it depends on the selection made; for instance, at 50% the values are halved); • Presence, between two or three phases, of unbalance above the value programmed for the "U" protection, with protection trip disabled; • Presence of distorted wave form with form factor > 2.1; • Contact wear greater than 80% (and less than 100%; with Vaux only); • WARNING Threshold I_w exceeded; • Circuit-breaker state error; • Frequency out of range.
Alarm (red) led	• Presence of overload on one or more phases with current values I >1.3 I1 (timing protection “L”) (on the Ne it depends on the selection made; for instance, at 200% the values are doubled)*; • Timing in progress for protection function S; • Timing in progress for protection function G; • Timing in progress for the voltage (UV, OV, RV), frequency (OF, UF) protection functions; • Timing in progress for the reverse active power protection function (RP); • Timing in the case of unbalance between the phases (protection U) above the value set in the configuration with protection trip set to on; • Contact wear = 100%; • Rating Plug disconnected; • Trip Coil (TC) disconnected; • Key plug error; • Current sensors disconnected.

* The IEC 60947-2 Standard defines the timing threshold L for current: 1.05 < I < 1.3 I1

13.6.2 Electrical signals

K51/p1..p4 Programmable electrical signals, if the PR120/K module are installed and there is an auxiliary power supply.
Pressing the "i Test" key enables you to reset the activated contacts.

13.6.3 Table or error and warning messages

All the messages which can be shown on the display relating to incorrect configurations, generic alarms or deriving from the protection functions and linked to useful information are described below.

The following symbols in the warning signals have the following meanings:

= warning signal / Protection in alarm mode, with no trip (trip=off)

= protection in alarm mode, with trip at end of delay (trip=on)

= Information, no action except display on the protection release

Alarm message	Description	Notes
Harmonic dist.	Harmonic distortion alarm	Busbar currents with form factor > 2.1
Contact wear	Alarm for contact wear	Contact wear = 100%
G (TRIP OFF)	Alarm for protection G	
Gext (TRIP OFF)	Alarm for protection Gext	
T Alarm	Alarm for protection T	Temperature outside range
T (TRIP OFF)	Alarm for protection T	
U Alarm	Alarm for protection U	
UV Alarm	Alarm for protection UV	
OV Alarm	Alarm for protection OV	
RV Alarm	Alarm for protection RV	
RP Alarm	Alarm for protection RP	
UF Alarm	Alarm for protection UF	
OF Alarm	Alarm for protection OF	
LC1 Load	Alarm for load control LC1	
LC2 Load	Alarm for load control LC2	
L1 Sensor	Alarm for L1 phase current sensor	Phase L1 sensor disconnected or faulty
L2 Sensor	Alarm for L2 phase current sensor	Phase L2 sensor disconnected or faulty
L3 Sensor	Alarm for L3 phase current sensor	Phase L3 sensor disconnected or faulty
Ne Sensor	Alarm for Ne phase current sensor	Phase Ne sensor disconnected or faulty
Gext Sensor	Alarm for Gext current sensor	Gext sensor disconnected or faulty
Warning signal	Protection in alarm, with no trip (trip=off)	
TC disconnected	Trip Coil disconnected or faulty	
Rating Plug	Rating Plug Error absent or faulty	
Power factor	Alarm for power factor	The power factor module is lower than the specified threshold
Phase cycle	Phase cycle inverted	
Invalid date	Clock information lost	
CB status	CB state error	Probable error in Q26 and/or Q27
Startup	Error key plug	
CB not defined	State of circuit breaker inconsistent (Open/Closed)	Probable error in Q26 and/or Q27
Local Bus	Local Bus error	See par. 13.7
Contact wear	Contact wear prealarm	Contact wear ≥ 80%
L prealarm	Protection L prealarm	
T prealarm	Protection T prealarm	
Frequency range	Frequency out of range	
Warning Iw	Iw threshold exceeded	
Timing L	Timing protection L	
Timing S	Timing protection S	
Timing G	Timing protection G	
Timing Gext	Timing protection Gext	
Timing U	Timing protection U	

Configuration	Inconsistency parameters	
Configuration	Key plug-relay data incosistency	

Error message	Description	Notes
Timing UV	Timing protection UV	
Timing OV	Timing protection OV	
Timing RV	Timing protection RV	
Timing RP	Timing protection RP	
Timing UF	Timing protection UF	
Timing OF	Timing protection OF	

13.6.4 Error messages displayed in pop-up windows

All the messages that appear on the display in a pop-up window are described below.

Error message	Description
Password error	
Session impossible	A programming session cannot be started due to a contingency (e.g. timing still underway)
Value outside range	Value beyond the established limits
Failed 1001	Incongruence between thresholds of protections L and S
Failed 1007	NEC requirements not satisfied: G threshold >1200 A
Failed 1008	NEC requirements not satisfied: startup G threshold >1200 A
Unavailable	Function is not available
Invalid date	Date has not been set
Parameters revised	Programming session concluded correctly
Cancelled	Programming session cancelled
Failed	Programming session rejected

13.7 Troubleshooting PR122/P unit

The following table lists a series of typical service conditions, to help you understand and solve hypothetical faults or malfunctions.

Note:
1. Before consulting the following table, check for any error messages appearing for some seconds on the display.
2. FN indicates the normal operation of the PR122/P.
3. In the case where the suggestions proposed do not lead to a solution of the problem, please contact the ABB SACE assistance service.

N°	Situation	Possible causes	Suggestions
1	The trip test cannot be run	1. The busbar current is > 0. 2. The TC is not connected	1. FN 2. Check the messages on the display
2	Trip times lower than expected	1. Threshold too low 2. Curve too low 3. Thermal memory enabled 4. Incorrect neutral selection 5. The SdZ is inserted	1. Correct threshold 2. Correct curve 3. Disable if not necessary 4. Correct neutral selection 5. Exclude if not necessary
3	Trip times higher than expected	1. Threshold too high 2. Curve too high 3. Curve I^2t inserted 4. Incorrect neutral selection	1. Correct threshold 2. Correct curve 3. Exclude if not necessary 4. Correct neutral selection
4	Rapid trip, with I3=Off	linst tripped	FN with short-circuit with high I
5	High earth I, but no trip happens	1. Incorrect selection of the sensor 2. Function G prevented with I>4In	1. Set int. or ext. sensor 2. FN
6	Display off	1. Vaux missing and the current and/or voltage are below the minimum value. 2. Temperature out of range	1. FN, see 13.2.2.1 2. FN, see 13.2.9.8
7	The display is not back-lit	Current and/or voltages below the limit for lighting the display	FN
8	Reading of I incorrect	Current below the minimum threshold that can be displayed	FN
9	Reading of V, W and power factor incorrect	1) Connection error between VT and PR120/V 2) Voltage parameter settings error	1)Check connections between VT and PR120/V 2) Set the correct parameters
10	"⚠ Local Bus" message on display	No communication between PR122/P and PR021/K	1. If not present, disable PR021/K, see 13.5.4.4.5 2. Check bus connection 3. Check PR021/K
11	Message "" instead of expected data	Function disabled or data out of range	FN
12	The expected trip does not occur	Trip function disabled	FN enable trip if necessary
13	No activation of the Unbalance U protection	Values of I out of range	FN, see 13.2.9.5
14	No display of the opening	Vaux missing, the buffer data capacitor is discharged	FN, see 13.5.6.1
15	The password is not requested	The password has been disabled	FN, re-enter the password with a value other than 0000.
16	Impossible to change any parameter	PR122/P in alarm situation	FN
17	"⚠ Sensor time" or "⚠ Start-up" message	Possible failure inside relay	Contact ABB Sace
18	Invalid date	1. First installation 2. Lost information for power supply lack	FN, see 13.4.3.1
19	Unexpected trip	see 13.6.3	
20	Led lighting	FN, see 13.6.1	
21	It's not possible to change the language	1. The relay is set in remote control 2. The circuit breaker is closed 3. Vaux or PR120/V supplied or PR030/B not present	1. Set the relay in local control 2. Open the circuit breaker 3. Supply the relay

13.7.1 In the case of a fault

If you suspect that the PR122/P is faulty, has a malfunction or has generated an unwanted trip, it is advisable to follow the recommendations below very carefully from the Measurements menu ⟶ Historicals ⟶ Trip:

1. Make a note of the type of protection that has tripped by accessing the LAST TRIP page if there is an external power supply (Vaux or battery) or by pressing "i Test" if in self-supply mode.
2. Note down the type of circuit-breaker, number of poles, any accessories connected, In, Serial Number (see par. 13.4) and the SW version.
3. Prepare a brief description of the opening (what led and/or warning were on the display? when did it happen?, how many times), was it always under the same conditions? what type of load? what voltage? what current? is the event reproducible?)
4. Send/communicate all the information collected, together with the circuit diagram for the circuit-breaker, to your nearest ABB Customer Support service.

The more the information given to the ABB Customer Support service is complete and accurate, the easier the technical analysis on the problem encountered will be, enabling us to take all action to help the user without delay.

13.8 Accessories

13.8.1 ABB SACE PR010/T test and configuration unit

The test with the SACE PR010/T unit enables you to check the proper operation of the inputs, outputs, thresholds and tripping times of the protection functions "L", "S", "I", "G", OV, UV, RV, U. The test unit is wired to the relay by means of the front Test connector (see par. 13.4).

13.8.2 ABB SACE PR030/B power supply unit

The PR030/B is a momentary power supply unit to be inserted in the front test connector of the PR122/P.
Using this standard accessory, you can run an autotest, the trip test, and power the PR122/P unit whatever the state of the circuit breaker (open/closed, in the test position or enabled and without an auxiliary power supply).
The battery inside the PR030/B guarantees a power supply to the unit for about 3h continuously (depending on the operations conducted on the PR122/P and on the PR120/D-BT module).
The life of the battery diminishes if the PR030/B accessory is also used to perform the trip test and the autotest. It is essential to use the PR030/B to read the trip data if the trip has occurred more than 48 hours earlier and the release was no longer powered.

13.8.3 BT030 wireless communication unit

The BT030 is a device for connecting to the Test connection on the PR122/P.
It enables Bluetooth communication between the protection release and a hand-held or laptop PC with a Bluetooth port.
This device is dedicated for use with the SD-Pocket application.
The BT030 has a rechargeable Li-ion battery that can provide the power needed for it to function and for the protection release.

14 SACE PR123/P Release - Identification

The PR123/P units available, in accordance with the IEC standards, together with the various protections and the various standard and optional modules, are illustrated in the following figure:

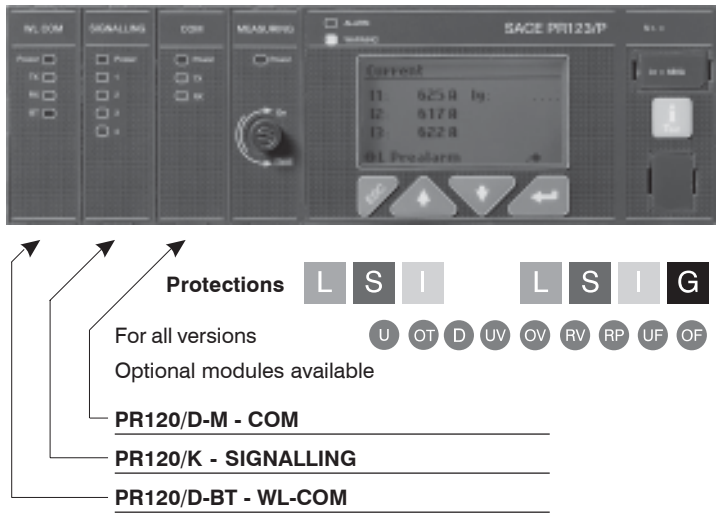

14.1 Standard

The PR123/P has been designed to work in accordance with the international standard:
Low voltage AC and DC power circuit breakers used in ANSI/UL 1066 enclosures.

14.2 Specifications

14.2.1 General

The PR123/P is a high-performance self-supplied protection unit with **Protection, Measurement, Data storage, Communication (optional), Self-test, Load control** and **Zone selectivity** functions for the ABB SACE 'Emax' range of 3- and 4-pole low-voltage air circuit breakers. The unit's user interface also enables parameter setup and complete the prealarm and alarm management for the protection and watchdog functions.

The protections available are:

Symbol	Protection against
L	overload with inverse long time delay
S, S2	short-circuit with adjustable delay
D	directional short-circuit with adjustable delay
I	instantaneous short-circuit
G	earth fault with adjustable delay
U	phase unbalance
OT	temperature out of range
UV	undervoltage
OV	overvoltage
RV	residual voltage
RP	reverse active power
UF	underfrequency
OF	overfrequency

The PR123/P can be installed on 3-pole CBs with and without an external neutral, or on 4-pole CBs.

It should be noted that the reference current for the PR123/P is the In (the rated current defined by the front Rating Plug) and not the Iu (the uninterrupted rated current of the CB itself).
Example: the CB E1B800 with a 400A Rating Plug has an Iu of 800A and an In of 400A.

The unit opens the circuit breaker in which it is installed by means of the TC, which takes effect directly on the device's mechanical leverism.

The protection unit is self-supplied by current sensors and primary voltages via the PR120/V module.
The unit is made using digital microprocessor technology and interfaces with the user by means of a graphic display and keyboard.

14.2.2 Electrical characteristics

Rated operating frequency	50/60 Hz ±10%
Pass band	3000 Hz max
Peak factor	6.3 max @ 2 In
MTBF (MIL-HDBK-217E)	15 years @ 45°C

14.2.2.1 Self-supply

The self-supply enables the protection unit to be powered with the busbar current using current transformers.
Using this supply mode, the unit's protection functions are assured, however, not the accessory functions regarding the modules. The characteristics are given in the table below:

General characteristics	E1 - E2 - E3	E4 - E6
Minimum single-phase busbar current for the complete activation of release protection function	70 A	140 A

14.2.2.2 Auxiliary power supply

The external auxiliary power supply is provided using a galvanically-separated power pack.

Since the auxiliary voltage needs to be isolated from the ground, "galvanically separated converters" in accordance with the IEC standard 60950 (UL 1950) or the equivalent IEC 60364-41 and CEI 64-8 have to be used to guarantee a current in common mode or leakage current (as defined in IEC 478/1 and CEI 22/3) no greater than 3.5mA

The presence of the auxiliary power supply enables the relay unit to be used even with the circuit breaker open, as well as powering all the modules, with the exception of the PR120/V - MEASURING module, which is powered by means of a connection to the busbars.
The characteristics of the power pack are given in the table below:

Characteristics	Version PR123/P
Auxiliary voltage (galvanically separated)	24V DC ±20%
Maximum ripple	5%
Inrush current @ 24 V	~10A for 5ms
Rated power @ 24 V	~3W

14.2.2.3 Powered by the PR120/V module

For a full explanation of the features of the PR120/V, see par. 15.1.

14.2.3 Environmental characteristics

Operating temperature	-25°C ... +70°C
Storage temperature	-40°C ... +90°C
Relative humidity	0% ... 98% with condensation
Degree of protection (with PR123/P installed in the CB)	IP 30

14.2.4 Description of inputs/outputs

14.2.4.1 Binary opto-insulated inputs

- **K51/SZin (K51/DFin):** Zone selectivity: input for protection S or "direct" input for protection D (only with Vaux)
- **K51/Gzin (K51/DBin):** Zone selectivity: input for protection G or "reverse" direction input for protection D (only with Vaux)

14.2.4.2 Binary opto-insulated outputs

- **K51/SZout (K51/DFout):** Zone selectivity: output for protection S or "direct" output for protection D (only with Vaux)
- **K51/GZout (K51/DBout):** Zone selectivity: output for protection G or "reverse" output for protection D (only with Vaux)

14.2.5 Communication bus

Local internal bus on rear connector; RS485 physical interface, ABB SACE protocol.
External system bus, RS 485 physical interface, Modbus RTU protocol, baud rate 9600-19200 bps.

14.2.6 Protection functions

The PR123/P protection unit carries out 14 independent protection functions. In particular:

1. Protection against overload with inverse time "**L**";
2. Protection against short-circuit with adjustable delay "**S**" and "**S2**";
3. Protection against directional short-circuit with adjustable delay "**D**";
4. Protection against instantaneous short-circuit "**I**";
5. Protection against earth fault with adjustable delay "**G**";
6. Protection against instantaneous short circuit at high currents "**Iinst** ";
7. Protection against phase unbalance "**U**";

8. Protection against overtemperature “**OT**”;

9. Protection against undervoltage "**UV**";
10. Protection against overvoltage "**OV**";
11. Protection against residual voltage "**RV**";
12. Protection against reverse active power "**RP**";
13. Underfrequency "**UF**";
14. Overfrequency "**OF**".

The PR123/P unit allows current signal processing of the neutral pole with different relationships relative to the value of the phases.
N.B.: Beyond 15.5xIn of current on the Ne, the protection is considered as being set to 100%.

A timing indication (message + "alarm" LED) is provided on the unit's display, which is activated during a protection alarm. It is disabled when the alarm condition ceases or when the protection has been tripped. When the circuit breaker opens, the page with the "Trip" data is displayed (when "i Test" is pressed, or automatically in the presence of Vaux).

14.2.6.1 Rms and peak calculation

All the protection functions do their respective processing on the basis of the real rms value of the currents and voltages (the protection G is disabled for current values greater than 8 In (where $I_4 \geq 0.8In$), greater than 6In (where $0.5In \leq I_4 < 0.8In$) and greater than 4In (where $I_4 < 0.5In$)).
If the waveform has a deformation beyond the declared limit (6.3@2 In), the tolerance for the calculation of the true rms value will increase. The UV, OV, RV voltage protections always work on the basis of the true rms value of the voltages.

14.2.6.2 Mains frequency

The PR123/P unit constantly measures the frequency of the mains voltages it is connected to.

If the frequency goes out of the permitted range by ±10% in relation to the nominal frequency selected (50 or 60Hz), the "warning" LED comes on and the warning message is displayed (see par. 14.6.3).
The signal can be combined with a relay of the optional PR120/K module or with those of the PR021/K unit.

14.2.6.3 Harmonic distortion

The PR123/P unit signals that a peak factor of 2.1 has been exceeded with a warning message and the "warning" LED lighting up (remember that the IEC 60947-2 standard annex "F" establishes that the protection unit must function regularly with a peak factor ≤ 2.1, up to 2x In).

The signal can be combined with a relay of the PR120/K module or with those of the PR021/K unit.

14.2.6.4 Circuit-breaker state

If an auxiliary supply is used, or it is powered from the PR120/V, the PR123/P unit records the state of the circuit breaker by means of specific wiring on the circuit breaker. In the case where the presence of current is determined with the circuit-breaker in the "OPEN" state, a state error is signaled by a warning message being displayed (see par.14.6) and the "warning" LED lighting up.

The signal can be combined with a relay of the PR120/K module or with those of the PR021/K unit.

14.2.7 Measurement functions

The current measuring (ammeter) function is available on all versions of the SACE PR123/P unit.
The display shows histograms with the currents of the three phases and of the neutral on the main page. In addition, the current of the phase under the greatest load is given in numerical form. Where applicable, the earth fault current is displayed on a separate page.
The ammeter functions both in self-supply mode and with an auxiliary supply. In the latter case, the display is backlit and the ammeter is always active. The tolerance for the ammeter measuring chain (current sensor plus ammeter) is described in paragraph 14.2.9.16.

The PR123/P release provides a complete set of measurements:
- Currents: three phases (L1, L2, L3), neutral (Ne), earth fault
- Voltage: phase-phase, phase-neutral, residual voltage
- Instantaneous voltage values over a given time interval (data logger)
- Power: active, reactive, apparent
- Power factor
- Frequency and peak factor
- Energy: active, reactive, apparent, meter
- Harmonics calculation: up to the fortieth harmonic (waveform and module of the harmonics displayed); up to the thirty-fifth for frequency f=60Hz
- Maintenance: number of operations, percentage of contact wear, opening data storage.
- Data Logger: see par.16.4.

The PR123/P unit can provide the trend of the measurements of certain quantities over an interval P, established by the user; these include: mean active power, maximum active power, maximum current, maximum voltage and minimum voltage. The last 24 P intervals (adjustable from 5 to 120 min) are stored in a non-volatile memory and displayed in a bar graph.
To examine the Measurement functions, see the relevant paragraphs (par.15.1 and par. 14.5.3) for the PR120/V - MEASURING module.

14.2.8 Watchdog

The PR123/P unit provides some watchdog functions able to guarantee the proper management of relay malfunctions. These functions are as follows:

- ❑ Watchdog for presence of Auxiliary power supply with "plug" icon displayed.
- ❑ Rating PLUG validity.
- ❑ Watchdog for proper connection of the current sensors (CS). Any anomalies are indicated by a special alarm message and the "alarm" LED coming on, and the circuit breaker opens after 1s.

- ❑ Watchdog for proper connection of the Trip Coil (TC). Any anomalies are indicated by a special alarm message and the "alarm" LED coming on. If the PR120/D-M module is installed, this activates the coil opening command (YO), thus opening the CB.
- ❑ Watchdog for protection against Hw Trip. If the sensors are disconnected or there is a Rating Plug error, a CB opening command is issued due to the TC being activated.

14.2.9 Description of the protection functions

14.2.9.1 Protection "L"

The "L" is the only protection that cannot be disabled because it is for self-protection against overloading of the relay itself. The types of trip curves settable are divided into two groups according to the standard they refer to.

Standard trip curve according to IEC 60947-2

Only one type of curve is settable ($t=k/I^2$) as defined by the IEC standard 60947-2.
The protection trip time - inverse time - is given by the expression.

$\frac{9 \cdot t_1}{(I_f / I_1)^2}$ where $I_f \leq 12In$ and 1s where $I_f > 12In$ where I_f is the fault current and I_1 the protection threshold.

NB: Time expressed in seconds.

14.2.9.1.1 Thermal memory "L"

The thermal memory function can be enabled for cable protection. It is based on the "τL" parameter defined as the trip time of the curve (t1) selected at 1.25xI1.
The release trip time is certainly 100% of the one selected, after an interval τL has passed since the last overload or since the last trip. Otherwise, the trip time will be reduced, depending on the overload which has occurred and on the time that has elapsed.

The PR123/P is fitted with two instruments to make up this thermal memory. The first is only effective when the release is powered (it also records overloads that have not lasted long enough to trip the release), while the second works even when the release is not powered, reducing any trip times in the case of an immediate reclosing and is enabled as soon as the CB is tripped.
It is the PR123/P release that automatically decides which of the two to use, according to the various situations.
NB: The thermal memory function can only be set if the type of curve selected is the standard one ($t=k/I^2$) (see par. 14.2.9.1).

14.2.9.2 Protection "S"

This protection can be disabled; it can be of the fixed time (t=k) or inverse time ($t=k/I^2$) type. In the latter case, the trip time is given by the expression.

$\max\left[\frac{100 \cdot t_2}{(I_f)^2},\ t_2\right]$ where $I_f > I_2$ where I_f is the fault current and I_2 the protection threshold.

14.2.9.2.1 Thermal memory "S"

The thermal memory function can be enabled for cable protection in the case where the curve with inverse time is selected. This is based on the "tS" parameter defined as the trip time of the curve (t2) selected at 1.5xI2. The other characteristics are the same as those for thermal memory "L" (see par. 14.2.9.1.1).

14.2.9.2.2 Start-up threshold "S"

The start-up function can be selected in the case where the curve with fixed time is selected.
The function can be disabled and it is a setting characteristic of the single protection units.
The start-up function enables the protection threshold (S, D, I and G) to be changed during a time interval lasting "ts", starting from "start-up". The latter must be intended as follows:
- Turning on of the relay, under self-supply;
- Passage of the peak value of the maximum current over 0.1xIn. A new start-up is possible after the current has dropped below 0.1xIn.

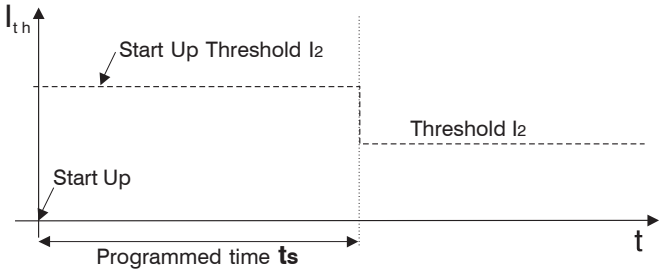

- **Start-up time**

The start-up time is common to all the protections involved.
Range: 0.1 s ... 1.5 s, with steps of 0.01 s.

14.2.9.2.3 Zone selectivity "S"

The zone selectivity function, guaranteed only if an auxiliary voltage is provided, enables the area of the fault to be isolated, only isolating the part of plant nearest to the fault, while keeping the rest of the plant operational.
This is done by connecting all the zone selectivity outputs of the releases belonging to the same zone to one another (ZSO=K51/SZout) and taking this signal to the zone selectivity input (ZSI=K51/SZin) of the next release on the supply side. If the wiring has been done correctly, all the zone selectivity inputs of the last circuit-breakers in the chain and all the outputs of the circuit-breakers at the head of each chain must be empty.

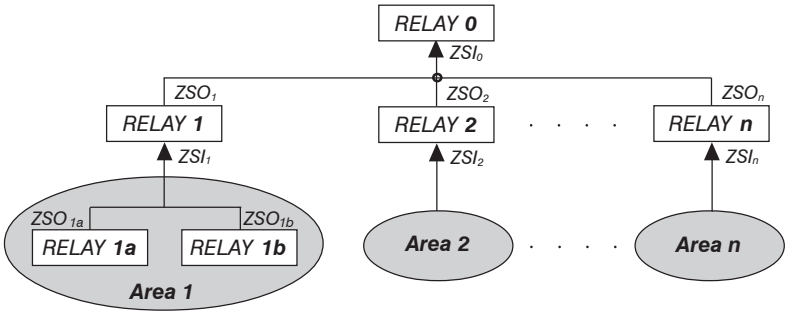

As a practical example, the figure above shows a fault on the load side of the "Relay 1a" isolated by the latter without the "Relay 1" or the "Relay 0" being affected; a fault immediately downstream from the "Relay 1" will be isolated by the latter without the "Relay 0" being affected, thus ensuring that the Areas 2...n remain operational.

The ZSO output can be connected to a maximum of 20 ZSI relays on the supply side in the selectivity chain.

The maximum length of cable for zone selectivity, between two units, is 300 meters.
Use corded shielded two-wire cable (see note A to par. 11.2.2).
The shield must only be earthed on the circuit-breaker of the supply-side relay (ZSI side).

Wiring and enabling zone selectivity "S" is an alternative to using protection "D" and operation is only guaranteed when there is an auxiliary voltage.
The following logical table is implemented to manage the Zone Selectivity Input (ZSI) and Zone Selectivity Output (ZSO) signals:

Zone selectivity	Imax > I_2	ZSI signal	ZSO signal	Trip T
Excluded	NO	0	0	No trip
Excluded	NO	1	0	No trip
Excluded	SI	0	0	t_2 programmed
Excluded	SI	1	0	t_2 programmed
Inserted	NO	0	0	No trip
Inserted	NO	1	1	No trip
Inserted	SI	0	1	$t_{selectivity}$
Inserted	SI	1	1	t_2 programmed

The time t_2 must be set at a value corresponding to at least $t_{selectivity}$ +50 ms.

14.2.9.3 Double S

Thanks to the new PR123/P release that enables two independent and simultaneously active protection S thresholds to be specified, selectivity can be assured even in critical conditions.
This function enables a better selectivity level to be obtained than using a release without a "double S".

14.2.9.4 Directional Protection "D"

The PR123/P unit carries out excludable directional protection against short-circuit with adjustable fixed time (t = k) active both with self-supply and with auxiliary supply.

The protection functionality is very similar to protection "S" with fixed time, with the capacity to recognize the current direction during the fault period as well. However, it is a phase and not a neutral protection.
The direction of the current enables the determination of whether the fault is on the supply side or the load side of the circuit-breaker. Especially in ring distribution systems, this enables the distribution stretch where the fault occurred to be identified and isolated without interfering with the rest of the installation (using zone selectivity).
To determine the direction of the current, the value of the phase reactive powers has to be higher than 2% of the nominal phase power ($P_Q \geq 2\% \cdot P_{nphase}$).
Protection D always considers I neutral = 100%.

The PR123 enables you to define the power flow in the circuit breaker from the menu
from high to low (High → Low),
from low to high (Low → High),
selectable in the menu Modules Measuring Module (PR120/V).

As a result, the currents in the circuit breaker will be defined as "forward" or "backward" if their are in phase or out of phase with the previously-defined power flow (for the default setting, see par.14.4.4).

In short:

Ifault (I_f)		Power flow setting High -> Low	Power flow setting Low -> High
Value	**Direction**	**T trip**	**T trip**
$I_f < I_7$	either	No trip	No trip
$I_f > I_7$	High → Low	t_{7FW}	t_{7BW}
$I_f > I_7$	Low → High	t_{7BW}	t_{7FW}

Example:
Once the power flow has been set as "High → Low", the direction of the figure alongside is:

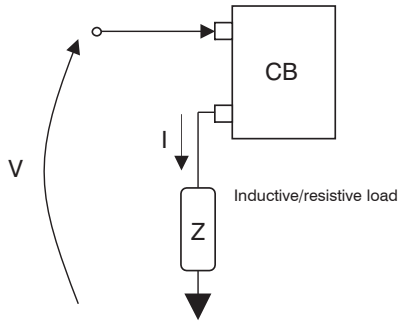

positive reactive power in → "forward" direction;

negative reactive power in → "backward" direction;

If the preset trip times were t_{7FW} = 200ms and t_{7BW} = 400ms, in this case the relay would have opened the circuit breaker after t_{7FW} = 200ms.

In short:
If $I_f > I_7$ and the direction of the current detected is in phase, at the power flow set by the user the relay counts down the delay and opens the circuit breaker in a time corresponding to t_{7FW} .
If $I_f > I_7$ and the direction of the current detected is out of phase, at the power flow set by the user the relay counts down the delay and opens the circuit breaker in a time corresponding to t_{7BW} .

Note:
- With the directional protection D activated, if the direction of the power cannot be determined the relay takes effect considering shorter of the programmed times between $t_7$fw and $t_7$bw.
- This protection works on the basis of the phase currents, not the neutral current.

14.2.9.4.1 Start-up threshold "D"

The function can be enabled from the menu (see description of the protection menu 14.5.2)
The function behaves in exactly the same way as the protection "S" (see par.14.2.9.2.2).

14.2.9.4.2 "D" (directional) zone selectivity

The Directional Zone Selectivity (SdZ D) function is particularly useful in ring and grid type systems where, in addition to the zone, it is essential to define the direction of the power flow that powers the fault.

The SdZ D can be set as an alternative to Zone Selectivity S and G and requires an auxiliary power supply.

To define the zone and power flow, each relay has two inputs (DFin and DBin) and two outputs (Dfout and DBout), which must be suitably connected to the other relays (see example below).
As in the SdZ S and G, the relays interact with each other, sending cutout signals via the outputs and reading them via the inputs.

The general behavior is summarized in the table below.
(Example with power flow setting "High → Low").

Ifault (I_f)		Outputs status		Inputs status		T trip
Value	**Direction**	**DFout**	**DBout**	**DFin**	**DBin**	
$I_f < I_7$	either	0	0	either	either	No trip
$I_f > I_7$	High -> Low	1	0	0	either	t_s
$I_f > I_7$	High -> Low	1	0	1	either	t_{7FW}
$I_f > I_7$	Low -> High	0	1	either	1	t_{7BW}
$I_f > I_7$	Low -> High	0	1	either	0	t_s

If the power flow is in phase with the direction set on the relay, the output DFout is enabled (1).
Vice versa, if the power flow is out of phase, the output DBout is enabled (1).

The typical configuration of the system of circuit breakers for which the SdZ D is likely to be used is the sort of ring illustrated in the following figure.

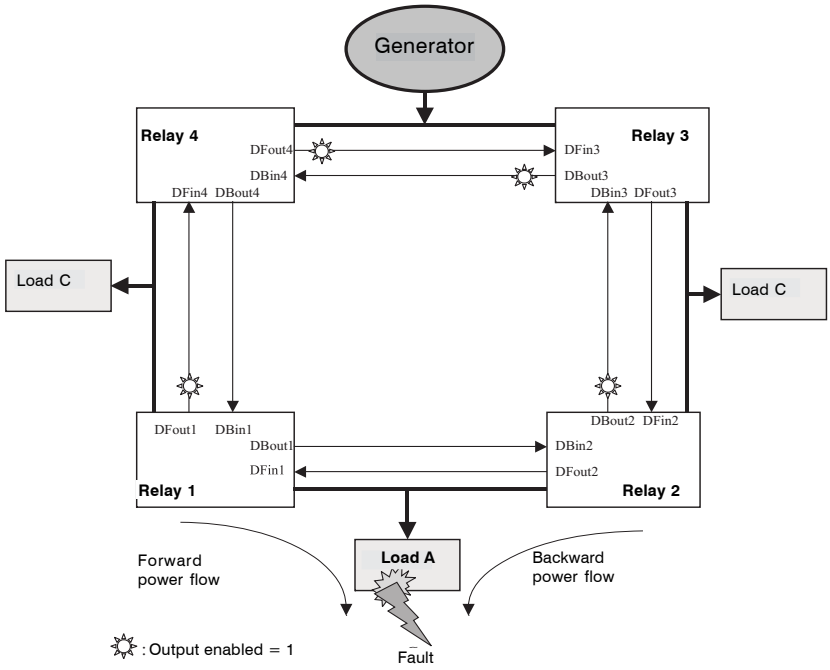

If a fault is detected (I fault If beyond the threshold I7) one of the sections in the system (Load A), the final circuit breakers for the section in question (Relay1 and Relay2) communicate the presence of the fault to the connected circuit breakers (Relay4 and Relay3) by setting the output signals DFout or DBout depending on the direction of the current (DFout1=On, DB2out=On). To be more precise, the circuit breakers that limit the section affected by the fault see the direction of the fault current in different ways (Relay1=forward and Relay2=backward).

The circuit breakers (Relay1 and Relay2) delimiting the section affected by the fault are tripped with the selectivity time ts, while the circuit breakers further away from the fault count down the time t7FW (Relay4) and t7BW (Relay3) without opening; in this way, the system is isolated, in the time ts, to exclude the part affected by the fault.
The load A, where the fault has occurred, will be disconnected, but loads B and C will continue to be powered normally.

It should be noted that activation of the DBout3 output by the relay3 will have no effect on the relay4, because the latter is recording not an out-of-phase (backward) fault current, but an in-phase (forward) current with the power flow defined previously by the user (High -> Low).

Note:
- With zone selectivity enabled, if the direction of the power flow cannot be ascertained, the relay is tripped considering the lesser of the programmed times between t7fw and t7bw, without enabling any outputs (DFout or DBout).
- If, for some reason, one of the circuit breakers required to open does not do so, a specific function will activate the opening of the first circuit breaker immediately upstream from it, after a further 100 ms approx. In the above example, if the circuit breaker does not open with the relay1, only the circuit breaker with relay4 will open after a time ts+100 ms.
- The SdZ D operates on the basis of the phase currents, not of the neutral.

14.2.9.5 Protection “I”

The protection is enabled/disabled from the menu.
In the case where zone selectivity "S" (or "D") is active, during the trip of the relay for "I", the ZSO (or DFW and BFW) output signal is activated in any case to guarantee correct operation of the relay on the supply side (and on the load side).

14.2.9.5.1 Start-up threshold “I”

The start-up function can be selected.
The function can be enabled from the menu on the protection "I" page.
The function behaves in exactly the same way as the protection "S" (see par. 14.2.9.2.2).

14.2.9.6 Protection “G”

This protection can be disabled; it can be of the fixed time (t=k) or inverse time ($t=k/i^2$) type. In the latter case, the trip time is given by the expression

$\max\left(\frac{2}{I^2}, t_4\right)$ where $I=I_f/I_4$, I_f is the fault current and I_4 is the protection threshold.

NB: Time expressed in seconds.

It is possible to disable the trip control of the protection ("Enable Trip: Off").
For the whole duration of the earth fault, circuit-breaker opening does not take place, but only the alarm condition is signaled ("Alarm" LED lit and alarm message).

The PR123/P unit can provide two different types of earth fault protection:

Internal protection G
This is provided inside the release by vectorially summing the phase and neutral currents. The fault current is defined by the following formula:

$$\overrightarrow{I_G} = \overrightarrow{I_1} + \vec{I}_2 + \vec{I}_3 + \vec{I}_N$$

If the circuit reveals no faults, the module of the sum of these currents is always nil; vice versa, the value of the fault current takes on a larger and larger value depending on the entity of the fault. This operating mode is enabled by default.
N.B.: it can be used also with CS for an external neutral.

Protection G with external toroid "Source Ground Return"
Also called "Source Ground return", this can be carried out when there is the need to check operation of a machine (transformer, generator or motor etc.) which has star-configured windings.
The protection is assured by physically positioning an external toroid on the cable connected from the star center of the machine to the earthing connection point.
The induced current on the winding of the toroid is proportional to the fault current which, in this case, only transits in the above-mentioned toroid.
To work in this mode, "Ground protection" must be selected on the Circuit breaker Settings menu.

The external toroid must be connected to the PR123/P by means of a corded shielded two-wire cable (see note A in par. 11.2.2) with a length not exceeding 15m.
The shield must be earthed both on the circuit-breaker side and on the toroid side.

It is indispensable for the star center to be connected openly to earth and for it not to be used as a neutral conductor too (as in the TNC system), making a protection according to the TT system.
The protections G and Gext can be enabled simultaneously.

14.2.9.6.1 Start-up threshold "G"
The start-up function can be selected in the case where the curve with fixed time is selected.
The function can be enabled and disabled on the protection "G" page.
The function behaves in exactly the same way as the protection "S" (see par. 14.2.9.2.2).

14.2.9.6.2 Zone selectivity "G"
The zone selectivity function can be enabled providing the fixed time curve, the wiring and the zone selectivity "G" enabling alternative to the one for "D" have been selected and the function is assured only if auxiliary voltage is provided.

Zone selectivity "G" can be active at the same time as zone selectivity "S".
The behavior and wiring of the function are identical to those indicated for zone selectivity "S" (see par. 14.2.9.2.3).

14.2.9.7 Protection against phase unbalance "U"
The protection with fixed time, which can be excluded, trips in the case when, for a time greater than or the same as the time **t6** set, an unbalance is determined between two or more phases higher than the set threshold **I6**.

The percentage of unbalance is therefore calculated $\%Unb = \frac{I_{max} - I_{min}}{I_{max}} \cdot 100$ where I_{max} is the maximum and I_{min} is the minimum phase current.

It is possible to disable the trip control of the protection ("Enable Trip: Off").
In that case, for the whole duration of the unbalance the CB will not be opened, but only the condition will be signaled by means of the "warning" LED lit up and a warning message.
When the value of the phase current is above a 6xIn, the function "U" excludes itself because, in this case, the other protections intervene because the fault is considered as a phase fault.
The protection is not enabled for maximum phase current values lower than 0.3xIn.

14.2.9.8 Protection against overtemperature inside the relay, "OT"
There is a sensor inside the PR123/P unit that monitors the temperature of the unit.
This enables the signalling of any abnormal temperature conditions, which could cause temporary or continuous malfunctions of the unit's electronic components.

This protection has two states of operation:

State of "**WARNING TEMPERATURE**" with ***–25°C < temp. < -20°C*** *or* ***70°C < temp. < 85°C*** : the display is turned off and the "WARNING" LED flashes.

State of "**ALARM TEMPERATURE**" with ***temp. < –25°C*** or ***temp. > 85°C*** : the display is turned off,

the "WARNING" led remains on and the Trip is activated (if enabled, by means of the "Over Temper. Trip = On" parameter).

N.B.:
- In the event of Warning and Alarm, the display is momentarily turned off, to preserve its functionality.
- The monitored temperature is not visible on the display.

The protection is always active, both with auxiliary supply and in self-supply.

Disabling the Trip control of the protection means that the PR123/P unit could work, with the circuit-breaker closed, in a range of temperatures where correct operation of the electronics is not guaranteed.

14.2.9.9 Load control function

Single loads can be enabled/disabled on the load side before the overload protection L intervenes and trips the circuit breaker on the supply side. This is done by contactors or switch-disconnectors (wired outside the release), controlled by the PR123/P by means of contacts on the PR120/K module or on the PR021/K external unit.

The current thresholds are lower than those available with the protection L, so that the load control can be used to prevent tripping due to overloads. The function is active when an auxiliary power supply is present, or supply from PR120/V (see par. 15.1.4)

The operating logic involves the activation of three contacts when the preset thresholds LC1, LC2 and I_w are exceeded.

Thresholds LC1 and LC2 are expressed as a percentage of I_1 (current threshold specified for protection L) while the "warning current" I_w is expressed as an absolute value. The allowable values are given in the following table:

Warning current Iw	0.30 ÷ 3.00 step 0.05xIn
Threshold LC1	50% ÷ 100% step 1% xI_1
Threshold LC2	50% ÷ 100% step 1% xI_1

From the PR123/P you can associate each of the PR120/K or PR021/K contacts with a configuration (NO or NC), a delay and the eventual latch.

14.2.9.10 Voltage protections "UV", "OV", "RV"

The PR123/P unit provides 3 voltage protections, which can be disabled, with fixed adjustable time (t = k), active both with self-supply and with auxiliary supply:
- Undervoltage "UV"
- Overvoltage "OV"
- Residual voltage "RV"

The protections work on the voltages. The threshold voltages indicated refer to the line voltage.

Apart from the normal timing and "TRIP" operation, the voltage protections can be in a state defined as "alarm" (with the "emergency" led on and an alarm message displayed) providing there is an auxiliary or PR120/V module power supply. In fact, in the case where the circuit-breaker is open and no current is detected, the timing leads to the "alarm" state and not to "TRIP". This is because the fault linked to the voltages can persist even with the circuit-breaker open and the unit would therefore always be under "timing". When the circuit-breaker is closed or the passage of a current is detected, you pass immediately from the state of "alarm" to "TRIP" without timing (see par. 14.3.2).

14.2.9.10.1 Protection “UV”

When the minimum phase voltage drops below the set threshold U_8 the protection counts down the preset time interval t_8 and then opens.

14.2.9.10.2 Protection “OV”

When the maximum phase voltage exceeds the set threshold U_9 the protection counts down the preset time interval t_9 and then opens.

14.2.9.10.3 Protection “RV”

When the residual voltage exceeds the set threshold U_{10} the protection counts down the preset time interval t_{10} and then opens.
The residual voltage U_0 is calculated by vectorially summing the phase voltages. It is therefore defined by the following formula.

$$\overrightarrow{U_0} = \overrightarrow{U_1} + \overrightarrow{U_2} + \overrightarrow{U_3}$$

14.2.9.11 Protection against Reverse active power "RP"

The PR123/P unit provides protection (which can be disabled) with an adjustable fixed time (t = k), against reverse active power, active both with self-supply and auxiliary supply.

When the total reverse active power (sum of the power of the 3 phases) exceeds the set reverse active power threshold P_{11}, the protection counts down the preset time interval t_{11} and then opens.
The minus sign ('-') in front of the threshold and power indicates reverse power. The threshold is indicated as a percentage of "Pn", where "Pn" is the rated power of the circuit-breaker (3 Vn*In).

14.2.9.12 Frequency protections "UF", "OF"

The frequency protections record the mains frequency variations above an adjustable threshold (f_{12}, t_{12}) or below (f_{13}, t_{13}), generating an alarm or the opening of the circuit breaker.

14.2.9.13 Double protections setting

Using the double protections setting, the PR123/P can save a set of alternative parameters for all the protections. The second set of parameters (set B) can replace the default set (set A) by means of an external command. The passage from set A to set B can be made when there is a change in the mains configuration or when there is an emergency capable of changing the load capacity and the short circuit levels.

The second set of parameters (set B) can be enabled by:
- digital input provided with the PR120/K module. For instance, it can be connected to an auxiliary contact of a bus-tie;
- communication network, by means of the PR120/D-M (e.g. when the switch is scheduled);
- directly from the user interface on the PR123/P (see settings menu par. 14.5.4).
- with a time that can be specified by set A or set B after the circuit breaker has closed.

In operation, the state (set A and set B) is indicated on the display.
The double setting is disabled by default. To enable it, see par. 14.5.1.4.

14.2.9.14 Summary table of the protection function settings for the PR123/P

Protection	Disabling	Disabling of TRIP only	Zone selectivity	Start-up threshold	Thermal memory	Threshold Range	Time Range	Threshold tolerance (2)	Time tolerance (2)
L ($t=k/I^2$)	☐	☐	☐	☐	☒	$0.4xIn \le I_1 \le 1xIn$ step 0.01xIn	$3s \le t_1 \le 144s$ (1), step 3s at $I=3xI_1$	Release between 1.05 and 1.2xI1	± 10%, $I_f \le 6$ In ± 20%, $I_f > 6$ In
S_1 ($t=k$)	☒	☐	☒	☒	☐	$0.6\ xIn \le I_2 \le 10xIn$ step 0.1xIn $0.6\ xIn \le I_{2\ start\text{-}up} \le 10xIn$ step 0.1xIn	Min, $0.05s \le t_2 \le 0.4s$, step 0.01s $0.10s \le t_{2start\text{-}up} \le 1.5s$, step 0.01s $0.04s \le t_{2sel} \le 0.20s$, step 0.01s	± 7%, $I_f \le 6$ In ± 10%, $I_f > 6$ In	The best of the two data ± 10% or 40 ms
S_1 ($t=k/I^2$)	☒	☐	☐	☐	☒	$0.6xIn \le I_2 \le 10xIn$ step 0.1xIn	$0.05s \le t_2 \le 0.4s$, step 0.01 at 10xIn	± 7%, $I_f \le 6$ In ± 10%, $I_f > 6$ In	± 15%, $I_f \le 6$ In ± 20%, $I_f > 6$ In
S_2 ($t=k$)	☒	☐	☒	☒	☐	$0.6xIn \le I_2 \le 10xIn$ step 0.1xIn	Min, $0.05s \le t_2 \le 0.4s$, step 0.01s $0.10s \le t_{2start\text{-}up} \le 1.5s$, step 0.01s $0.04s \le t_{2sel} \le 0.40s$, step 0.005s	± 7%, $I_f \le 6$ In ± 10%, $I_f > 6$ In	The best of the two data ± 10% or 40 ms
D ($t=k$)	☒	☐	☒	☒	☐	$0.6xIn \le I_7 \le 10xIn$ step 0.1xIn	$0.20s \le t_7 \le 0.4s$, step 0.01s $0.10s \le t_{7start\text{-}up} \le 1.5s$, step 0.01s $0.13s \le t_{7sel} \le 0.50s$, step 0.01s	± 10%	The best of the two data ± 10% or 40 ms
I ($t=k$)	☒	☐	☐	☒	☐	$1.5xIn \le I_3 \le 15xIn$ step 0.1xIn	≤ 30 ms	± 10%	
G (4) ($t=k$)	☒	☒	☒	☒	☐	$0.20xIn \le I_4 \le 1xIn$ (5) step 0.02xIn	For I> I4 $0.1s \le t_4 \le 0.4s$, step 0.05s $0.2s \le t_{4start\text{-}up} \le 1s$, step 0.02s $0.04s \le t_{4sel} \le 0.2s$, step 0.01s	± 7%	The best of the two data ± 10% or 40 ms
G (4) ($t=k/I^2$)	☒	☒	☐	☐	☐	$0.2xIn \le I_4 \le 1xIn$ (5) step 0.02xIn	$0.1s \le t_4 \le 0.4s$, step 0.05s @I= $4xI_4$	± 7%	± 15%
Gext ($t=k$)	☒	☒	☒	☒	☐	$0.2xIn \le I_4 \le 1xIn$ (5) step 0.02xIn	$0.1s \le t_4 \le 0.4s$, step 0.05s $0.2s \le t_{4start\text{-}up} \le 1s$, step 0.02s $0.04s \le t_{4sel} \le 0.2s$, step 0.01s	± 7%	The best of the two data ± 10% or 40 ms
Gext ($t=k/I^2$)	☒	☒	☐	☐	☐	$0.2xIn \le I_4 \le 1xIn$ (5) step 0.02xIn	$0.1s \le t_4 \le 0.4s$, step 0.05s @I= $4xI_4$	± 7%	± 15%
U ($t=k$)	☒	☒	☐	☐	☐	$5\% \le I_6 \le 90\%$ step 5%	$0.5s \le t_6 \le 60s$, step 0.5s	± 10%	The best of the two data ± 10% or 40 ms
OT (temp=k)	☐	☒	☐	☐	☐	fixed, defined by SACE	Instantaneous	± 1°C	_____
Iinst	☐	☐	☐	☐	☐	Automatic, defined by SACE	Instantaneous	± 5%	+1mS
UV ($t=k$)	☒	☒	☐	☐	☐	$0.5xUn \le U \le 0.95xUn$ step 0.01xUn	$0.1s \le t_8 \le 5s$, step 0.1s	± 5%	± 20%
OV ($t=k$)	☒	☒	☐	☐	☐	$1.05xUn \le I_9 \le 1.2xUn$ step 0.01xUn	$0.1s \le t_9 \le 5s$, step 0.1s	± 5%	The best of the two data ± 10% or 40 ms
RV ($t=k$)	☒	☒	☐	☐	☐	$0.1xUn \le I_{10} \le 0.4xUn$ step 0.05 Un	$0.5s \le t_{10} \le 30s$, step 0.5s	± 5%	The best of the two data ± 10% or 40 ms
RP ($t=k$)	☒	☒	☐	☐	☐	$-0.3xPn \le P_{11} \le -0.1xPn$ step 0.02 Pn	$0.5s \le t_{11} \le 25s$, step 0.1s	± 10%	The best of the two data ± 10% or 40 ms
UF	☒	☒	☐	☐	☐	$0.9fn \le f \le 0.99fn$ step 0.01 fn	$0.5s \le t_{12} \le 3s$, step 0.1s	± 5%	The best of the two data ± 10% or 40 ms
OF	☒	☒	☐	☐	☐	$1.01fn \le f \le 1.1fn$ step 0.01 fn	$0.5s \le t_{13} \le 3s$, step 0.1s	± 5%	The best of the two data

Protection	Disabling	Disabling of TRIP only	Zone selectivity	Start-up threshold	Thermal memory	Threshold Range	Time Range	Threshold tolerance (2)	Time tolerance (2)
Load control LC1/LC2	☒	☐	☐	☐	☐	50%÷100% step 0.05xI_1			
Warning Iw	☒	☐	☐	☐	☐	0.30÷3.00% step 0.05xI_0			± 10% or 40 ms

(1) The minimum value of this trip is 1s regardless of the type of curve set (self-protection).

(2) These tolerances are based on the following assumptions:
- self-powered relay at full power (without start-up)
- presence of auxiliary power supply
- two-phase or three-phase power supply
- Preset trip time ≥ 100ms

(3) no-trip time

(4) the protection G is disabled for current values greater than 4In, where I4 < 0.5 In, greater than 6 In, where 0.5 In ≤ I4 < 0.8 In and greater than 8 In where I4≥ 0.8 In.

5) ABB meets all the NEC standards, guaranteeing that the maximum earth fault current (I4) selectable does not exceed 1200A. The allowable adjustment range for the threshold I4 is reduced automatically, depending on the type of circuit breaker selected, so as to fulfil the following condition: I4xIn=1200A.

For all cases not covered by the above hypotheses, the following tolerance values apply:

Protections	Trip threshold	Trip time
L	Release between 1.05 and 1.25 x I1	± 20%
S	± 10%	± 20%
I	± 15%	≤ 60ms
G	± 10%	± 20%
Others		± 20%

14.2.9.15 Table of measurements

Type of measurement	Tolerance	
	Range	%
Phase and neutral currents	0.3 ... 6 In	1.5
Internal ground fault current (internal source ground return)	0.3 ... 4 In	1.5
External ground fault current (external source ground return)	0.3 ... 4 In	1.5
Phase-to-phase and phase voltages (measured at the module's input and thus independent of the precision relating to the use of any VT)	$50V_{phase\text{-}to\text{-}phase}$ ... $1.1x690V_{phase\text{-}to\text{-}phase}$	1
Residual voltage (for systems with neutral only)	$50V_{phase\text{-}to\text{-}phase}$ ... $1.1x690V_{phase\text{-}to\text{-}phase}$	1
Peak factor	0.3 ... 6In	1.5
Total power factor	0.5 ... 1	2.5
Mains frequency	35 ... 80Hz	± 0.2
Instantaneous active power on the single phase and total system	0.3 ... 6 Pn	2.5
Instantaneous reactive power on the single phase and total system	0.3 ... 6 Pn	2.5
Instantaneous apparent power on the single phase and total system	0.3 ... 6 Pn	2.5
Active energy	0.3 ... 6 Pn	2.5
Reactive energy	0.3 ... 6 Pn	2.5
Apparent energy	0.3 ... 6 Pn	2.5

14.2.10 Trip curves

The trip curves provided are merely for guidance and only show a sub-group of the possible selections (see par. 14.5.2).

14.2.10.1 Trip curves for functions L-S(t=k/I²)-I

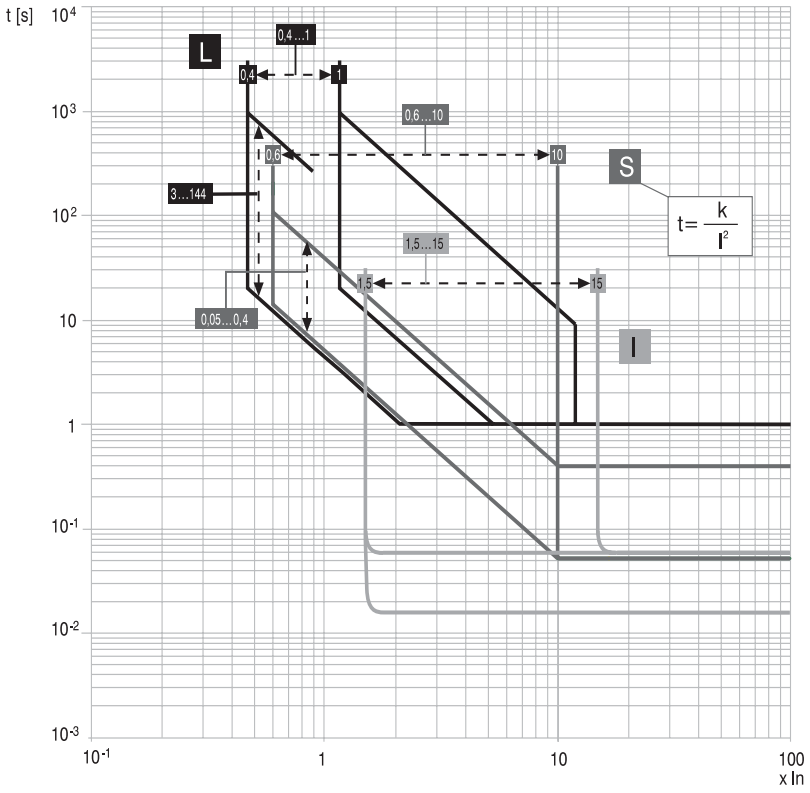

14.2.10.2 Trip curves for functions L-S(t=k)-I

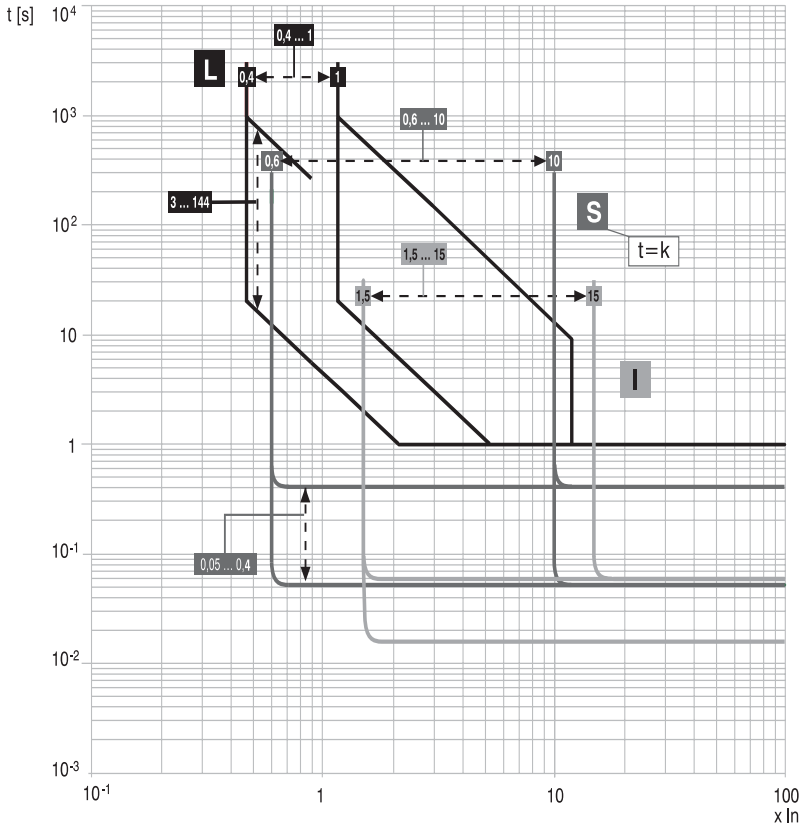

14.2.10.3 Trip curves for functions G

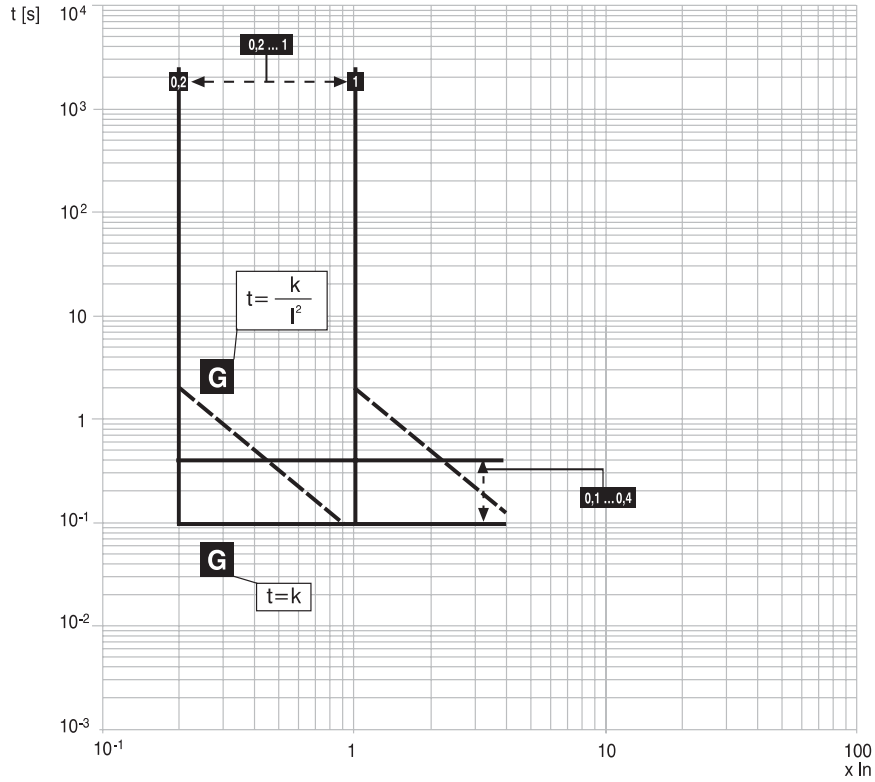

14.2.10.4 Trip curves for functions D

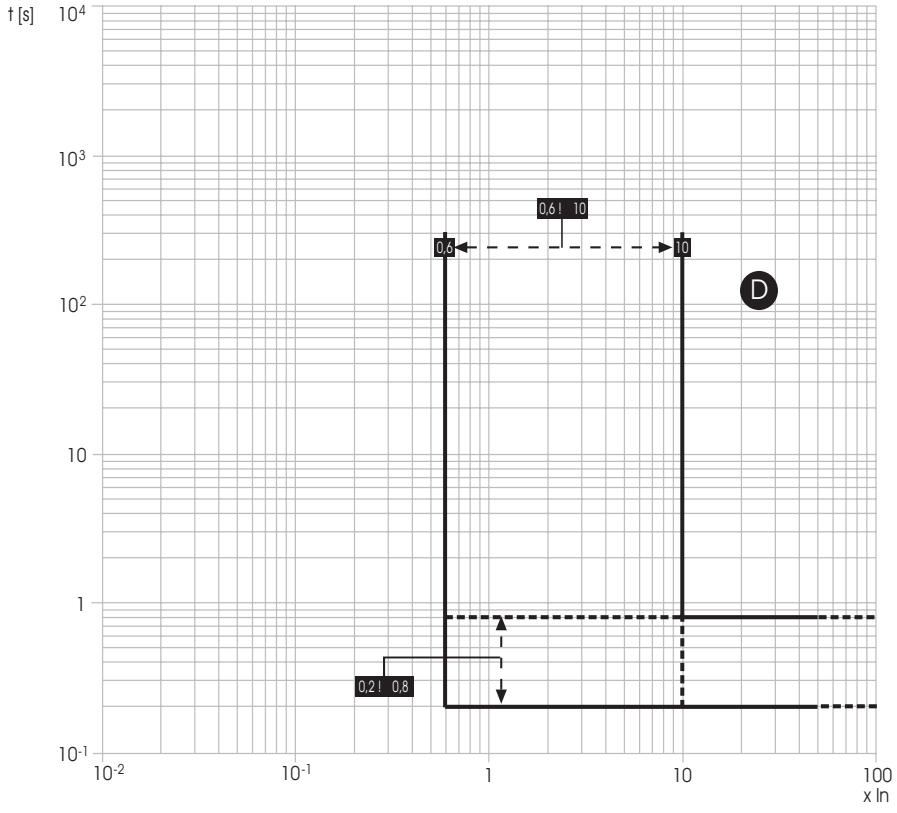

14.2.10.5 Trip curves for functions U

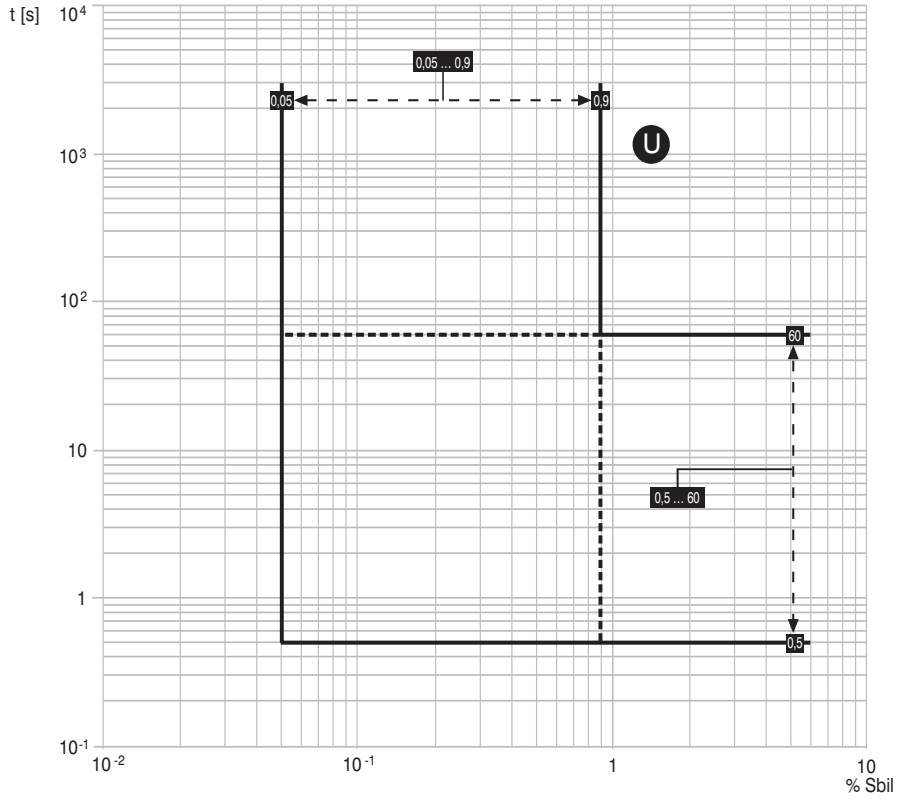

14.2.10.6 Trip curves for functions UV

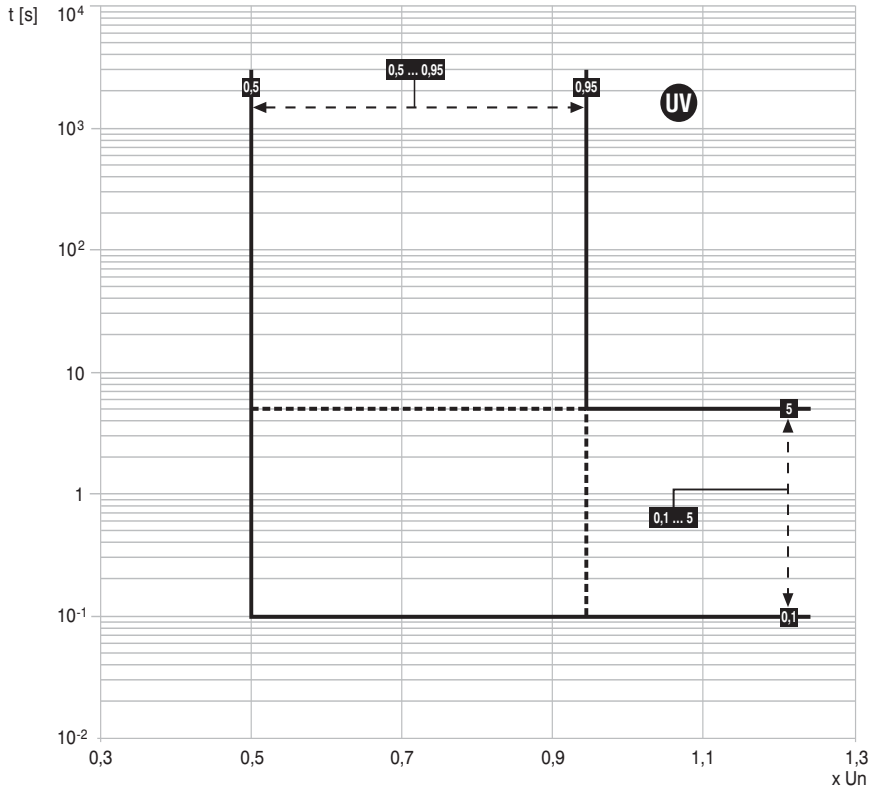

14.2.10.7 Trip curves for functions OV

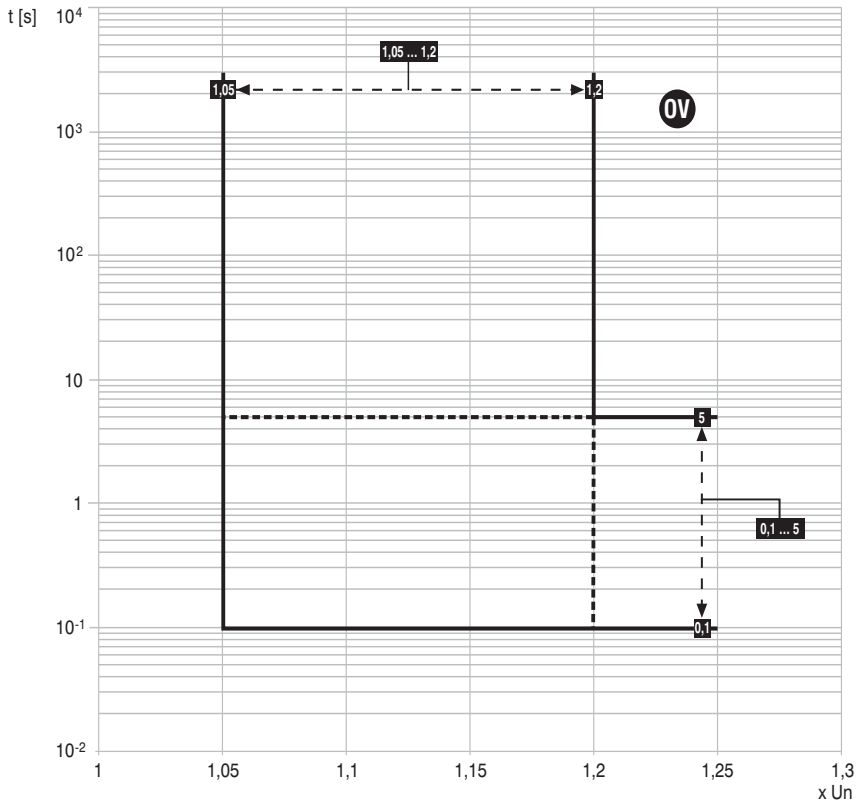

14.2.10.8 Trip curves for functions RV

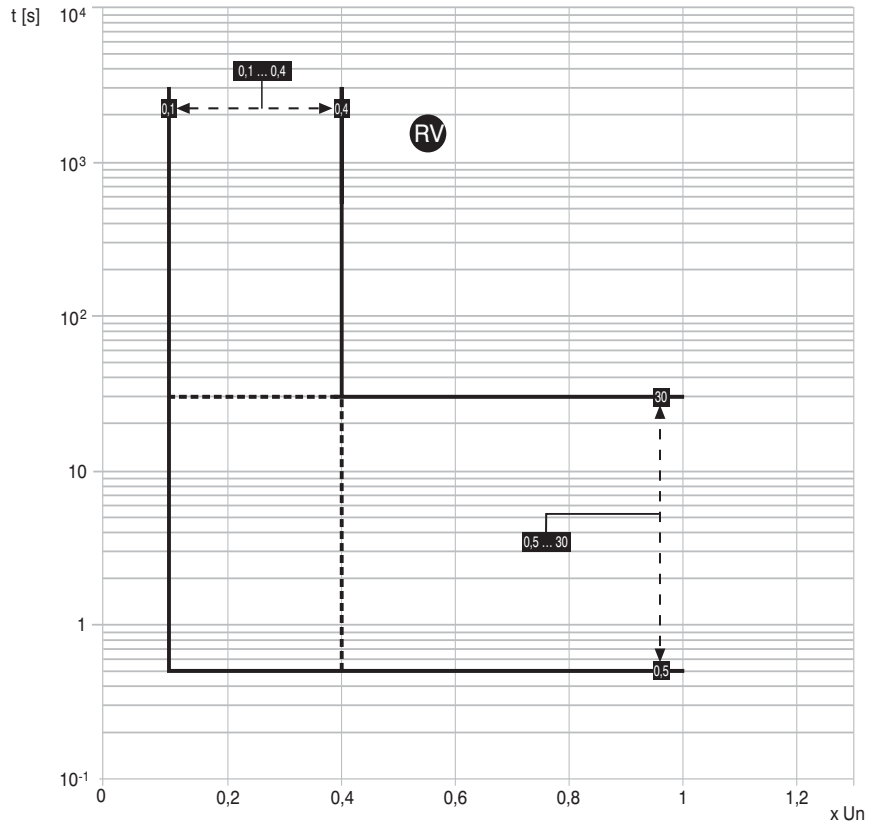

14.2.10.9 Trip curves for functions RP

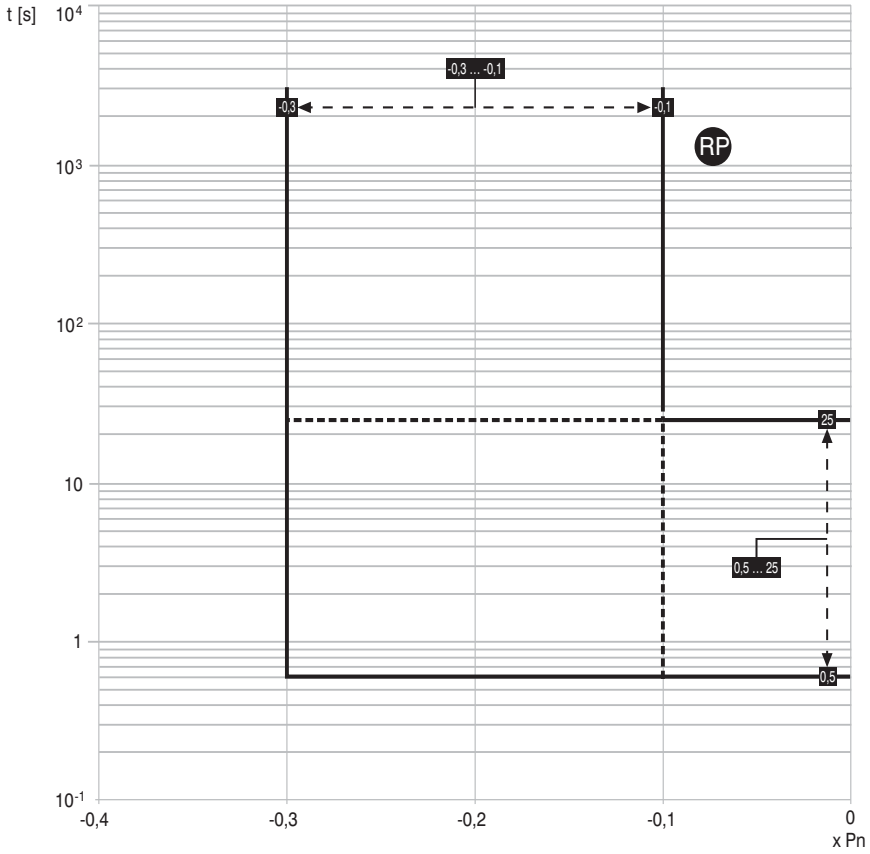

14.3.1 Connections

For the connections provided by the user, it is recommended that you comply strictly with the recommendations contained in this document. This will enable us to satisfy all the international reference standards and guarantee perfect operation of the relay even under severe environmental and electromagnetic conditions.
Pay particular attention to the types of cable, the connections to earth and the recommended maximum distances.

The maximum length of the VT - PR120/V wiring must not exceed 15 meters.
Use corded shielded two-wire cable (see note A to par. 11.2.2).
The shield must be connected to earth on both sides.

Use VTs with a shield, connected to earth (see standard VT par. 14.3.2).
The VTs should only be used for voltages > 690V; for lower voltages the presence of the PR120/V module connected to the lower or higher busbars will be sufficient. If VTs are present, you must set voltage transformers data in "present" and regulate line to line primary and secondary voltage of VT.

14.3.1.1 Current sensor connection for external neutral

If you want to connect the current sensor for the external neutral conductor to a three-pole circuit breaker, remember to set I_nN accordingly. During this procedure, the circuit breaker must be open and preferably isolated.

14.3.2 VT connections

Dielectric strength tests are not allowed on the inputs and outputs of the releases or on the secondary lines of any connected VTs.

The following is a summary table of standard VT connections according to the type of plant.

VT Standard: Single standard transformers, see par. 15.1.7.
The VTs must have a performance coming between the values of 10 and 20 VA inclusive, 4 kV insulation between the primary and secondary.

Installation system	"VT Standard" type transformer (Star/Star)	"VT Standard" type transformer (Delta/Delta)
	Application diagram	Application diagram
TN-C	**B**	**A**
TN-S	**B**	**A**
IT with neutral	**B**	**A**
IT	**n.c**	**A**
TT with neutral	**B**	**A**
TT without neutral	**n.c**	**A**

Note:
- for TN-C systems the connection must be made to PEN
- for TN-S systems the connection must be made to N for configurations with neutral or PE for configurations without neutral; if the PE is used, the current thereon could be around a dozen mA. If a customer considers this value too high or has a residual current protection which risks being tripped, then application diagram A must be used
- for IT and TT systems with neutral, the connection must be made to N

Application diagram A

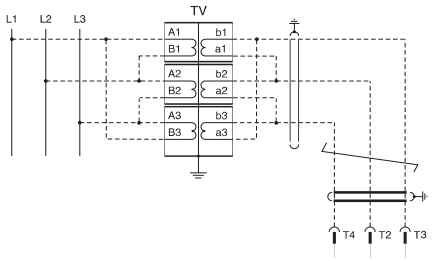

Application diagram B

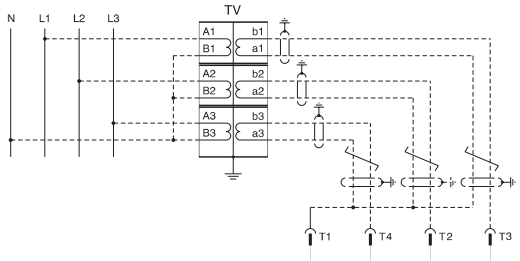

14.3.3 CS and TC connection check

If the PR123/P was installed by the user, before closing the CB, it is important to check the last line on the display when the relay is first turned on using the PR030/B battery unit. No CS and/or TC disconnected messages must appear; if they do, do not close the circuit-breaker immediately and make the correct connections.

14.3.4 Test

Before putting into service, a test can be conducted by means of the specific "Auto test" function which can be activated on the PR123/P. A positive result is shown on the display.
Then a test can be conducted on the whole TC chain, again using the specific function (Trip test). A positive outcome is shown by the circuit-breaker opening.
Check the open or closed state of the circuit-breaker on the same "PR123/P Test" screen, by checking "CB Status".

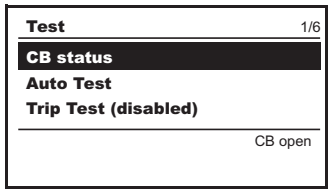

14.3.5 Initial settings

If the PR123/P is supplied ready installed in the circuit-breaker, it is up to ABB SACE to set all the variables referring to the circuit-breaker or the specific application correctly (e.g. type of circuit breaker, Rating Plug size, mains frequency ...). With PR120/V it's necessary to set properly the rated voltage.
Vice versa, if the PR123/P is supplied separately, it will be up to the user to set all the necessary parameters correctly.
Note that ABB SACE defines each possible setting according the content of the paragraph on the default parameters (see par. 14.4.4).

Apart from this, it is absolutely indispensable for the user to modify the password and carefully define each modifiable parameter, before putting the PR123/P into service.

14.3.6 Password management

Specify a password? [0*]**

To enter "EDIT" mode it is necessary to enter a four-figure numerical password. The values attributable to the password go from 0000 to 9999. For the default password see par.14.4.4.
Select the value of the first figure (between '0' and '9') by means of the ↑ and ↓ keys and press ↵ to confirm the figure and then move on to enter the next one.
After entering the fourth figure, check the password you have entered. If the password is correct, you go from the "READ" state to the "EDIT" state.

If the password is wrong, the message

Wrong password

appears and remains until the **ESC** key is pressed (or until an interval of 5 seconds has elapsed).

It is also possible to interrupt the password entry procedure by pressing the **ESC** key.

The password is valid for a maximum of two minutes from the last time a key was pressed. It is immediately reset in the case of a high priority alarm or when the unit is reset.

On entering a page with no modifiable parameters, the state of the protection is put on "READ". If the password is still valid, to enter "EDIT" mode (on a page with modifiable parameters) simply press the ↵ key.

Disabling the Password.
By setting the value of the password to [0000] (on the "Unit configuration" menu) the password prompt is disabled. It is therefore always possible to switch from "READ" to "EDIT".

To enter a new password, select the "New Password" item on the "Settings/System" menu.

14.3.7 Replacing an electronic release

14.3.7.1 Installation

To complete the procedure for installing a PR123/P unit, follow the steps below:

1. With the circuit breaker open and preferably isolated, install the protection unit on the circuit breaker
2. Power the unit ONLY from the PR030/B
3. If there are no other errors, the display will show the message Configuration (configuration error) accompanied by the yellow led coming on permanently (warning)
4. Enter the unit's "*Settings*" menu
5. Select "*Circuit breaker*"
6. Select "*Unit installation*"
7. Input the password
8. Select "*Install*" and press "*ENTER*"
9. When the red led flashes on and off and the message Installation (installation error) is displayed, remove the PR030/B
10. Power the relay from any other source

Check for the absence of configuration errors.

14.3.7.2 Uninstalling

To complete the procedure for uninstalling a PR123/P unit, follow the steps below:

1. With the circuit breaker open and/or isolated power the unit from the PR030/B
2. Enter the unit's "*Settings*" menu
3. Select "*Circuit breaker*"
4. Select "*Unit installation*"
5. Input the password
6. Select "*Uninstall*" and press "*ENTER*"
7. If there are no error messages, remove the PR030/B
8. Remove the PR123/P unit from the circuit breaker
9. To remove the TC connector, proceed as indicated in the figure alongside.

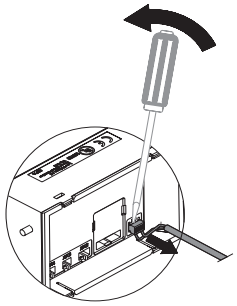

It is strongly advised to complete the uninstalling procedure, because this enables the parameters relating to the circuit breaker, such as contact wear and others, to be saved in the "*KEY PLUG*", otherwise these data would be lost. The data in question are then transmitted to the new PR123/P unit installed on the same circuit breaker.

14.4 User interface

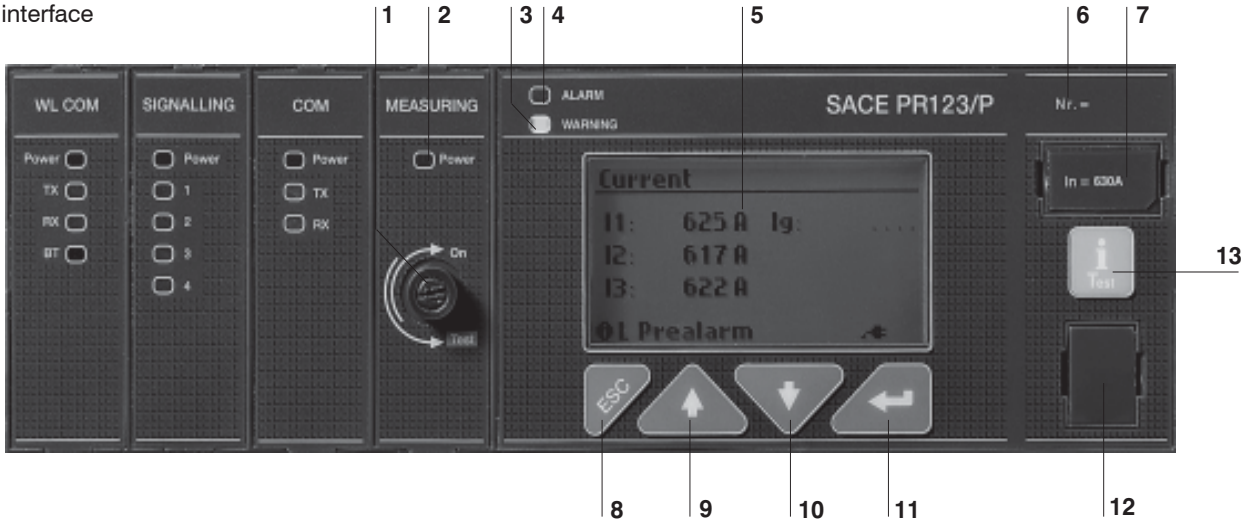

Ref.	Description
1	Voltage takeoff isolator
2	Busbar voltage LED
3	Pre-alarm indicator LED
4	Alarm indicator LED
5	Graphic display (the word ABB in the bottom left-hand corner indicates normal operation)
6	Serial number of the PR123/P
7	Rating plug
8	Pushbutton for exiting the sub-menus or for canceling (ESC)
9	Button for the cursor (UP)
10	Button for the cursor (DOWN)
11	ENTER key for confirming the data or changing the page
12	TEST connector for connecting or testing the release by means of an external device (PR030/B battery unit, BT030 wireless communication unit and PR010/T test unit)
13	"i Test" test and info button

Description of icons that appear on the display

Icon	Description
	Remote control
	Dual setting of protection activated and indication of the active set
	Fix icon shows Datalogger activated blink icon shows trigger verified
	Vaux is present
	Change settings

The Graphic Display is of the LCD type with 128x64 pixels and it is backlit when there is an auxiliary voltage or a self-supply from a PR120/V module. The display is always lit when there is a Vaux or, in self-supply mode with a minimum busbar current or powered from the PR120/V module as defined in par. 14.2.2.1
You can adjust the contrast on the display by means of the specific function available on the user interface settings menu (par. 14.5.4.1).

14.4.1 Use of pushbuttons

The modifiable fields can be filled in using the ↑ or ↓ keys and confirming with the ↵ key. Once you have entered the page you need, you can move from one value to another by using ↑ or ↓ keys. To change a value, position the cursor over the value (the modifiable field will appear in reverse, i.e. white on a black background), and use the ↵ key.

To confirm the programming of the previously configured parameters, press the **ESC** key once only. A check will be carried out on the parameters entered and then the programming confirmation page will be displayed. To return to the main menu, press the **ESC** key twice.

The "**i Test**" key must be used to perform the Trip test to view the information page and to see the last trip within 48 hours of the CB opening in self-supply mode.

14.4.2 Read and Edit modes

The menus map (see par. 14.5.1) shows all the pages which can be obtained and how to move between them from the keyboard, in the "READ" mode (just to read the data) or in the "EDIT" mode (to set the parameters).

Starting from any page displayed, two different functions can be obtained according to the state of the unit:

1. "READ": the default page will be displayed automatically after about 120 seconds (see par. 14.5.1).

2. "EDIT": the default page will be displayed automatically after about 120 seconds.

The allowable functions depending on the state are:

"READ":

- ✓ Consultation of the measurements and of the historical data
- ✓ Consultation of the unit configuration parameters
- ✓ Consultation of the protection parameters

"EDIT":

- ✓ Everything allowed in READ mode
- ✓ Configuration of the unit
- ✓ Programming of the parameters relative to the protections
- ✓ TEST Functions of the unit

To access the "EDIT" mode, it is necessary to press the ↵ key on a page with fields which can be edited. A password will then be required to enable you to switch to the editing mode.

The use of the keys is summarized in the following table:

Key	Function
	Move between pages Move within menu Change parameter values
	End setting phase and confirm result Choose menu item
	Access to surfing menus from the default pages Return to previous level when surfing within the menus, until you return to the default pages Exit the parameter changing phase, aborting the change
	This key is used to re-enable the display after it has gone off within 48 hours of the opening of the circuit breaker in self-supply mode. Can be used jointly with the other keys for special combinations that enable access to reserved pages.

14.4.3 Changing parameters

Moving within the Main Menu you can reach al the pages relating to the configurations and parameter settings with the opportunity to change the values specified for the parameters.

After any programming, you need to Confirm/Cancel/Change any changes you have made. This procedure is not applicable to all the programming activities.

Two examples are provided below: one concerns the case in which no confirmation is needed for the changes you have made, while in the other a confirmation window appears.

Procedure not requiring the confirmation of any programming

For instance, to set the System Date, the correct sequence is as follows:

Press ESC to access the Main Menu.

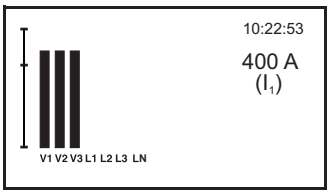

From the Main Menu, select SETTINGS

press the ↵ key (enter)

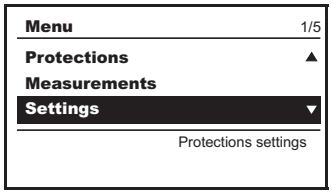

Select SYSTEM

press the ↵ key (enter)

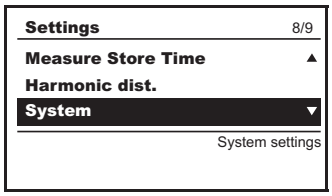

Select the menu item DATE to change

press the ↵ key (enter)

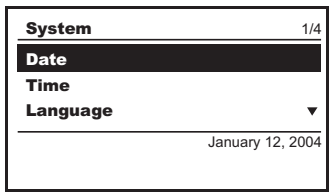

You will be prompted to input a Password
complete the password entry procedure (par.14.3.6)

press the ↵ key (enter)

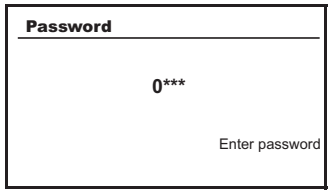

Change the date using the ↓ keys (arrow down)

↑ (arrow up) and confirm by pressing the ↵ key (enter).

Press ESC twice to return to the Main Menu.

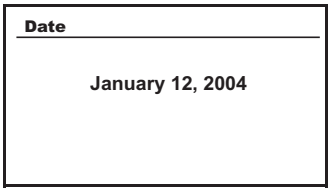

Procedure requiring the confirmation of any programming

For instance, to change the Curve of the Protection L, the correct sequence is as follows:

Press ESC to access the Main Menu.

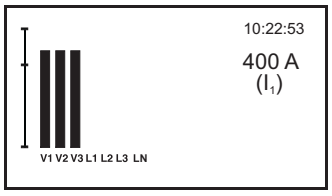

From the Main Menu select the item PROTECTIONS

press the ↵ key (enter)

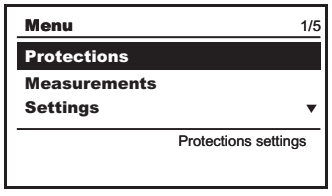

From the Protections Menu select the item PROTECTION L

press the ↵ key (enter)

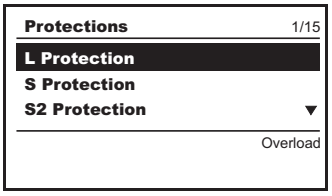

From the Protection L Menu select the item CURVE

press the ↵ key (enter)

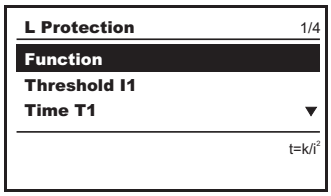

You will be prompted to input a Password

complete the password entry procedure (par.14.3.6)

press the ↵ key (enter)

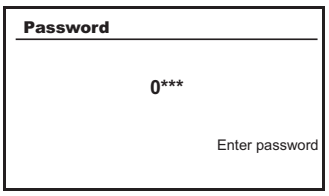

Select the value you want from the list
and confirm pressing the ↵ key (enter).

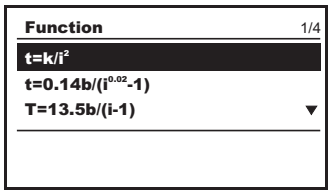

Press ESC twice

Before accessing the Main Menu, the following box will appear:

Accept the new configuration
Reject the new configuration (the previous configuration is retained)
Change the previously input values.

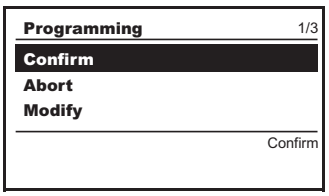

To select the required option use the ↓ (arrow down), ↑ (arrow up) keys, and press ↵ (enter) to confirm.

14.4.3.1 Modification of basic configuration

No parameter settings can be made if the PR123/P unit is in alarm conditions.

The configuration of the unit must be done in EDIT mode.

Following the instructions given in par. 14.4.3, view the following on the display:

Change system date
Change system time
Select system language

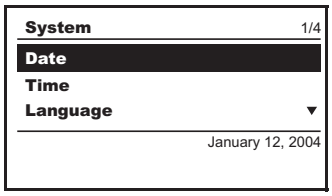

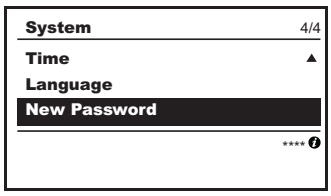

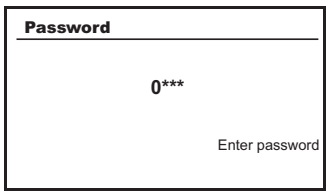

To change the system password, select the relevant menu item and press ↵ (enter); then you will be prompted to enter the OLD password, and afterwards you can input the new one twice.
Press ESC twice to return to the Main Menu

Before accessing the Main Menu, the following box will appear:

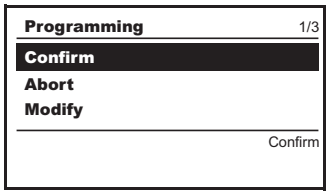

Accept the new configuration
Reject the new configuration (the previous configuration is retained)
Change the previously input values.

Note: for setting system language you must check:
• the relay is set in locally control
• the circuit breaker is open
• Vaux or PR120/V supplied or PR030/B is present
If one of the above conditions is not respected, it's not possible to change the language.

14.4.4 Default settings

The PR123/P is supplied by ABB SACE with the following predefined parameters (Set A and Set B):

#	Protection	On/Off	Thresholds	Time	Curve	T.M.	ZS	Trip
1	**L**	–	1 In	144 s	I^2t	Off	–	–
2	**S**	Off	6 In	50 ms	K	–	Off: 0.04s	–
3	**D**	Off	6 In	0.2s-0.2s			Off: 0.13s	
4	**I**	On	4 In	–	–	–	–	–
5	**G**	Off	0.2 In	0.4 s	K	–	Off: 0.04s	On
6	**U**	Off	50 %	5 s				Off
7	**OT**	–						Off
8	**K LC1**	Off	50 % I_1					
9	**K LC2**	Off	75 % I_1					
10	**UV**	Off	0.9 Un	5 s				Off
11	**OV**	Off	1.05 Un	5 s				Off
12	**RV**	Off	0.15 Un	15 s				Off
13	**RP**	Off	- 0.1 Pn	10 s				Off
14	**UF**	Off	0.9 Fn	3 s				Off
15	**OF**	Off	1.1 Fn	3 s				Off
16	**Language**	–	Engl					
17	**Net Frequency**	–	50 Hz					
18	**PR021/K**	Off						
19	**Neutral sel.**	–	*					
20	**Toroid Selec.**	–	None					
21	**Ext. ground tor.**	Off	100 A					
22	**Rated Voltage**	–	380V					
23	**S startup**	Off	6 In	100 ms				
24	**I startup**	Off	4 In	100 ms				
25	**G startup**	Off	1 In	100 ms				
26	**Password**	–	0001					
27	**Measuring interval**	–	60 $\overline{\text{min}}$					
28	**Iw**	Off	3 In					
29	**Harmonic dist. warning**	Off						
30	**Power direction**	–	top → bottom					

*= OFF for three-pole versions

*= 50% for four-pole versions

*= 100% for full-size versions

14.5.1 Menu

As seen previously, the PR123/P uses the display to show messages, diagrams and menus. These are organized in a logical and intuitive way. The following is a general layout showing how to access the main menu pages.

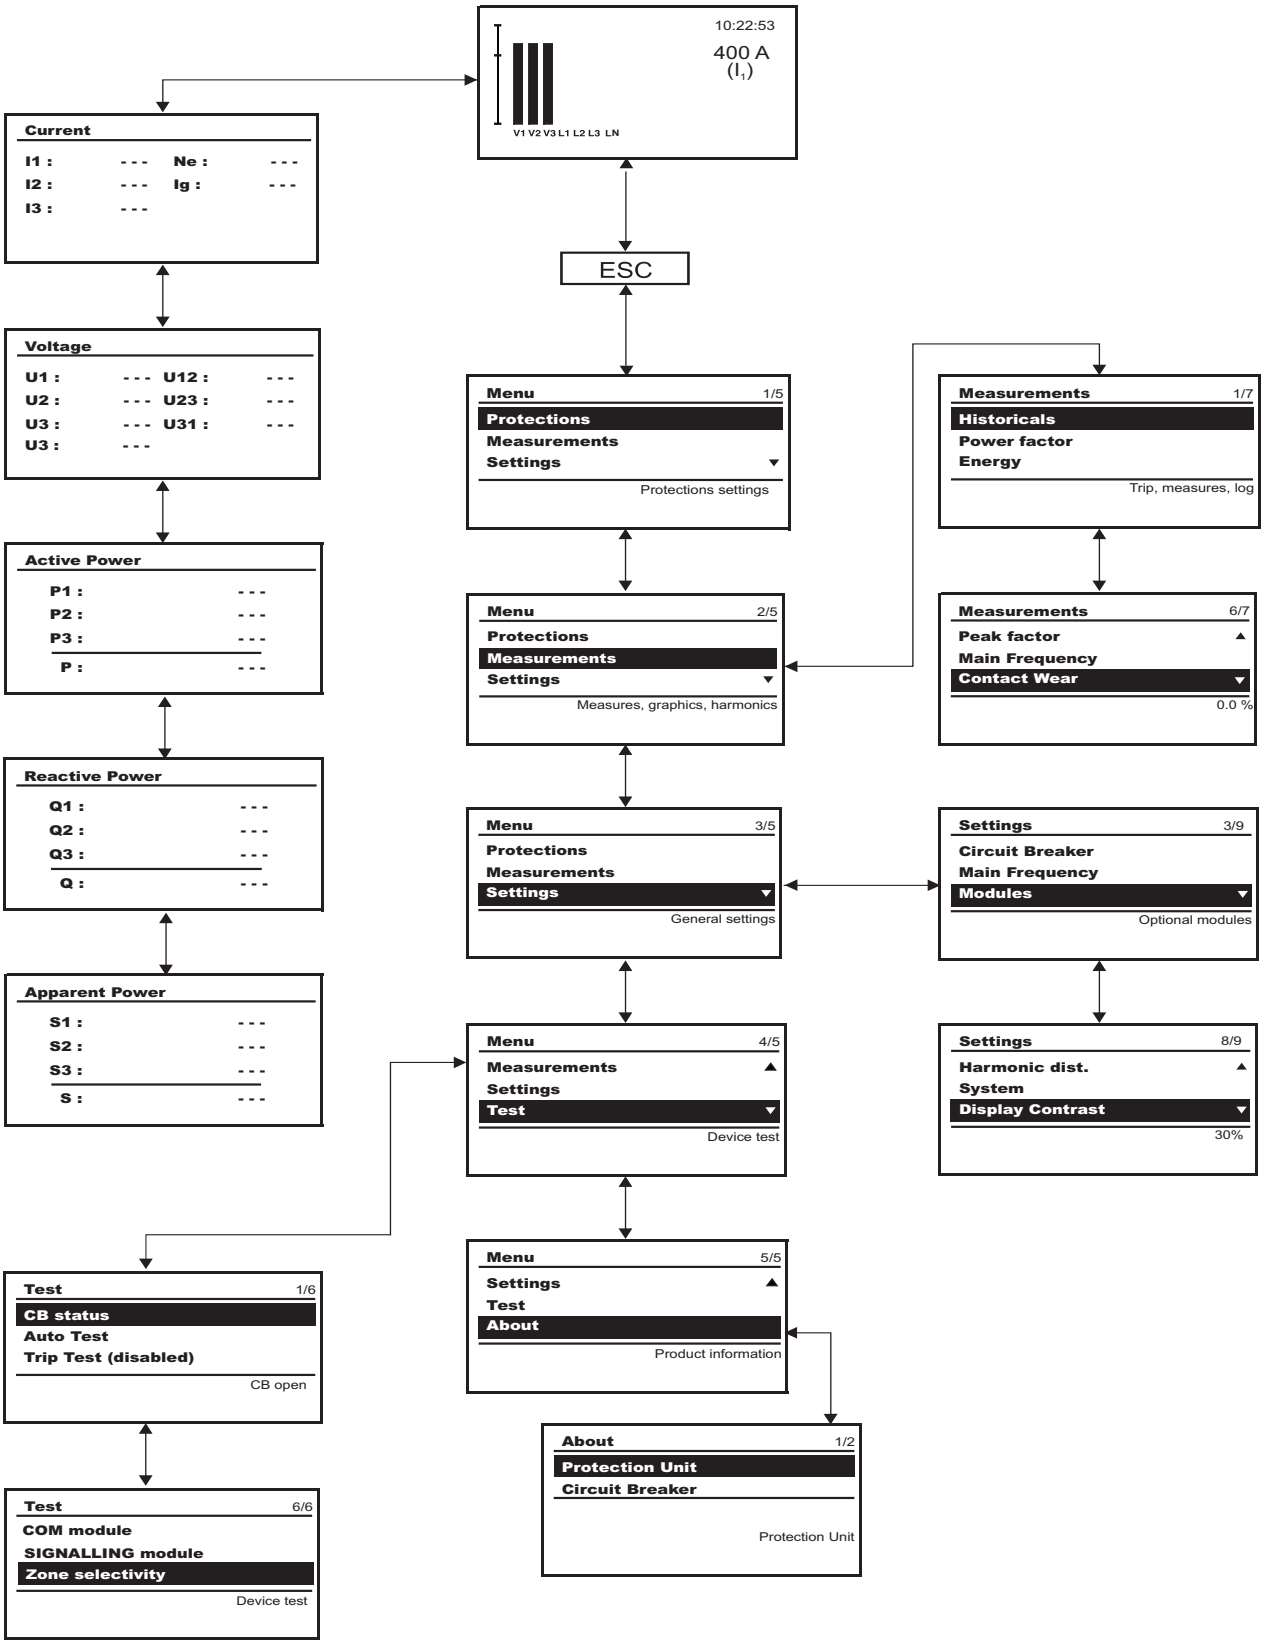

Each time the unit is turned on, or after more than 2 minutes of inactivity on the keyboard, the display indicates the following page (default):

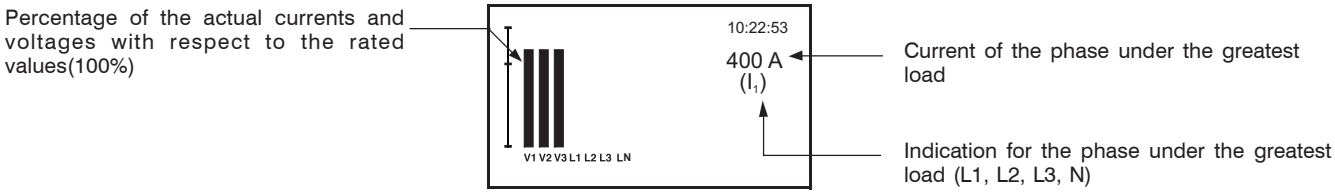
Percentage of the actual currents and voltages with respect to the rated values(100%)
10:22:53
400 A
(I1)
V1 V2 V3 L1 L2 L3 LN
Current of the phase under the greatest load
Indication for the phase under the greatest load (L1, L2, L3, N)

14.5.2 Protections menu

From the interface you can press ENTER to access the menu of the various protections available on the display

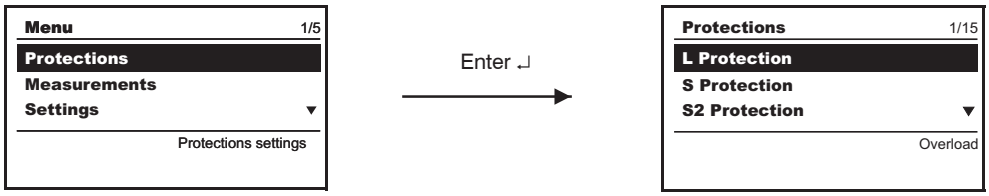

Using the "arrow UP" and "arrow DOWN" you can view the various protections.
On the whole, the data that you can display concern the protections: L, S, S2, D, I, G, U, UV, OV, RV, RP, UF,OF,T, LOAD PROTECTION.

Example of surfing the Protections menu

From the Protection main page you can press ENTER to go to the Protection L Menu.
You can use "arrow UP" and "arrow DOWN" to select the items on the menu and confirm by pressing ENTER. Pressing this key triggers a Password prompt, then you can select the functions associated with the protection L (as in the example)

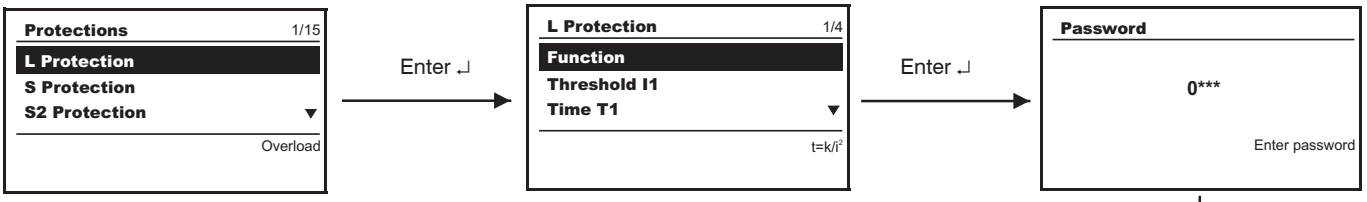

Example of how to select the curve $t=k/i^2$

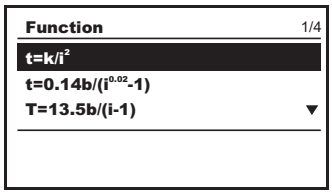

Similarly, to access the menus for the other protections, see the Protections Menu table below.

14.5.2.1 Protections menu table

Protection	Parameter / Function	
L	Curve	
	Threshold I1	
	Time t1	
	Thermal memory	ON / OFF
S	Enable	ON / OFF
	Curve	
	Threshold I2	
	Time t2	
	Zone selectivity	ON / OFF
	Selectivity time	

Protection	Parameter / Function	
	Enable StartUp	ON / OFF
	StartUp threshold	
	StartUp time	
S2	Enable	ON / OFF
	Threshold I2	
	Time t2	
	Zone selectivity	ON / OFF
	Selectivity time	
	Enable StartUp	ON / OFF
	StartUp threshold	
	StartUp time	
D	Enable	ON / OFF
	Threshold I7	
	Time t7 Fw	
	Time t7 Bw	
	Zone selectivity	ON / OFF
	Selectivity time	
	Enable StartUp	ON / OFF
	StartUp threshold	
	StartUp time	
I	Enable	ON / OFF
	Threshold I3	
	Enable StartUp	ON / OFF
	StartUp threshold	
	StartUp time	
G	Enable	ON / OFF
	Curve	
	Threshold I4	
	Time t4	
	Enable Trip	ON / OFF
	Zone selectivity	ON / OFF
	Selectivity time	
	Enable StartUp	ON / OFF
	StartUp threshold	
	StartUp time	
Gext	Enable	ON / OFF
	Curve	
	Threshold I4	
	Time t4	
	Enable Trip	ON / OFF
	Zone selectivity	ON / OFF

Protection	Parameter / Function	
	Selectivity time	
	Enable StartUp	ON / OFF
	StartUp threshold	
	StartUp time	
U	Enable	ON / OFF
	ThresholdI6	
	Time t6	
	Enable Trip	ON / OFF
UV	Enable	ON / OFF
	Threshold U8	
	Time t8	
	Enable Trip	ON / OFF
OV	Enable	ON / OFF
	Threshold U9	
	Time t9	
	Enable Trip	ON / OFF
RV	Enable	ON / OFF
	Threshold U10	
	Time t10	
	Enable Trip	ON / OFF
RP	Enable	ON / OFF
	Threshold P11	
	Time t11	
	Enable Trip	ON / OFF
UF	Enable	ON / OFF
	Threshold f1	
	Time t12	
	Enable Trip	ON / OFF
OF	Enable	ON / OFF
	Threshold f2	
	Time t13	
	Enable Trip	ON / OFF
OT	Enable Trip	ON / OFF

Protection	Parameter / Function	
Load control		
	Threshold 1 Enable Threshold	ON / OFF
	Threshold 2 Enable Threshold	ON / OFF
	Threshold Iw Enable Threshold	ON / OFF

Note: for an explanation of the characteristics of the single protections and their settings and corresponding curves, see par. 14.2.9

14.5.3 Measurements Menu

For a complete description of the functions of the PR120/V module, see par. 15.1.
The following is a summary of the parameters accessible from the menu in the PR123/P unit.

14.5.3.1 Measurements Menu table

Setting	Parameter / Function	Values	Notes
Historicals			
	Trips		Last trip
	Events		Events log
	Measurements		
	I Max		Maximum active current
	P Max		Maximum active power
	P Mean		Mean active power
	U Max		Maximum voltage
	U Min		Minimum voltage
	Reset measurements		
Power factor			Cos φ measured
Energy	Energy meters Reset meters		
Peak factor			
Mains frequency		50 Hz 60Hz	Measured value
Contact wear			Percentage of wear on CB contacts
Waveforms	I1, I2, I3 N Voltage 12, 23, 31		Graph, harmonics Graph, harmonics Graph, harmonics

14.5.4 Settings Menu

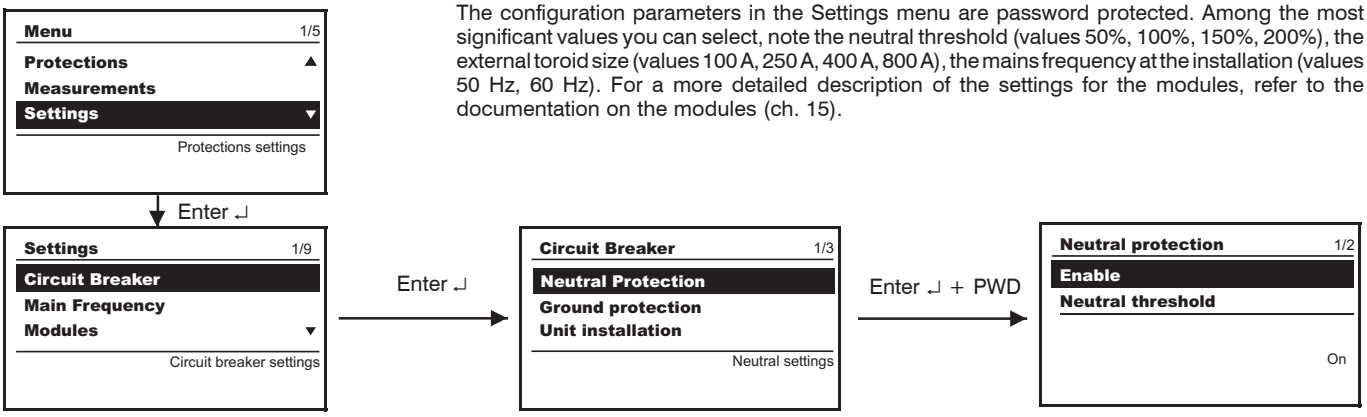

The configuration parameters in the Settings menu are password protected. Among the most significant values you can select, note the neutral threshold (values 50%, 100%, 150%, 200%), the external toroid size (values 100 A, 250 A, 400 A, 800 A), the mains frequency at the installation (values 50 Hz, 60 Hz). For a more detailed description of the settings for the modules, refer to the documentation on the modules (ch. 15).

14.5.4.1 Settings Menu table

	Parameter / Function	Values	Notes
Circuit breaker	Neutral protection		
	Enable	ON/OFF	
	Neutral threshold	50%-100%-150%-200%	
	Ground protection		Said protection is provided only in the event of an external toroid being used
	External toroid	Absent, SGR, Rc	
	Toroid size SGR		
	Toroid size Rc	Idn = 1A, 10A	
Mains frequency		50 Hz - 60Hz	
Modules	Module		
	PR120/V - Measuring	if any	see par. 14.5.4.4.1
	PR120/D-M - COM	if any	see par. 14.5.4.4.2
	PR120/K - Signalling	if any	see par. 14.5.4.4.3
	Local Bus unit	Absent - Present	
Data Logger	Enable	ON/OFF Sampling frequency Stop Event Stopping delay Reset Stop	See Annex par. 16.4
Dual setting	Enable Default setting Dual Set CB closure Dual Set with Vaux	ON/OFF SET A / SET B	
Measurement interval		from 5 to 120 min, step 5 min	
Harmonic distortion		ON/OFF	The warning indicates that the distortion exceeds factor 2.1
System	Date Time Language New password	English/Italiano/Francais/Deutsch/Español	
Display	Contrast		

The summary table relates to the surfing of the pages dedicated to the PR120/K module (see par. 15.3) and to the PR021/K unit (see par. 16.1).

14.5.4.2 Neutral adjustment

The neutral protection is normally set to a current value 50% of the adjustment made on the phases.
In some installations, where particularly high harmonics occur, the current circulating on the neutral may be higher than that of the phases.
In the SACE PR123/P release, this protection can be set for the following values: I_nN = 50% - 100% - 150% - 200% * I_n.
The values that can be used to adjust the neutral are given in the table below for the various possible combinations between types of circuit-breaker and adjustment of the threshold I_n.

14.5.4.2.1 Neutral adjustments table

Adjustment for the threshold I_1 (L protection)			
Circuit breaker size	**$I_1 \leq 0.5$**	**$0.5 < I_1 \leq 0.66$ (1)**	**$I_1 > 0.66$**
E1	50-100-150-200%	50-100-150%	50-100%
E2	50-100-150-200%	50-100-150%	50-100%
E3	50-100-150-200%	50-100-150%	50-100%
E4	50-100%	50%	50%
E4/f	50-100-150-200%	50-100-150%	50-100%
E6	50-100%	50%	50%
E6/f	50-100-150-200%	50-100-150%	50-100%

Note 1: The $I_1 = 1\ I_n$ setting is intended as the maximum adjustment of the protection against overload. The actual maximum allowable adjustment must take into account any temperature derating, the terminals used and the altitude.

Note 2: with three poles circuit breaker without external neutral you must set I_nN = OFF

Failure to comply with the setting limits for "I_n" and "I_nN" can cause circuit breaker damage with consequent risks even for the operator.

In any case, the relay records any setting error between I_1 and the Neutral setting and it signals this by means of the warning (see par. 14.6.3).

14.5.4.3 Mains frequency settings

In the Mains frequency menu, you can choose between the frequency values: 50, 60 Hz.

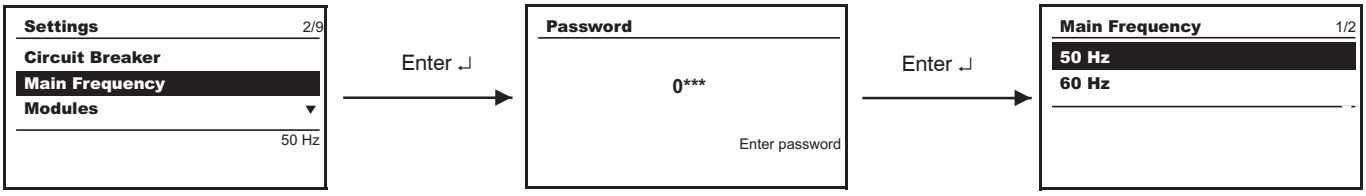

14.5.4.4 Modules

When you access the Settings menu, there is a set of menus available relating to the modules.

14.5.4.4.1 PR120/V - MEASURING module

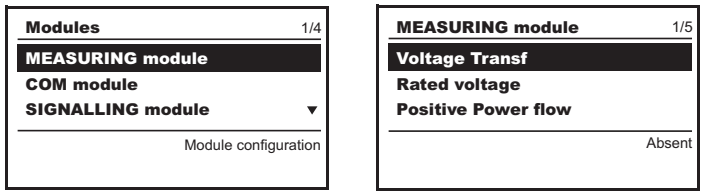

In the measuring module you must enter a password and can then opt for the absence or presence of the voltage transformer. Moreover, you can select the values of the primary line to line voltage (100, 115, 120, ... 1000V) and secondary voltage (100, 110,..,230V). The power flow can be LOW -> HIGH or HIGH-> LOW. After entering a password you can choose whether the neutral connection is to be Absent or Present. The phase sequence and cosφ signal can be enabled and disabled (ON /OFF) and the corresponding threshold values can be selected (see par. 15.1).

14.5.4.4.2 PR120/D-M COM module

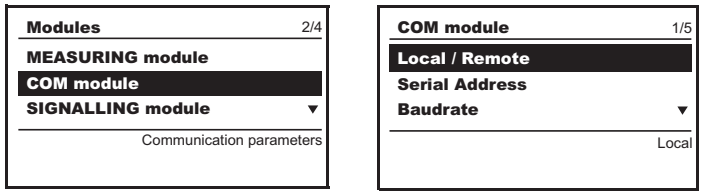

The local or remote modes can be selected after entering a password. The serial address can be displayed after entering a password. The Baud Rate can be set on the values 9600 and 19200 bit/s. The physical protocol provides for the options: (8,E,1), (8,0,1), (8,N,2), (8,N,1). The addressing can be selected as standard Modbus or ABB. For further information on the PR120/D/M communication MODULE, see paragraph 15.2 in this manual.

14.5.4.4.3 PR120/K - SIGNALLING module

For a thorough examination of the signalling module, refer to the corresponding section of the module, paragraph 15.3.

14.5.4.4.4 PR120/D- WL-COM module

This module is for wireless communication based on the Bluetooth standard between the PR123/P protection release and a hand-held PC (PDA) or a laptop with a Bluetooth port. For further information, see the description of the module in paragraph 15.4.

14.5.4.4.5 Settings for the Local Bus unit

If the PR021/K unit is connected, you need to enable the local bus by selecting present.

14.5.5 Test Menu

Access to the Test menu is password protected.

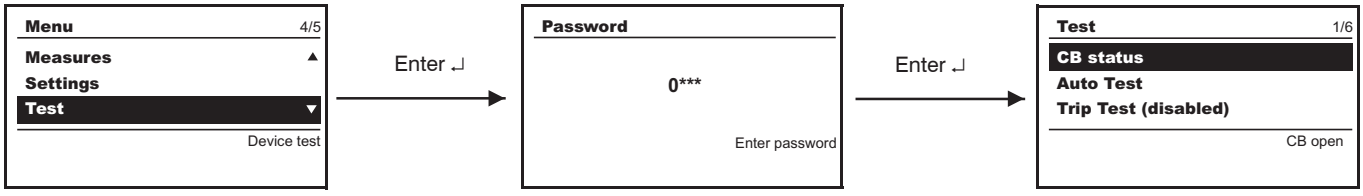

The menu shows the state of the CB, in the dialog module (COM module) the state of the springs and the position of the CB, and in this submenu you can make the CB open or close.
Using the "Trip Test" function lets you view the disabling/enabling of the Trip. If it is enabled, the circuit breaker is opened. The function is only available with a busbar current of nil (use Vaux, PR030/B or PR010/T).
On the page, only with Vaux, you can also see the state of the circuit breaker "STATUS", and thus make sure that the input is correctly wired.

The surfing path is summarized in the following table:

14.5.5.1 Test Menu table

Parameter / Function		Values
CB Status		Open/Closed Indefinite
Auto Test		Test display
Trip Test		Enabled / Disabled
PR120/D-M Module	State of springs Position of CB Open CB Close CB	Loaded / Unloaded Isolated / Withdrawn
PR120/K Module	Input Auto Test	ON ---
Zone selectivity	Protection S (status) Input Force Output Release Output	ON/OFF
	Protection G (status) Input Force Output Release Output	ON/OFF

14.5.6 Information Menu

The Information Menu enables you to view the data relating to the protection unit and the type of circuit breaker.

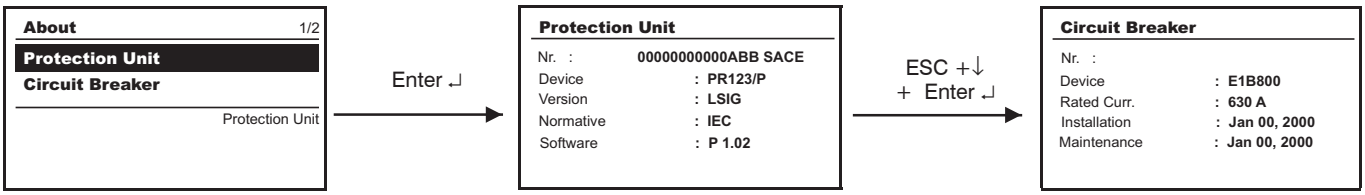

14.5.6.1 Information on the trip and opening data

The PR123/P unit saves all the information relating to the type of protection tripped, the opening data, the date and time. Using the "i Test" key makes the release show all these data directly on the display. There is no need for an auxiliary power supply for this function. With an auxiliary power supply, the information is shown immediately on the display without the need to press the "i Test" key and remains displayed indefinitely until you press the key .
The information remains available for 48 hours with the circuit breaker open or without any current flowing in the busbars. The data relating to the last 20 trips are stored in the unit's memory. By connecting a PR030/B battery unit or a BT030 wireless communication unit, you can retrieve the information relating to the last 20 trips recorded.
Access to view the opening data is via the Historicals submenu in the Measurements menu. The following is an example of the information provided:

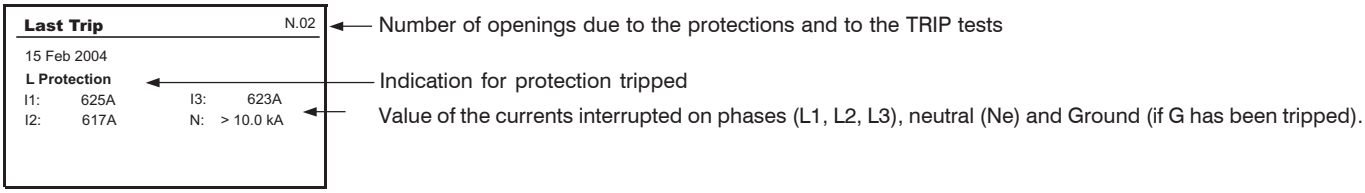
Last Trip N.02
15 Feb 2004
L Protection
I1: 625A
I2: 617A
I3: 623A
N: > 10.0 kA
Number of openings due to the protections and to the TRIP tests
Indication for protection tripped
Value of the currents interrupted on phases (L1, L2, L3), neutral (Ne) and Ground (if G has been tripped).

Again in the Measurements menu, you can view the percentage of contact wear, which is an indication of the electrical life of the electrical contacts in the circuit breaker.
In any case, functionality of the relay is in no way modified by the presence of the wear messages.
The prealarm message (wear > 80%, "warning" LED lighting up) indicates that the wear has reached a high value. The alarm message (100% wear, "alarm" LED lighting up) indicates that it is necessary to check the state of contact wear.
The percentage of wear depends on the number of openings carried out by the circuit-breaker and by the absolute current interrupted during each of them.

14.6 Definition of alarms and signals in the PR123/P unit

14.6.1 Optical signals

Signalling	Description
Warning (yellow) led	• The prealarm threshold has been exceeded; one or more phases with current values in the range $0.9xI_1 < I < 1.05xI_1$ (on the Ne it depends on the selection made; for instance, at 50% the values are halved) • Presence, between two or three phases, of unbalance above the value programmed for the "U" protection, with protection trip disabled • Presence of distorted wave form with form factor > 2.1; • Contact wear greater than 80% (and less than 100%; with Vaux only); • WARNING Threshold I_w exceeded; • Circuit-breaker state error; • Frequency out of range.
Alarm (red) led	• Presence of overload on one or more phases with current values I >1.3 I1 (timing protection “L”) (on the Ne it depends on the selection made; for instance, at 200% the values are doubled)* • Timing in progress for protection function S; • Timing in progress for protection function I; • Timing in progress for protection function G; • Timing in progress for protection function D; • Timing in progress for the voltage (UV, OV, RV), frequency (OF, UF) protection functions; • Timing in progress for the reverse active power protection function (RP); • Timing in the case of unbalance between the phases (protection U) above the value set in the configuration with protection trip set to on; • Contact wear = 100%; • Rating Plug disconnected; • Trip Coil (TC) disconnected; • Key plug error; • Current sensors disconnected.

* The IEC 60947-2 Standard defines the timing threshold L for current: 1.05 < I < 1.3 I1

14.6.2 Electrical signals

K51/p1..p4 Programmable electrical signals, if the PR120/K module or the PR021/K unit are installed and there is an auxiliary power supply. Pressing the "i Test" key enables you to reset the activated contacts.

14.6.3 Table of error and warning messages

All the messages which can be shown on the display relating to incorrect configurations, generic alarms or deriving from the protection functions and linked to useful information are described below.

The following symbols in the warning signals have the following meanings:

= warning signal / Protection in alarm mode, with no trip (trip=off)

= protection in alarm mode, with trip at end of delay (trip=on)

= Information, no action except display on the protection release

Alarm message	Description	Notes
Harmonic dist.	Harmonic distortion alarm	Busbar currents with zone factor > 2.1
Contact wear	Alarm for contact wear	Contact wear = 100%
G (TRIP OFF)	Alarm for protection G	
Gext (TRIP OFF)	Alarm for protection Gext	
T Alarm	Alarm for protection T	Temperature outside range
T (TRIP OFF)	Alarm for protection T	
U Alarm	Alarm for protection U	Protection U timing underway
UV Alarm	Alarm for protection UV	
OV Alarm	Alarm for protection OV	
RV Alarm	Alarm for protection RV	
RP Alarm	Alarm for protection RP	
UF Alarm	Alarm for protection UF	
OF Alarm	Alarm for protection OF	
LC1 Load	Alarm for load control LC1	
LC2 Load	Alarm for load control LC2	
L1 Sensor	Alarm for L1 phase current sensor	Phase L1 sensor disconnected or faulty

Alarm message	Description	Notes
L2 Sensor	Alarm for L2 phase current sensor	Phase L2 sensor disconnected or faulty
L3 Sensor	Alarm for L3 phase current sensor	Phase L3 sensor disconnected or faulty
Ne Sensor	Alarm for Ne phase current sensor	Phase Ne sensor disconnected or faulty
Gext Sensor	Alarm for Gext current sensor	Gext sensor disconnected or faulty
TC disconnected	Trip Coil disconnected or faulty	
Rating Plug	Rating Plug Error absent or faulty	
Power factor	Alarm for power factor	The power factor module is lower than the specified threshold
Phase cycle	Phase cycle inverted	
Invalid date	Clock information lost	
CB status	CB state error	Probable error in Q26 and/or Q27
Startup	Error key plug	
CB not defined	State of circuit breaker inconsistent (Open/Closed)	Probable error in Q26 and/or Q27
Local Bus	Local Bus error	See par. 14.7
Contact wear	Contact wear prealarm	Contact wear ? 80%
L prealarm	Protection L prealarm	
T prealarm	Protection T prealarm	
Frequency range	Frequency out of range	
Warning Iw	Iw threshold exceeded	
Timing L	Timing protection L	
Timing S	Timing protection S	
Timing S2	Timing protection S2	
Timing G	Timing protection G	
Timing Gext	Timing protection Gext	
Timing D	Timing protection D	
Timing U	Timing protection U	
Timing UV	Timing protection UV	
Timing OV	Timing protection OV	
Timing RV	Timing protection RV	
Timing RP	Timing protection RP	
Timing UF	Timing protection UF	
Timing OF	Timing protection OF	

14.6.4 Error messages displayed in pop-up windows

All the messages that appear on the display in a pop-up window are described below (they automatically disappear after 5 sec).

Error message	Description
Password error	
Session impossible	A programming session cannot be started due to a contingency (e.g. timing still underway)
Value outside range	Value beyond the established limits
Failed 1001/2001	Incongruence between thresholds of protections L and S (SET1/SET2)
Failed 1002/2002	Incongruence between thresholds of protections I and S (SET1/SET2)
Failed 1006/2006	Incongruence between thresholds of protections I and D (SET1/SET2)
Failed 1005/2005	Incongruence between thresholds of protections L and D (SET1/SET2)
Failed 1009/2009	Zone selectivity enabled in both protection D and S or S2 or G or Gext
Failed 1003/2003	Incongruence between thresholds of protections L and S2 (SET1/SET2)
Failed 1004/2004	Incongruence between thresholds of protections I and S2 (SET1/SET2)
Failed 1007/2007	NEC requirements not satisfied: threshold of protection G > 1200 A
Failed 1008/2008	NEC requirements not satisfied: startup threshold of protection G > 1200 A

Error message	Description
Unavailable	Function is not available
Invalid date	Date has not been set
Parameters revised	Programming session concluded correctly
Cancelled	Programming session cancelled
Failed	Programming session rejected

14.7 Troubleshooting PR123/P unit

The following table lists a series of typical service conditions, to help you understand and solve hypothetical faults or malfunctions.

Note:
1. Before consulting the following table, check for any error messages appearing for some seconds on the display.
2. FN indicates the normal operation of the PR123/P.
3. In the case where the suggestions proposed do not lead to a solution of the problem, please contact the ABB SACE assistance service.

N°	Situation	Possible causes	Suggestions
1	The trip test cannot be run	1. The busbar current is > 0 2. The TC is not connected	1. FN 2. Check the messages on the display
2	Trip times lower than expected	1. Threshold too low 2. Curve too low 3. Thermal memory enabled 4. Incorrect neutral selection 5. The SdZ is inserted	1. Correct threshold 2. Correct curve 3. Disable if not necessary 4. Correct neutral selection 5. Exclude if not necessary
3	Trip times higher than expected	1. Threshold too high 2. Curve too high 3. Curve I^2t inserted 4. Incorrect neutral selection	1. Correct threshold 2. Correct curve 3. Exclude if not necessary 4. Correct neutral selection
4	Rapid trip, with I3=Off	Iinst tripped	FN with short-circuit with high I
5	High earth I, but no trip happens	1. Incorrect selection of the sensor 2. Function G prevented with I>4In	1. Set int. or ext. sensor 2. FN
6	Display off	1. Vaux missing and the current and/or voltage are below the minimum value. 2. Temperature out of range	1. FN, see 14.2.2.1 2. FN, see 14.2.9.8
7	The display is not back-lit	Current and/or voltages below the limit for lighting the display	FN
8	Reading of I incorrect	Current below the minimum threshold that can be displayed	FN
9	Reading of V, W and power factor φ incorrect	1) Connection error between VT PR120/V 2) Voltage parameter settings error	1) Check connections between VT and and PR120/V 2) Set the correct parameters
10	"⚠ Local Bus" message on display	No communication between PR123/P and PR021/K	1. If not present, disable PR021/K, see 14.5.4.4.5 2. Check bus connection 3. Check PR021/K
11	Message "" instead of expected data	Function disabled or data out of range	FN
12	The expected trip does not occur	Trip function disabled	FN enable trip if necessary
13	No activation of the Unbalance U protection	Values of I out of range	FN, see 14.2.9.5
14	No display of the opening data	Vaux missing, the buffer capacitor is discharged	FN, see 14.5.6.1
15	The password is not requested	The password has been disabled	FN, re-enter the password with a value other than 0000.
16	Impossible to change any parameter	PR123/P in alarm situation	FN
17	"⚠ Sensor time" or "⚠ Start-up" message	Possible failure inside relay	Contact ABB Sace
18	Invalid date	1.First installation 2.Lost information for power supply lack	FN, see 14.4.3.1

19	Unexpected trip	see 14.6.3	
20	Led lighting	FN, see 13.6.1	
21	It's not possible to change the language	1. The relay is set in remote control 2. The circuit breaker is closed 3. Vaux or PR120/V supplied or PR030/B not present	1. Set the relay in local control 2. Open the circuit breaker 3. Supply the relay

14.7.1 In the case of a fault

If you suspect that the PR123/P is faulty, has a malfunction or has generated an unwanted trip, it is advisable to follow the recommendations below very carefully from the Measurements menu → Historicals → Trip:

1. Make a note of the type of protection that has tripped by accessing the LAST TRIP page if there is an external power supply (Vaux or battery) or by pressing "i Test" if in self-supply mode.
2. Note down the type of circuit-breaker, number of poles, any accessories connected, In, Serial Number (see par. 14.4) and the SW version.
3. Prepare a brief description of the opening (what led and/or warnings were on the display? when did it happen?, how many times), was it always under the same conditions? what type of load? what voltage? what current? is the event reproducible?)
4. Send/communicate all the information collected, together with the circuit diagram for the circuit-breaker, to your nearest ABB Customer Support service.

The more the information given to the ABB Customer Support service is complete and accurate, the easier the technical analysis on the problem encountered will be, enabling us to take all action to help the user without delay.

14.8 Accessories

14.8.1 ABB SACE PR010/T test and configuration unit

The test with the SACE PR010/T unit enables you to check the proper operation of the inputs, outputs, thresholds and tripping times of the protection functions "L", "S", "I", "G", OV, UV, RV, U. The test unit is wired to the relay by means of the front Test connector (see par. 14.4).

14.8.2 ABB SACE PR030/B power supply unit

The PR030/B is a momentary power supply unit to be inserted in the front test connector of the PR123/P.
Using this standard accessory, you can run an autotest, the trip test, and power the PR123/P unit whatever the state of the circuit breaker (open/closed, in the test position or enabled and without an auxiliary power supply).
The battery inside the PR030/B guarantees a power supply to the unit for about 3h continuously (depending on the operations conducted on the PR123/P and on the PR120/D-BT module).
The life of the battery diminishes if the PR030/B accessory is also used to perform the trip test and the autotest. IT is essential to use the PR030/B to read the trip data if the trip has occurred more than 48 hours earlier and the release was no longer powered.

14.8.3 BT030 wireless communication unit

The BT030 is a device for connecting to the Test connection on the PR123/P.
It enables Bluetooth communication between the protection release and a hand-held or laptop PC with a Bluetooth port.
This device is dedicated for use with the SD-Pocket application.
The BT030 has a rechargeable Li-ion battery that can provide the power needed for it to function and for the protection release.

15 Modules

15.1 PR120/V - MEASURING Module

15.1.1 General characteristics

The MEASURING module records and processes the phase voltages. The measurements are sent by the module to the protection release, enabling the implementation of a set of protection and measurement functions. The module comes with a “Power” LED and a sealable isolator for dielectric stiffness tests. The module also enables the relay to be powered.

15.1.2 Front view

- "Power line " LED (on with isolator in position and line voltage present, see 15.1.4)
- Isolator

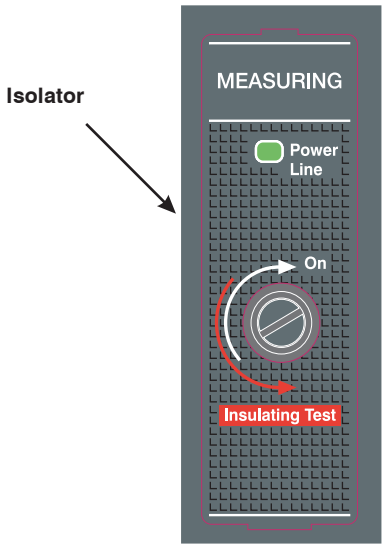

Before performing the dielectric stiffness test it is essential to turn the isolator into the Test position mode by turning the screw anticlockwise until you reach the end of stroke position.

After performing a dielectric stiffness test, restore the isolator to its original position by turning it clockwise until you reach the opposite end of stroke, because all the voltage protections are disabled while the isolator is in the test position.

Dielectric stiffness tests on any voltage transformers connected to the secondary lines alone are prohibited.

At the end of the procedure, make sure that the Power Line LED is on.

15.1.3 Releases complete with the module

- standard for PR123/P
- optional for PR122/P.

15.1.4 Powering the PR122/P and PR123/P units via the PR120/V module

The PR122/P and PR123/P units are powered by the MEASURING module via the busbar voltage.
The powering stage is capable of operating starting from a voltage of 80Vrms two-phase phase to phase up to 897Vrms (1.3 * 690Vrms) three-phase phase to phase at its input (coming directly from the busbars or from a transformer secondary). In the case of three-phase systems with a rated voltage greater than 690Vrms phase to phase, a step-down transformer (with a transformation ratio of less than 1) is used. See par. 15.1.7.

The following table shows the phase-to-phase voltage values at the MEASURING module's input for which the relays and modules are enabled:

ENABLING THE UNIT AND ITS FUNCTIONS				THREE-PHASE (phase-to-phase voltage)
PR123/P Relay	PR120/K	PR120/D-BT WL module	Relay display backlighting	Enabling threshold
☒				60Vrms
☒	☒			70Vrms
☒	☒	☒		90Vrms
☒	☒	☒	☒	110Vrms
☒	☒		☒	90Vrms
☒		☒	☒	70Vrms

Note: for proper connection of PR120/V module, see figs. 43, 44 and 48 in the wiring diagrams.

15.1.5 Operating instructions / Operation in service

15.1.5.1 Using the Measurement submenus with the PR120/V

N.B. Some screen pages are not available with the PR122.

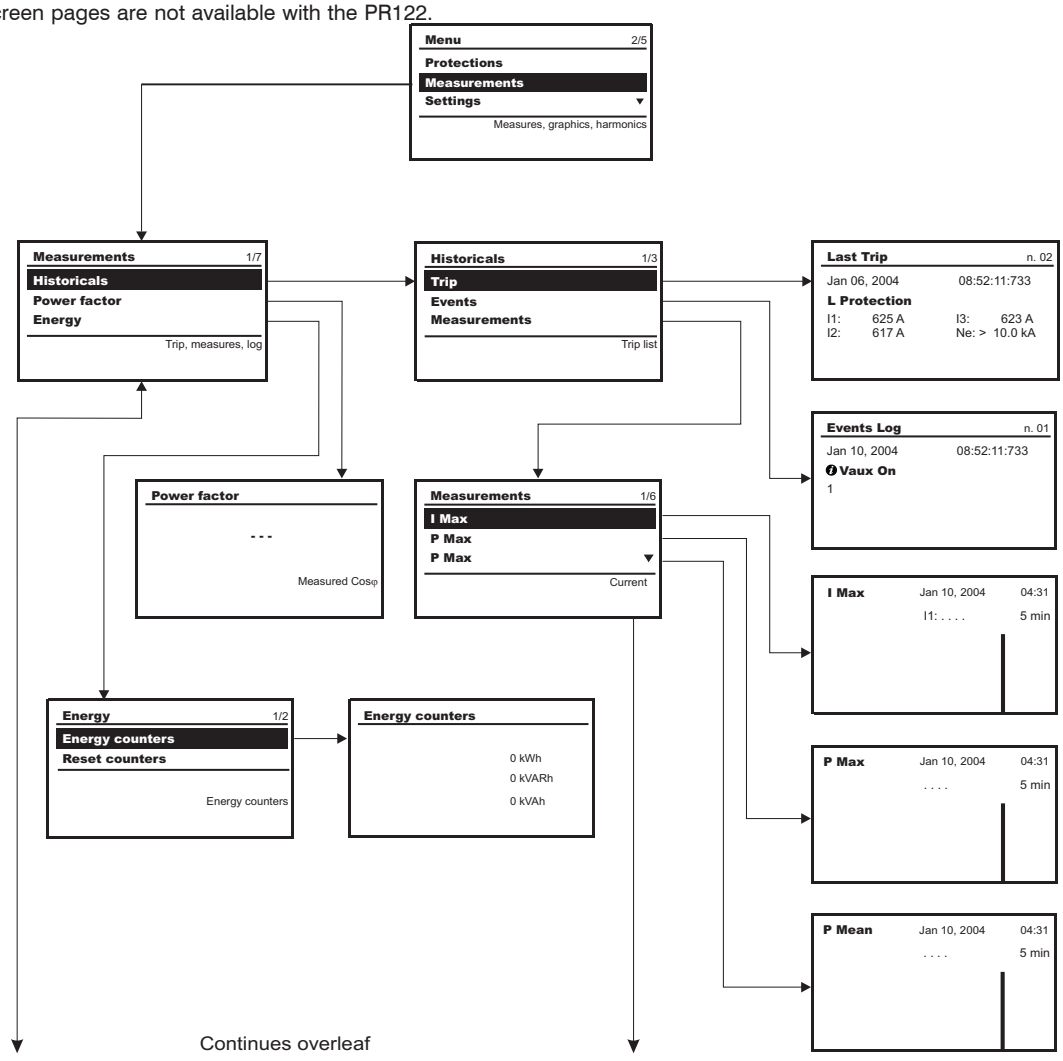

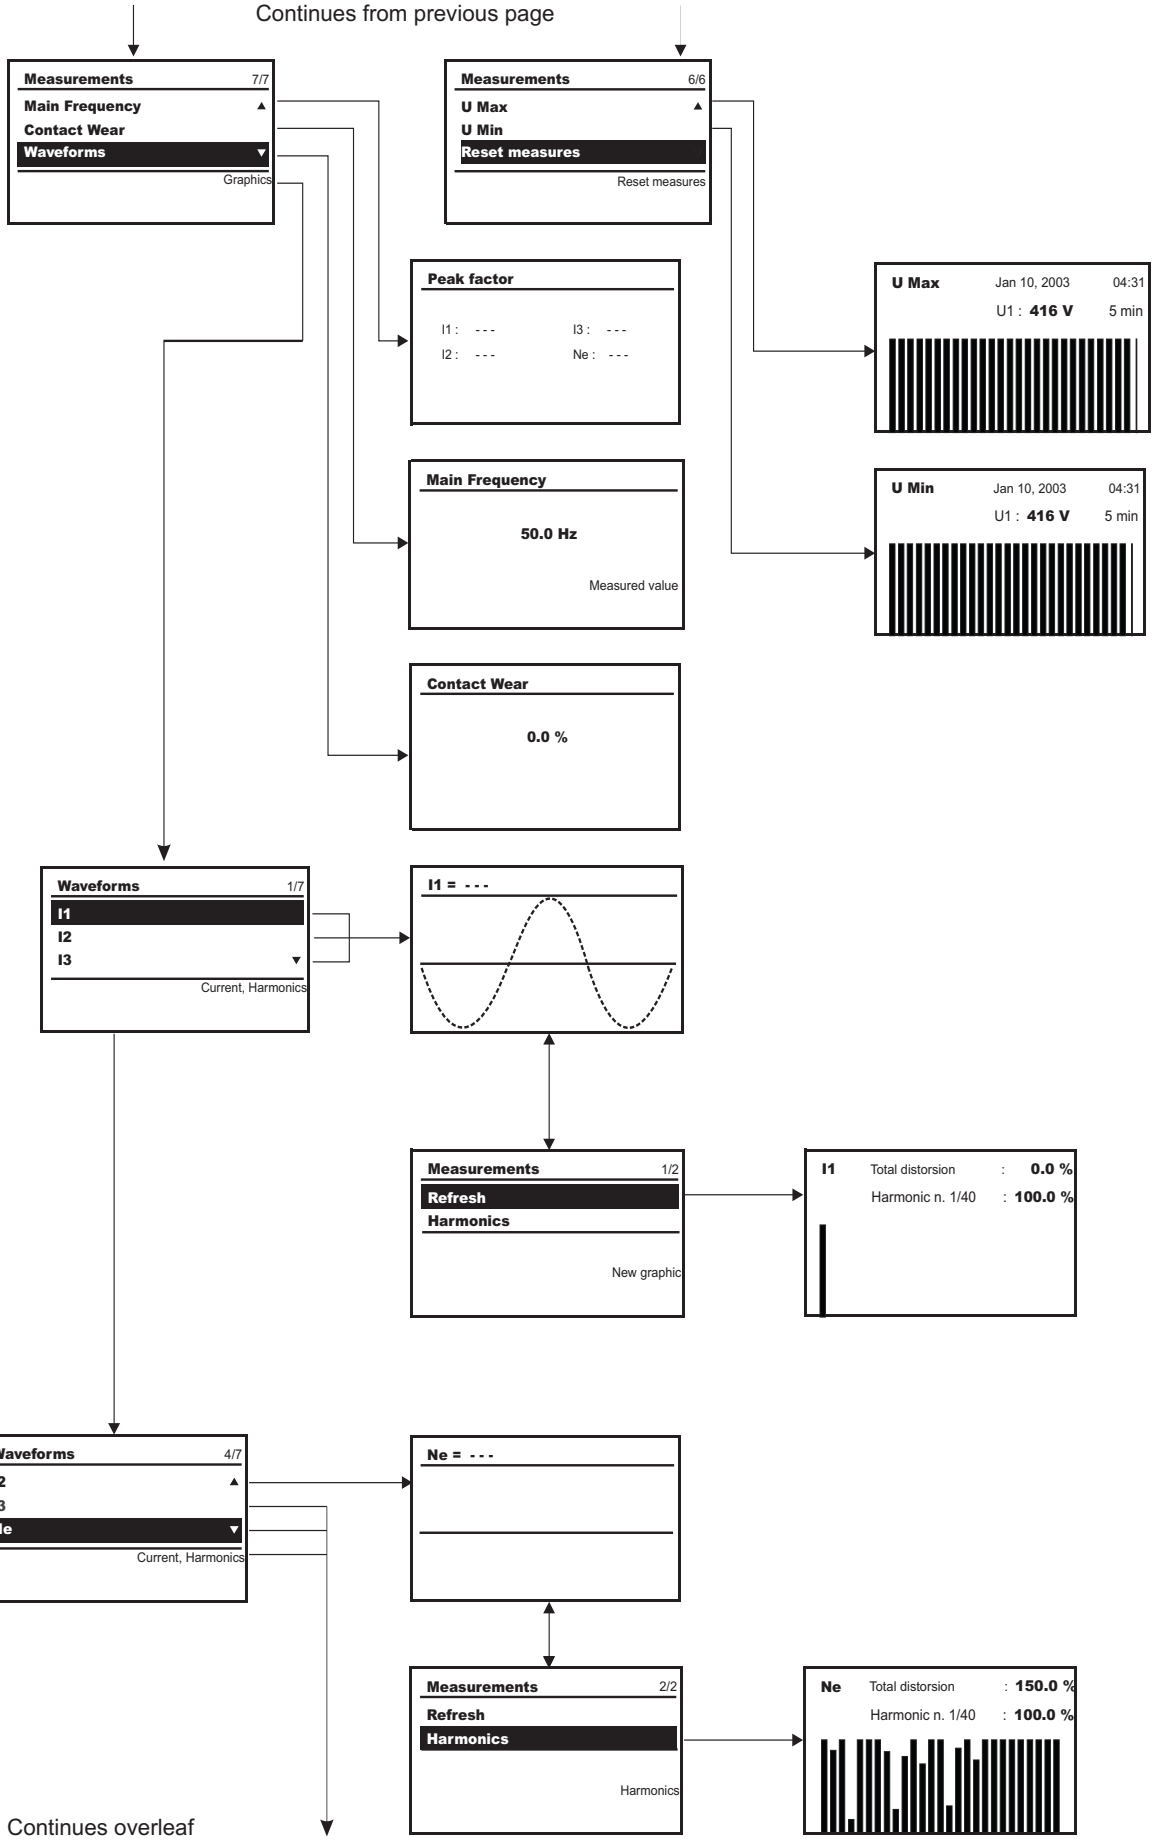
Continues from previous page
Measurements 7/7
Main Frequency
Contact Wear
Waveforms
Graphics
Measurements 6/6
U Max
U Min
Reset measures
Reset measures
Peak factor
I1 : ---
I2 : ---
I3 : ---
Ne : ---
U Max Jan 10, 2003 04:31
U1 : 416 V 5 min
Main Frequency
50.0 Hz
Measured value
U Min Jan 10, 2003 04:31
U1 : 416 V 5 min
Contact Wear
0.0 %
Waveforms 1/7
I1
I2
I3
Current, Harmonics
I1 = ---
Measurements 1/2
Refresh
Harmonics
New graphic
I1 Total distorsion : 0.0 %
Harmonic n. 1/40 : 100.0 %
Waveforms 4/7
I2
I3
Ne
Current, Harmonics
Ne = ---
Measurements 2/2
Refresh
Harmonics
Harmonics
Ne Total distorsion : 150.0 %
Harmonic n. 1/40 : 100.0 %
Continues overleaf

Continues from previous page

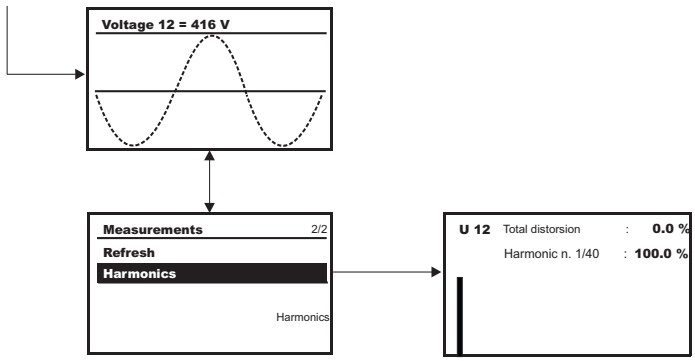

15.1.5.2 Table of submenus for the PR120/V module

This menu is accessible using the path "Settings/Modules/ PR120/V module"

Parameter / Function		Values	Notes
Voltage transformer		Absent	for voltages below 690V
	Rated voltage	100V-115V-120V-190V 208V-220V-230V-240V 277V-347V-380V-400V 415V-440V-480V-500V 550V-600V-660V-690V	
Voltage transformer		Present	for voltages above 690V, see par. 15.1.7
	Primary voltage	100V-115V-120V-190V 208V-220V-230V-240V 277V-347V-380V-400V 415V-440V-480V-500V 550V-600V-660V-690V 910V-950V-1000V-1150V	
	Secondary voltage	100V-110V-115V-120V 200V-230V	
Power flow		Low → High High → Low	PR120/V connected to the bottom CB terminals PR120/V connected to the top CB terminals
Signals	Phase sequence		
	Enabling status	ON/OFF	
	Threshold	123/321	can be selected if enabling status is ON
	Cos φ		
	Enabling status	ON/OFF	
	Threshold	from 0.5 to 0.95 step 0.01	

15.1.5.3 Measurements Menu table

For the sake of simplicity, the table refers to the Measurements menu already provided in the PR123/P, which is also applicable for the PR122/P fitted with a PR120/V module.

Parameter / Function		Values	Notes
Historicals	Trips		List of trips
	Events		Events log
	Measurements		
	Maximum current		
	Maximum active power		
	Mean active power		
	Maximum voltage		
	Minimum voltage		
	Reset measurements		
Power factor			measured cos φ available in self-supply mode
Energy	Energy meters		
	Reset meters		

Peak factor		Peak value/rms value available in self-supply mode
Mains frequency	50-60Hz	Measured value available in self-supply mode
Contact wear		Percentage of contact wear
Waveforms	Current I1/I2/I3/Ne Refresh Harmonics Voltage 12/23/31 Refresh Harmonics	

15.1.5.4 Measurements Menu

15.1.5.4.1 Historicals

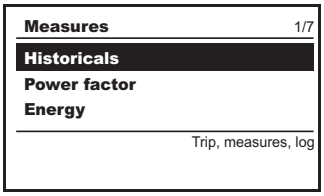

A whole range of measurements is accessible from the "Measurements/Historicals" menu.

15.1.5.4.2 Trips

The following is an example of a page showing the latest trip. You can access said page by selecting Trips via the path Measurements / Historicals / Trips. The page shows the values for the type of protection that has been tripped (L in the example).

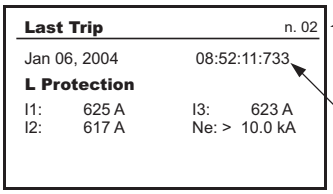

Meter: counts progressively (0 … 65,535) as of the date of the latest trips reset. It shows the latest 20 trips which can still be selected.

Time (in hours and minutes) when CB opened

15.1.5.4.3 Events

The following table shows a typical page concerning the latest events Log. You can access said page by selecting Events via the path Measurements/ Historicals / Events.

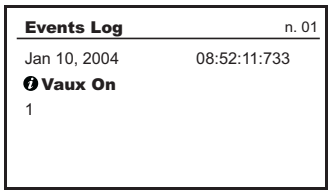

Meter: indicates “Latest” and measures the previous events in the sequence -1, -2 up to -80 (e.g., the last but one is shown as -1)

15.1.5.4.4 Measurements

This submenu is for showing the following measurements:

I Max - Maximum current
P Max - Maximum active power
P Mean - Mean active power
U Max - Max line voltage (phase-to-phase)
U Min - Min line voltage (phase-to-phase)
Reset - Reset measurements

15.1.5.4.5 Power factor

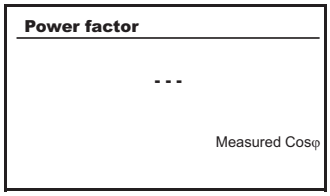

The unit provides the measurement of the global power factor. For phase power under 2% (0.02xPn_{phase}), the value is not displayed, but is replaced by '.....'.

15.1.5.4.6 Energy

The unit also provides meter readings of the active, reactive, and total apparent energy of the system. The minimum value that can be displayed is 0.001MWh or 0.001MVARh or 0.001MVAh. The energy meters' end of scale is approximately 2.15 billion kWh / kVARh / kVAh.
The meter can also be reset by pressing the "Reset meters" key on the menu.
For the ranges and precisions see par. 14.2.9.15.

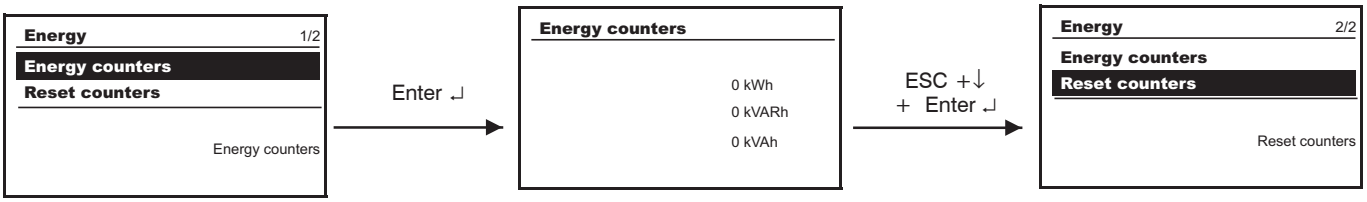

15.1.5.4.7 Peak factor

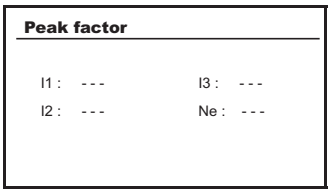

On this page you can also measure the peak factor - i.e. the relationship between I_{peak} / I_{rms} - for each of the phases. This measurement is not displayed for phase currents below 0.3xIn and it is not available for phase currents above 6xIn. For the ranges and precisions see par. 14.2.9.15.

15.1.5.4.8 Mains frequency

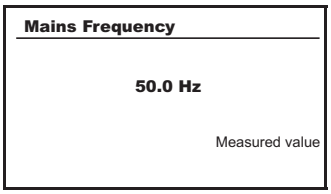

This page enables you to view the mains frequency. This is calculated on the voltages (if Umax > 0.1Un).
For the ranges and precisions see par. 14.2.9.15.
The measurement is guaranteed a maximum of 5 s after the change in frequency.

15.1.5.4.9 Contact wear

This submenu shows the percentage of wear on the CB contacts.

15.1.5.4.10 Wave forms

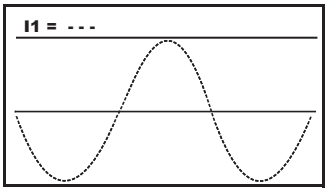

When you access this menu page, 120 samples of the wave form of the selected phase are acquired and displayed. When you press the ↵ key, a new wave form is acquired and displayed. Using the ↑ or ↓ keys, you can display the waveforms of the following measurement channels (L2, L3, Ne, V1, V2, V3, Gt).
Note: the display characteristic could show in a not very good way the waveform visualisation of curve with high presence of harmonic distorsions.

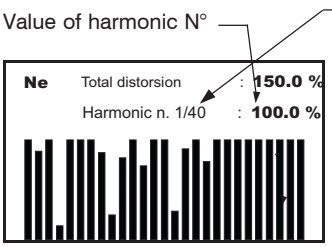

You can analyze the harmonic of the samples acquired and displayed on the "Waveforms" page, i.e. the page on the left is displayed, containing the module of the harmonics from the 1st to the 40th (up to the 35th for a mains frequency set to 60Hz) given as a percentage of the fundamental (harmonic n° 1), which is consequently always given as 100%.

Using the ↑ or ↓ keys you can go to the bar of interest (at the "No." of harmonic required, the bar begins to flash) and read the corresponding percentage value.
The measurement precision is 5%.

15.1.6 Data Logger

The data logger is active both with Vaux and with a power supply from the PR120/V.
For further information, see par. 16.4.

15.1.7 Electrical characteristics of the transformers

If the phase-to-phase line voltage is greater than 690Vac, it is essential to use a step-down transformer between the bars and the PR120/V module. Voltage transformers can be installed up to 15 m away from the PR120/V module to which they are connected.
Proper operation is only guaranteed for star/star or delta/delta configurations.
The allowable primary and secondary rated voltages that must be set on the unit are specified in the table 15.1.5.2.

Mechanical characteristics

Fixture	DIN rail EN 50022
Material	self-extinguishing thermoplastic
Degree of protection	IP30
Electrostatic protection	shielded towards EARTH

Electrical characteristics

Precision class	cl. 0.5
Performance	≥ 10 VA
Overload	20% permanent
Insulation	4 kV between inputs and outputs 4 kV between shield and outputs 4 kV between shield and inputs
Operating frequency range	from 50 Hz to 60 Hz, ± 10%

15.2 PR120/D-M - COM communication module

15.2.1 General characteristics

Dedicated communication module for connecting the relay to a Modbus net, and for remote supervisory and control activities on the circuit breakers.

15.2.2 Front view

- "Power" LED (on with Vaux present)
- LED RX/TX (data send/receive signal)

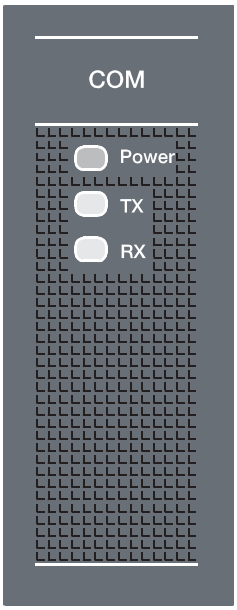

15.2.3 Releases complete with the module

- optional for PR122/P
- optional for PR123/P

15.2.4 Power supply

The PR120/D-M - COM communication module is only powered by the relay if there is a 24V auxiliary voltage available.

15.2.5 Connection

Refer to fig.45 in the wiring diagram provided in this manual.

15.2.6 Communication functions available

The communication function on the PR122/P, PR123/P releases with PR120/D-M - COM is listed in the table:

PR122/P or PR123/P + PR120/D-M - COM

Protocol	Modbus RTU
Physical interface	RS-485
Baud rate	9600 - 19200 bit/s

15.2.7 PR120/D-M - COM module menu

Parameter / Function	Values	Notes
Local/remote	Local/remote	
Serial address	1 ... 247	
Baudrate	9600 bit/s 19200 bit/s	
Physical protocol	8,E1 - 8,0,1 - 8,N,2 - 8,N,1	
PR120/K signalling module	Modbus standard ABB	

15.3 PR120/K signalling module

15.3.1 General characteristics

The module enables the local signalling of alarms and circuit breaker trips.
There are two possible configurations for the SIGNALLING module:
- default configuration: 1 digital input, 3 contacts with pole in common, 1 independent contact;
- alternative configuration: 4 independent contacts. In this case, the digital input is wired, but not brought up to the terminal block.

The two configurations are alternative to each other. You can switch from one configuration to the other without changing the module, by using a different wiring, as illustrated in the wiring diagrams in figs. 46 or 47.

15.3.2 Front view

- "Power" LED (on with Vaux present)
- N° 4 LED: associated with the signalling contacts.

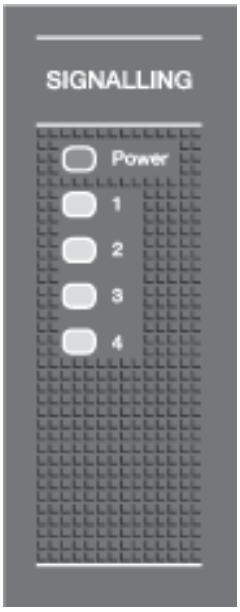

15.3.3 Releases complete with the module

- optional for PR122/P
- optional for PR123/P

15.3.4 Characteristics of the digital input

The unit enables the digital input to be associated with the following functions:
- enabling of an alternative set of parameters, set B (PR123/P only);
- outside trip control;
- zeroing release trips;
- resetting PR120/K contacts;
- local/remote enabling;
- resetting energy meters.

With the digital input the enabling relays have a common connection.
For the load control function, the module can be used as an actuator.

15.3.5 Characteristics of the signalling contacts

The following data are defined for resistive loads (cos φ = 1)

Type of contact	**SPST**	
Maximum switching voltage	130 Vdc	380 Vac
Maximum switching current	5 A	8 A
Maximum switching power	175 W	2000 VA
Breaking capacity @ 35 Vdc	5 A	----
Breaking capacity @ 120 Vdc	0.2 A	----
Breaking capacity @ 250 Vdc	----	8 A
Breaking capacity @ 380 Vdc	----	5.2 A
Contact/coil insulation		4000 Vrms
Contact/contact insulation		1000 Vrms

15.3.6 Power supply

The PR120/K signalling module is powered in auxiliary mode by the relay and/or by the PR120/V as specified for the PR120/V module.

15.3.7 PR120/K module menu

	Parameter / Function	Values	Notes
Relay n.1			
(K51/p1)	Signal source	Standard or custom	- see par.15.5
	Delay	0...100s step 0.01s	- Deliberate delay before activating the contact
	NO/NC	NO/NC	- Contact normally-open (NO) or normally-closed (NC)
	Latch	ON/OFF	- With the contact "ON", once it has been activated it stays switched. A specific reset action is needed to reset it
Relay n. 2			
(K51/p2)	Signal source	Standard or custom	
	Delay	0...100s step 0.01s	
	NO/NC	NO/NC	as above
	Latch	ON/OFF	
Relay n. 3			
(K51/p3)	Signal source	Standard or custom	
	Delay	0...100s step 0.01s	as above
	NO/NC	NO/NC	
	Latch	ON/OFF	
Relay n. 4			
(K51/p4)	Signal source	Standard or custom	
	Delay	0...100s step 0.01s	as above
	NO/NC	NO/NC	
	Latch	ON/OFF	
Input			
	Polarity	active low	
		active high	
	Function	Generic	- no associated action
		Outside trip	- releases the circuit breaker
		Reset trip	- resets the data after a trip
		Set B	- switches from set A to set B
		Local	- forces the local status of the protection (local/remote)
		Signal reset	- programmable contact reset
		Energy reset	- energy meter reset
	Delay	0...100 s step 0,01 s	- performs action after preset time

15.3.8 Programming contacts K51/p1, K51/p2, K51/p3 and K51/p4

The PR120/K is fitted with four relays whose contacts are named K51/p1, K51/p2, K51/p3 and K51/p4, which can signal different situations selectable by the user from among those given in the standard list, whereas customizations can be programmed by selecting "custom" on the menu and setting the signal required with a PDA, SD-Testbus or PR010/T.
See Appendix 16.5.

15.3.9 Configurable input

There is an input with a configurable function in the Signalling module. The figure shows two cases, A and B, in which the input's status is active; in case A the input does not stay valid beyond the enabling delay so the associated action does not take place, whereas in case B the action takes place after the preset delay.

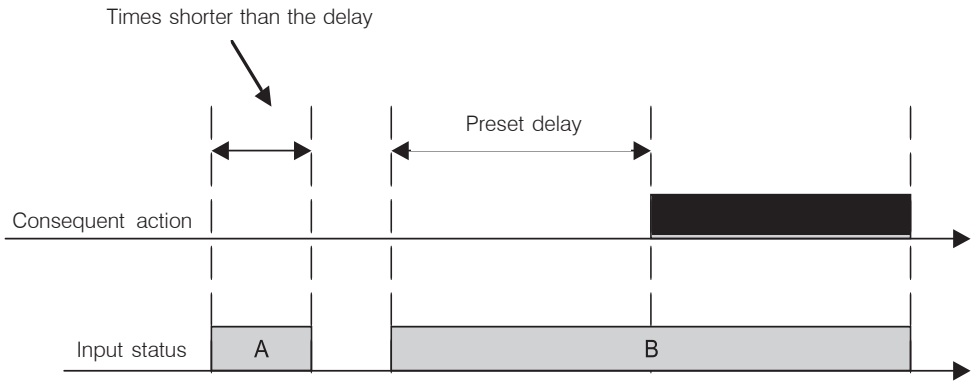

15.3.9.1 Input configuration settings

You can select the level at which to consider the input enabled:
1. low input enabling level
2. high input enabling level

15.3.9.2 Input function settings (ACTION)

You can select the action associated with the input, i.e. the action that takes place after the programmed delay, when the input is enabled (on high or low level).
You can select one of the following actions:
1. Generic: no specific action is associated with the input. The status of the input is shown on the available display and remotely via the bus
2. Trip test: when the input is enabled for the specified delay, a trip test is performed
3. Trip reset: when the input is enabled for the specified delay a trip reset is performed
4. Set B: when the input is enabled for the specified delay, the Set B is enabled
5. Dial Local: when the input is enabled for the specified delay, there is a forcing of the dialogue local mode
6. Signalling module reset: when the input is enabled for the specified delay, the status of the relays in the PR120/K module is reset
7. Energy reset: when the input is active for the specified delay, the energy meters are reset.

15.3.9.3 Setting the input enabling delay

BY mean s of the "Delay" parameter, you can specify the time elapsing before the input is enabled in the range 0.00 [s] to 100.00 [s] with 0.01[s] steps.

15.3.10 PR120/K module menu layout

The menu layout relating to relay n. 1 (K51/p1) is shown below as an example; the same applies to the menus for the other relays.

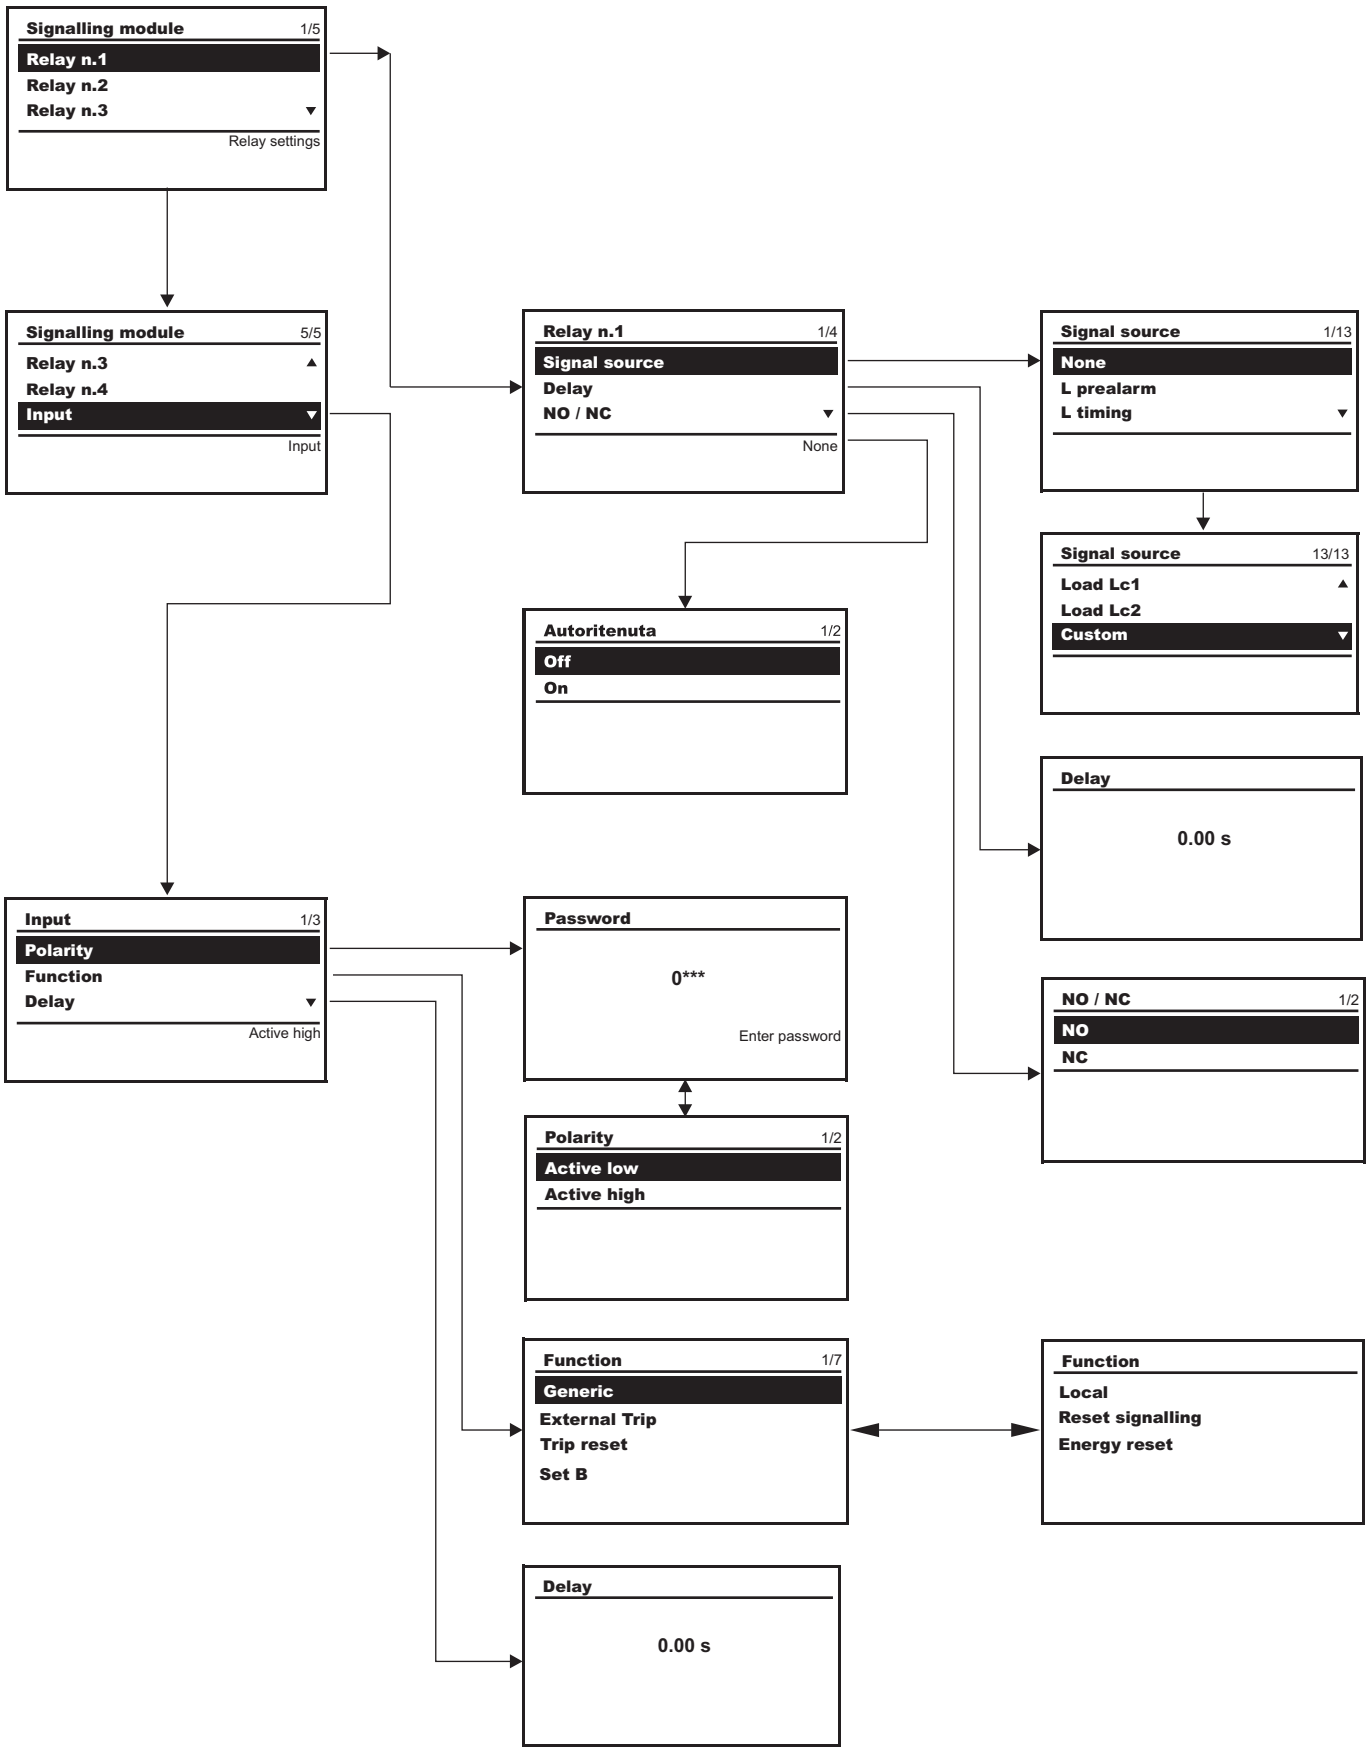

15.4 PR120/D-BT - WL-COM wireless communication module

15.4.1 General characteristics

This module enables wireless communication between the protection releases and a handheld PC (PDA) or a laptop with a Bluetooth port. The module is designed specifically for use with the SD-Pocket application.

15.4.2 Front view

- "Power" LED (on with Vaux present)
- LED Rx/Tx (send/receive signal)
- LED BT (Bluetooth link enabled)

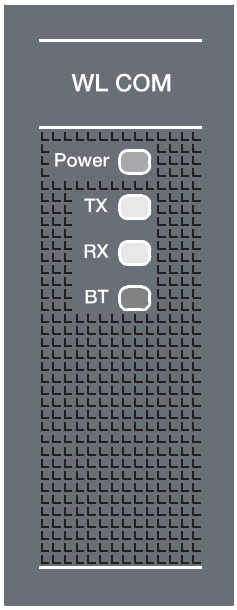

15.4.3 Releases complete with the module

- optional for PR122/P
- optional for PR123/P

15.4.4 Power supply

The PR120/D-BT WL-COM module is powered in auxiliary mode, from the PR120/V module, as specified in the description of the module, or by a PR030/B power supply unit.

15.4.5 Connection

For a proper connection, bear in mind that the module's range of action is 10 meters in air.

16 Appendices

16.1 PR021/K outside signalling unit

16.1.1 General information

The signalling unit converts the digital signals provided by the protection units into electrical signals by means of normally-open electric contacts. Information on the status of the protection functions transits on a dedicated serial line connected to the release.
The following signals/contacts are available:
- L overload prealarm (the alarm signal remains enabled throughout the overload, until the release has been tripped)
- protections timing and trip (the protections trip signal remains enabled during the timing-controlled phase and after the release has been tripped)
- I protection trip
- timing and overheating threshold overrun
- two contacts for load control
- release trip
- communication error on serial line (connections between protection and signalling units)
- phase unbalance U.

By setting the DIP switches, you can configure the signals of 7 programmable contacts. This can be done by selecting them directly in the PR122/P or PR123/P relay, choosing from a long list, including: directional protection trip D, minimum and maximum voltage trip UV and OV, reverse power trip RP and others.

Two contacts available on the SACE PR021/K (load control) unit enable you to control a release for opening and closing the circuit breaker. These contacts enable various applications, including load control, alarms, signals, electric cutouts. In case of "Tc error", a signalling contact can be programmed on "Hw trip" and, consequently, it can command an Y0 to open the CB.
A Reset button enables you to zero the status of all the front optical signals and return the relays' contacts to the resting position.
The unit also contains ten LEDs to display the following information:
- Power ON: auxiliary power supply on
- Tx(int Bus): flashing synchronized with dialogue with the Internal Bus
- Eight LEDs associated with the signalling contacts

16.1.2 Power supply

Auxiliary power supply	24 V DC +/-20%
Maximum ripple	5%
Rated power @ 24V	4.4 W

Type of contact	**SPST**	
Maximum switching voltage	130 Vdc	380 Vac
Maximum switching current	5 A	8 A
Maximum switching power	175 W	2000 VA
Breaking capacity @ 35 Vdc	5 A	----
Breaking capacity @ 120 Vdc	0.2 A	----
Breaking capacity @ 250 Vdc	----	8 A
Breaking capacity @ 380 Vdc	----	5.2 A
Contact/coil insulation		4000 Vrms
Contact/contact insulation		1000 Vrms

16.1.3 General characteristics of the signalling relays

The following data are defined for resistive loads (cos φ = 1)

16.1.4 Relay functions

The available contacts can be used to manage the respective relays indicating an event (a given situation in the state of the device) that prompts the required relays to be independently enabled after the delay specified by the user. The function is entirely similar to the one described in the PR120/K signalling module in par. 15.3 and 16.5 of this manual.

16.1.5 PR021/K signalling unit menu

The unit's functions are accessible from the operator panel (PR123/P and PR122/P where applicable)

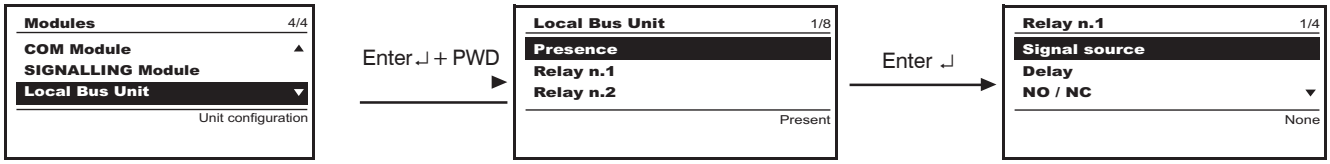

16.1.5.1 PR021/K unit menu table

Protection	Parameter / Function	Values	Notes
PR021K unit		Present Abent	Leave as Absent if there is no PR021/K
	Relay n. 1 / 2 / 3 / 4 / 6 / 7 / 8		
	Signal source	None L Prealarm L Timing S Timing L Trip S Trip G Trip I Trip Any trip Custom	see par.16.5
	Delay	0...100s step 0.01s	- Deliberate delay before activating the contact
	NO/NC	NO/NC	- Contact normally-open (NO) or normally-closed (NC)
	Latch	ON/OFF	- With the contact "ON", once it has been activated it stays switched. A specific reset action is needed to reset it

16.1.5.2 Important note

The unit must be connected to the PR122/P or PR123/P by means of an internal busbar with a shielded, corded two-wire cable (see note A, par. 11.2.2) no more than 15m long.
The shield must be earthed both on the circuit breaker side and on the PR021/K side. For the installation and operation of the PR021/K accessory, refer to the specific user manual.

16.2 SD-Pocket

SD-Pocket is a software application designed to connect the new releases to a handheld (PDA) or laptop PC to use wireless communication for communicating with the PR121/P, PR122/P and PR123/P specifically for:
- configuring the protection thresholds (PR122/P - PR123/P)
- viewing the measurements, including the data stored in the data logger of the PR122/PR123 releases
- checking the conditions of the circuit breaker (e.g., status, number of trips, fault data, etc., depending on the release in question).

The scenarios for using SD-Pocket include:
- during commissioning, for a rapid and error-free transfer of the protection settings to the releases (also using the files for exchanging data directly from Docwin)
- during the normal operation of the equipment, for collecting information on the circuit breakers and the related loads (fault data, currents measured and other data)

SD-Pocket requires a PDA with MS Windows Mobile 2003 and a Bluetooth interface, or a PC with MS Windows 2000 OS. The releases must be complete with a PR120/D-BT or BT030 Bluetooth interface. It is not necessary, however, to have a PR120/D-M communication module.
SD-Pocket is distributed free of charge (freeware) and can be downloaded from the BOL site (http://bol.it.abb.com).

16.3 SD-Testbus

SD-TestBus is the installation and diagnostic software for ABB SACE products with a Modbus RTU communication. It can be used during commissioning, or to find faults in an already up and running communication network.
This enables the connection to a PR121/P, PR122/P and PR123/P.
SD-TestBus runs an automatic scan on the RS-485 bus, recording all the devices connected and checking their configurations, and also testing all the possible combinations of addresses, parity and baud rate.
With a simple click on SCAN you can pinpoint the devices that fail to respond, the configuration errors, the wrong addresses and parity errors, and so on.
After scanning, the software shows warning messages on potential problems or configuration errors, enabling a complete diagnosis of the communication network. These functions are not limited to the ABB SACE devices: any apparatus using the Modbus RTU standard protocol is recorded and tested.
For the ABB SACE circuit breakers with an electronic release, the software provides a vast range of additional functions, for checking the wiring, setting opening, closing or reset commands, and reading diagnostic information.
This program is so easy to use that it guarantees a trouble-free installation and commissioning of a Modbus communication network.
SD-TestBus is distributed free of charge (freeware) and can be downloaded from the BOL site (http://bol.it.abb.com).

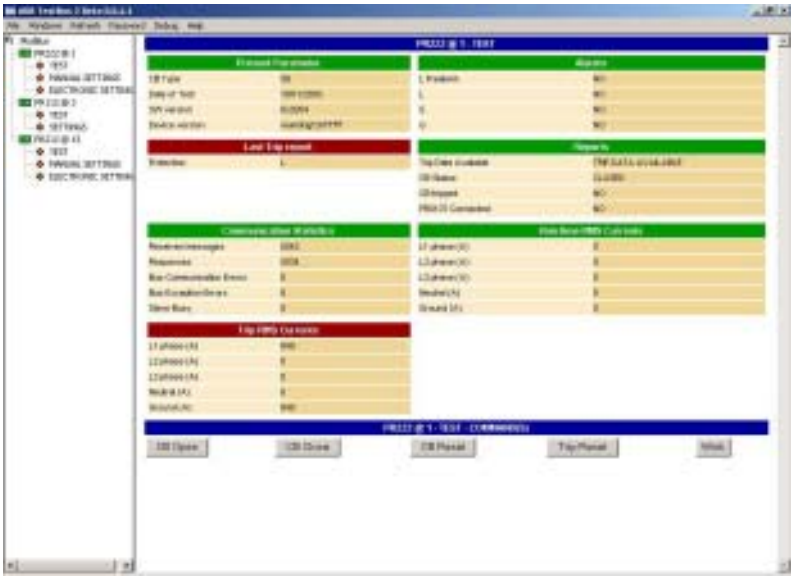

16.4 Data logger (recorder)

The data logger function is available on the PR122/P and PR123/P units and it can be used to save the instantaneous values of certain analog and digital measurements automatically in a large-sized memory buffer. The data can easily be downloaded from the unit using either the SD-Pocket application with a Bluetooth port, or the SD-TestBus application via a Modbus bus, and transferred to any personal computer for processing. The function stops the recording every time a trip occurs in order to facilitate failure analysis.

16.4.1 General characteristics:

Number of analogue channels:	7
Number of digital events:	64
Maximum sampling frequency:	4800 Hz
Maximum sampling time:	27s (- sampling frequency 600 Hz)

16.4.2 Description of the data logger menu

You can access the data logger menu from the Settings menu in the PR122/P and PR123/P units:

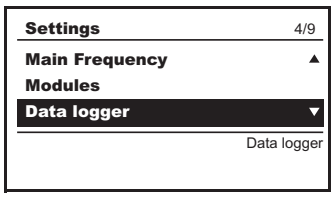

16.4.2.1 Enabling the data logger

The data logger can be enabled by inputting a password:

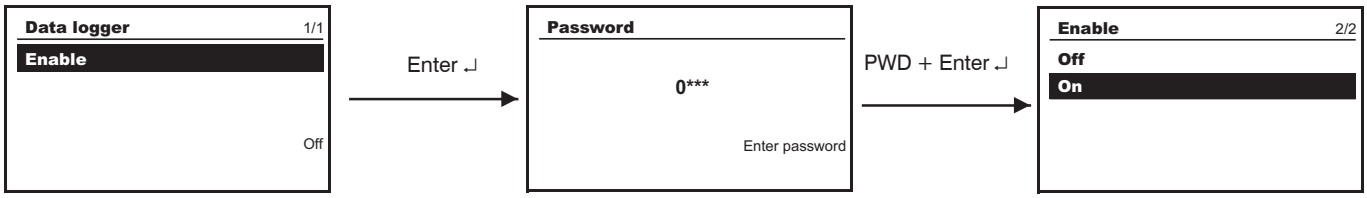

16.4.2.2 Setting the sampling frequency

On the menu, you can specify the frequency with which the measurements are saved, choosing from 4 fixed frequencies, i.e. 600Hz, 1200Hz,2400Hz or 4800Hz.

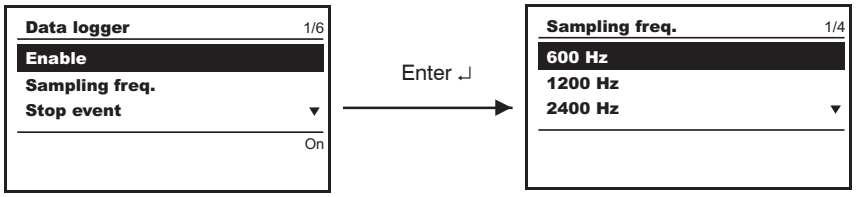

The maximum data recording times (see also par. 16.4.3) depend on the selected frequency and are illustrated in the following table:

Frequency	RECORDING TIME
600 Hz	27.3 s
1200 Hz	13.6 s
2400 Hz	6.8 s
4800 Hz	3.4 s

Note: the setting of the sampling frequency is very important, indeed the presence of high order harmonic curve could cause an aliasing phenomenon on the collected data elaboration. It's advised to use the highest frequency in presence of harmonic distortion, otherwise the data elaboration could give results not corresponding to red plant conditions.

16.4.2.3 Setting the standard stop events (triggers)

You can select one of the following stop events (triggers), see also par.16.5.2:

1. **None**
2. **Any alarm**
3. **L timing**
4. **Any trip**

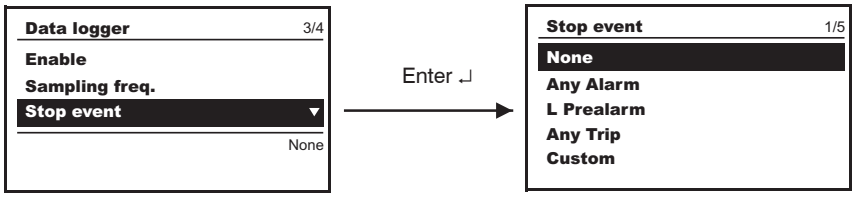

If you select "None" for the stop event, the data logger can be stopped only by a stop command from the operator panel, from the system or following a trip generated by the relay.

16.4.2.4 Setting and viewing customized stop events (triggers)

From the system, you can set customized stop events (triggers) to coincide with the events shown in paragraph 16.5.
In the event of a customized trigger point, the following window is displayed:

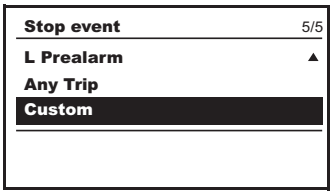

16.4.2.5 Setting the stopping delay

The stopping delay can be set between 0.00 [s] and 10.00 [s], in 0.01 [s] steps.

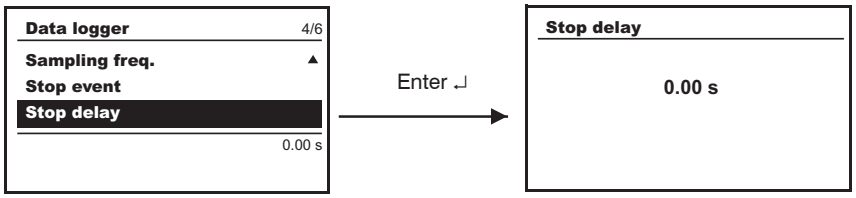

In the event of a trip, this data storage process is stopped after 10 ms, even if a longer stopping delay has been selected.

16.4.2.6 Restart/Stop data logger

Using the Restart/Stop options, you can restart or stop the recording by the data logger:

16.4.3 Recording time windows

The data logger's measurements are recorded in a time window, the duration of which is defined and synchronized by an event (trigger/stop event) of your choice.
The following figure displays the time window, the trigger and the samples available in gray:

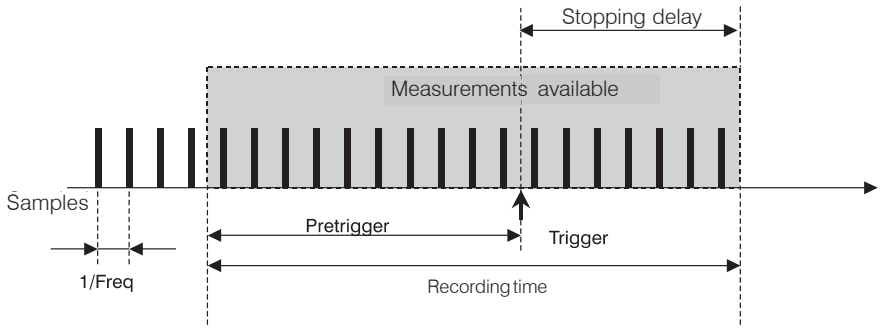

The user can select the sampling frequency (see par.16.4.2.2), the type of stop event (trigger) (see par.16.4.2.3) and the stopping delay (see par.16.4.2.4) so as to obtain the required pre-trigger with respect to the selected event.
Depending on the selection you make, the stopping delay ower or higher than the recording time, as illustrated in the following figure:

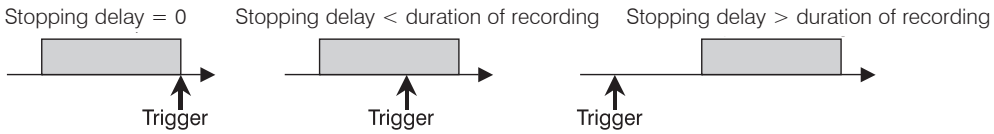

The maximum recording time is determined exclusively by the sampling frequency, established as shown in the table in par. 16.4.2.2. If the sum of the stopping delay plus the time elapsing between a restart trigger and a trigger is less than the maximum recording time, then the recording time will be shorter than the maximum, as illustrated in the following figure:

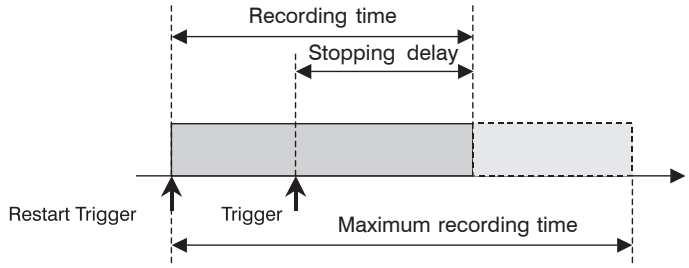

If the parameters relating to the data logger are changed while it is operating, the recording underway is terminated and a new recording begins (after a restart trigger command) on the basis of the new parameters.

16.4.4 Description of the information given by the data logger system

16.4.4.1 Combination of devices for reading/setting data from the data logger system

By connecting to the release's outside bus, you can set certain data logger parameters, triggers or commands, or read certain types and sequences of data in its memory.

The combinations of devices and the consequent software combinations that enable these functions are as follows:

1) PR122/P + BT030+SD-Pocket
2) PR122/P + PR120/D-M + SD-Testbus or remote system
3) PR122/P+ PR120/D-BT + SD-Pocket
4) PR123/P + BT030+SD-Pocket
5) PR123/P + PR120/D-M + SD-Testbus or remote system
6) PR123/P+ PR120/D-BT + SD-Pocket
7) PR122/P + PR010/T *
8) PR123/P + PR010/T *

* With these combinations it is impossible to download sequences of stored data

In this manual, the term "from the system" is used to define both the operations that are carried out using one of the combinations with SD-Pocket or SD-Testbus, and the operations that involve connecting to a remote system.

16.4.4.2 Access to saved data from the system

When the event associated with the stop event occurs or a stop command is received, the following data are saved in the recording block:

- Data logger Trigger, which indicates the type of stop event (trigger) that has prompted the stoppage of the data logger;
- Time-stamp of the stop event (trigger) (day/hour + minutes/seconds/milliseconds)(4 words);
- Data logger max file, which indicates which is the max file with consistent data;
- Data logger max address, which indicates the max address number of a block with consistent data.

The following information is recorded in the block for each sampling period:

1. **current sample L1**
2. **current sample L2**
3. **current sample L3**
4. **current sample Ne**
5. **voltage sample U12**
6. **voltage sample U23**
7. **voltage sample U31**
8. **digital inputs / outputs (among 16 possible options, e.g. inputs/outputs for Zone Selectivity, PR120/K contact status, ...)**
9. **alarms1 (among 16 possible options, e.g. L timing, G alarm, Prealarm)**
10. **alarms2 (among 16 possible options, e.g. UF timing, OV timing, Frequency error, RP timing)**
11. **trip (among 16 possible options, e.g. tripping of L, S, I, G, UV, OF, ...)**

16.4.4.3 Information from the system on the configuration and status of the data logger

The following information is provided on the status of the data logger:

STATUS	
Waiting trigger:	this means that the data logger is enabled and waiting for the occurrence of the event selected as the trigger
Data Logger triggered:	this indicates that the trigger event has occurred and the data logger is still recording
Data Logger stopped:	this means that the recording has been terminated either because it has been completed or because a data logger stop command has been received, or because a trip has occurred

CONFIGURATION	
Data Logger Config:	indicates whether or not the data logger is active
Data Logger Trigger Type:	indicates the stop event (trigger) setting
Data logger stopping delay:	indicates the delay for the stop

16.4.5 Data logger commands from the system

When a data logger stop command is given, the recording is stopped from the system. The subsequent recording is enabled by a Restart trigger command. The same applies to the operator panel, as illustrated in par. 16.4.2.6.

Example of data logger operation

The following figure shows an example of how a trigger works, the data logger's function, the effect of the stopping delay and of the restart and subsequent stop commands on the data saving procedure.

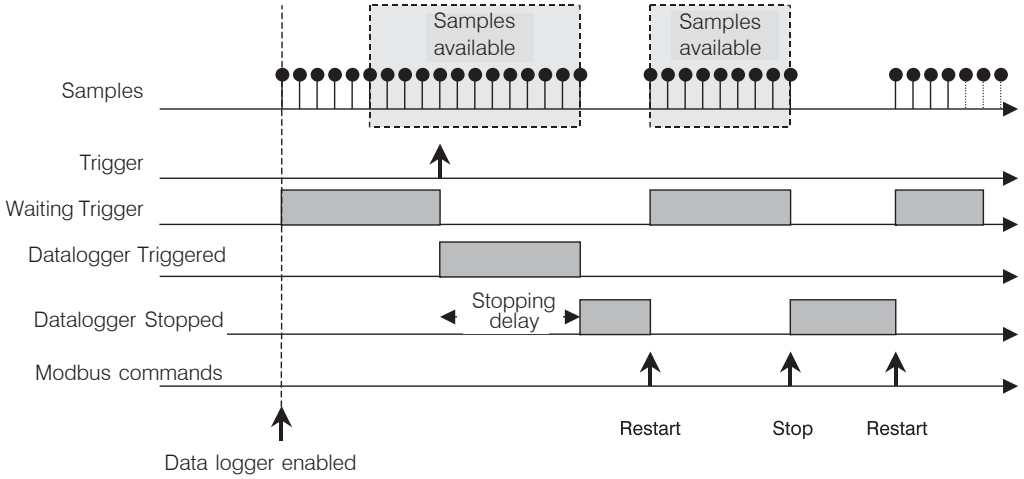

16.5 Table showing list of events

16.5.1 "Standard" events for PR120/K and for PR021/K selectable from the relay:

Event n.	Description	
0.	None	(none enabled)
1.	L prealarm	(L protection prealarm)
2.	L timing	(L protection timing)
3.	S timing	(S protection timing)
4.	L trip	(L protection trip)
5.	S trip	(S protection trip)
6.	I trip	(I protection trip)
7.	G trip	(G protection trip)
8.	Any trip	(tripping of any protection)

16.5.2 "Standard" events for the data logger function, selectable from the relay:

Event n.	Description	
0.	None	(free running)
1.	Any alarm	(any alarm)
2.	L timing	(L protection timing)
3.	Any trip	(tripping of any protection)

16.5.3 "Custom" events for the data logger function, for PR120/K and PR021/K:

N. (decimal)	Event	Notes	PR122	PR123
1920	G timing		x	x
2894	L1 or L2 or L3 sensor error or Trip Coil error		x	x
2688	LC1 alarm		x	x
2049	G alarm		x	x
2306	UV timing		x	x
4124	UV or OV or RV tripped		x	x
33672	CB connected and springs charged		x	x
1793	Harmonic distortion > 2.1		x	x

You can combine the status bits with “and” / “or” logical functions within the same group of events (byte). For more detailed information, refer to the Modbus Interface document.

16.5.4 Combining the devices needed to customize settings

The “custom” events can be selected using a remote control system, SD-Pocket, or SD-TestBus.
The devices you need to enable you to do so can be selected from the among the following:

1) PR122/P + BT030 + SD-Pocket
2) PR122/P + PR120/D-M + SD-Testbus or remote system
3) PR122/P + PR120/D-BT + SD-Pocket
4) PR122/P + PR010/T
5) PR123/P + BT030 + SD-Pocket
6) PR123/P + PR120/D-M + SD-Testbus or remote system
7) PR123/P + PR120/D-BT + SD- Pocket
8) PR123/P + PR010/T

17. Overall dimensions

Fixed circuit-breaker

Basic version with horizontal rear terminals

E1

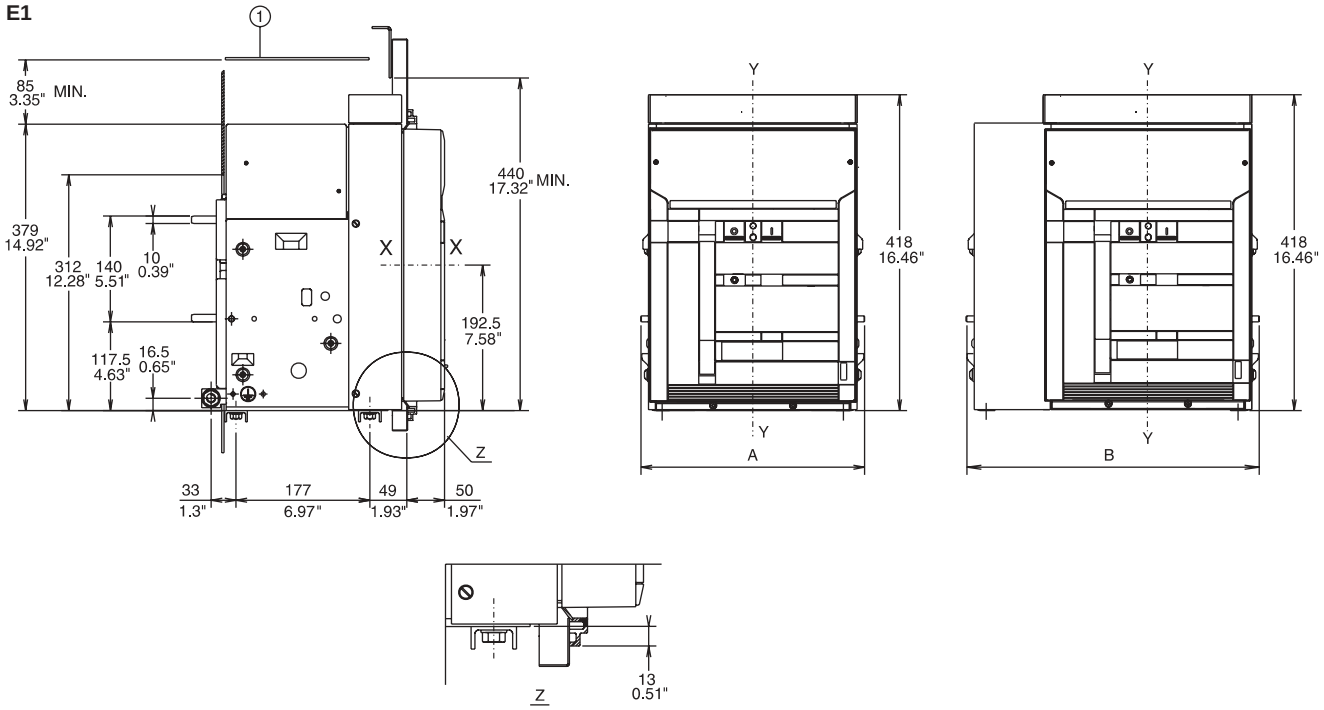

E2-E3

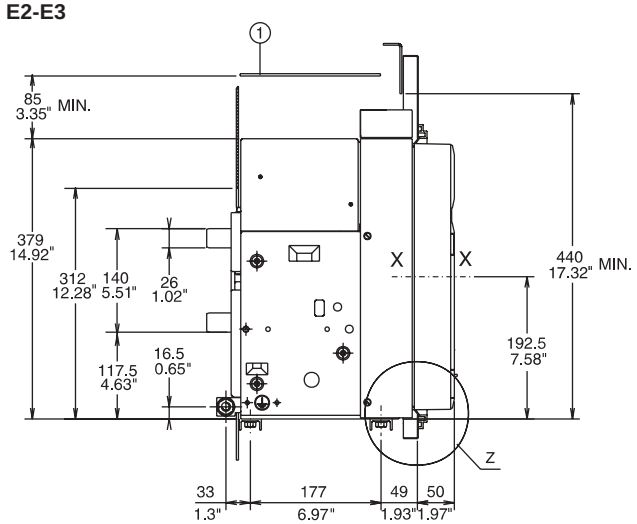

E4-E6

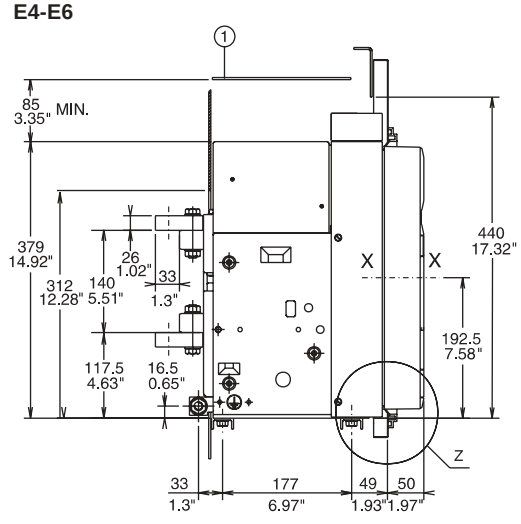

Legend

① Insulating or metal-insulated wall

	A 3 Poles	B 4 Poles
E1-A	296/11.65"	386/15.2"
E2-A	296/11.65"	386/15.2"
E3-A	404/15.91"	530/20.87"
E4-A	566/22.28"	656/25.83"
E4/f-A		746/29.37"
E6-A	782/30.79"	908/35.75"

Fig. 35

Fixed circuit-breaker

Basic version with horizontal rear terminals

E1 3 poles / **E2** 3 poles

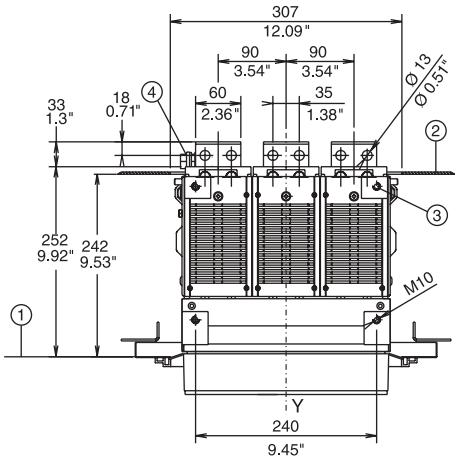

E1 4 poles / **E2** 4 poles

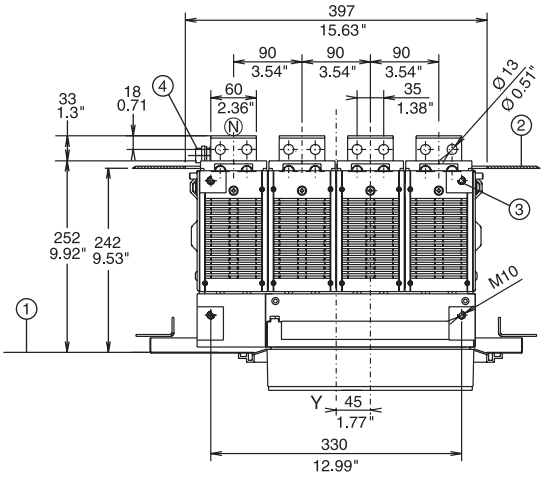

E3 3 poles

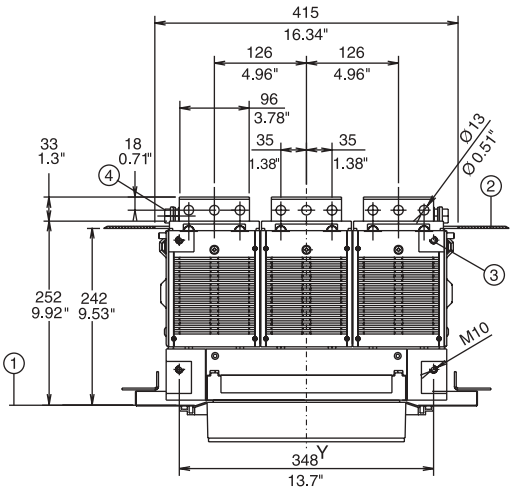

E3 4 poles

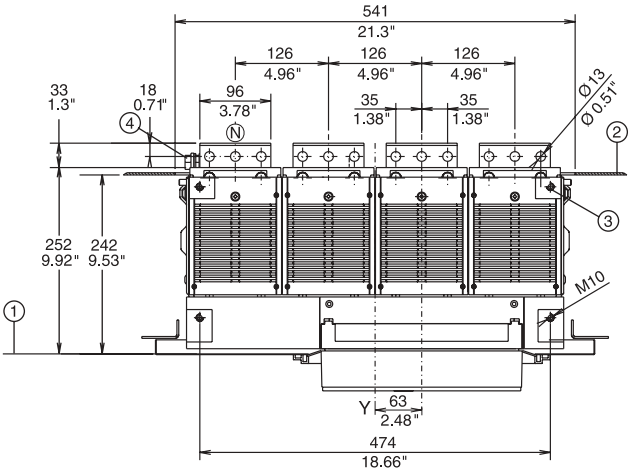

Legend

① Inside edge of compartment door

② Segregation (where foreseen)

③ M10 mounting holes for circuit breaker (included in the supply)

④ No 1 M12 screw for earthing (included in the supply)

Fig. 36

Fixed circuit-breaker

Basic version with horizontal rear terminals

E4 3 poles

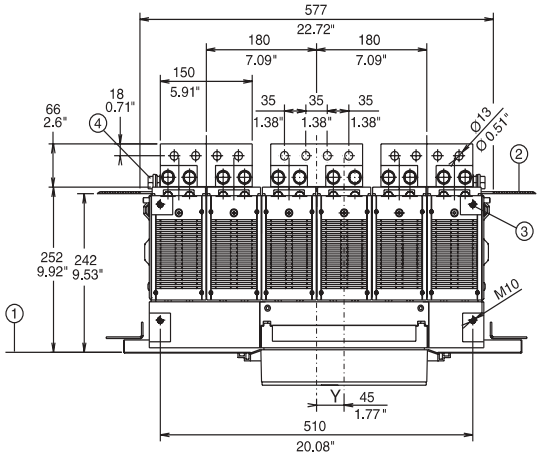

E4 4 poles

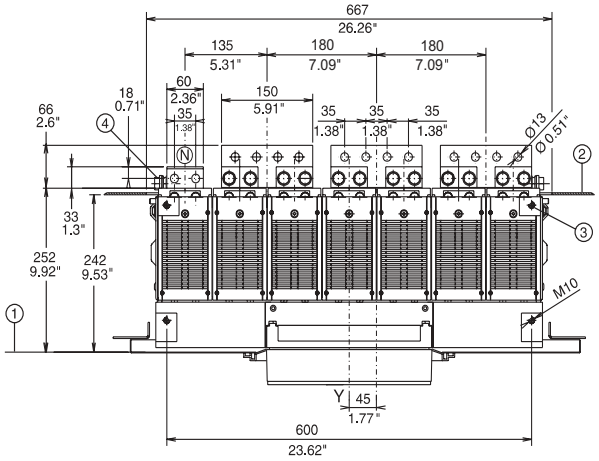

E4/f 4 poles

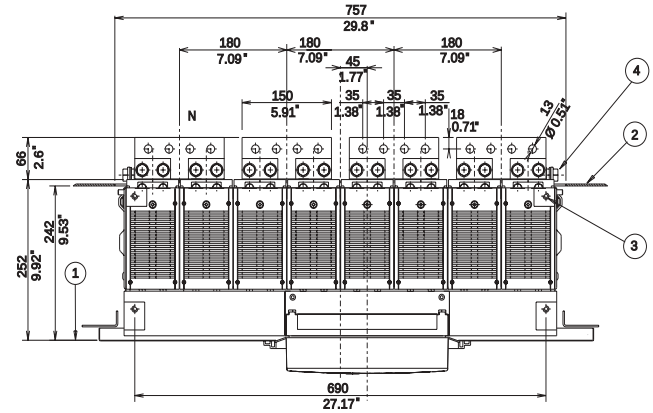

E6 3 poles

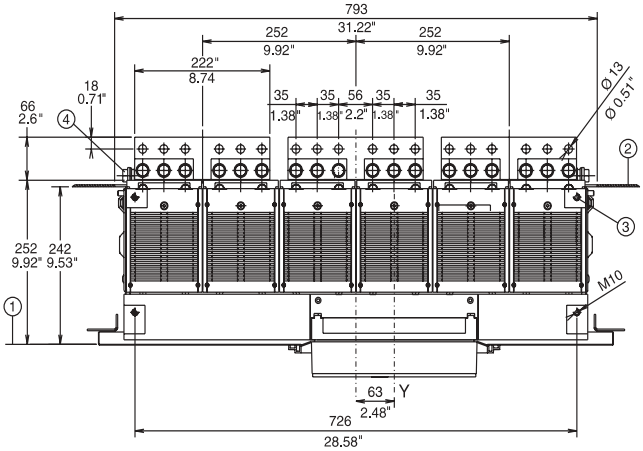

E6 4 poles

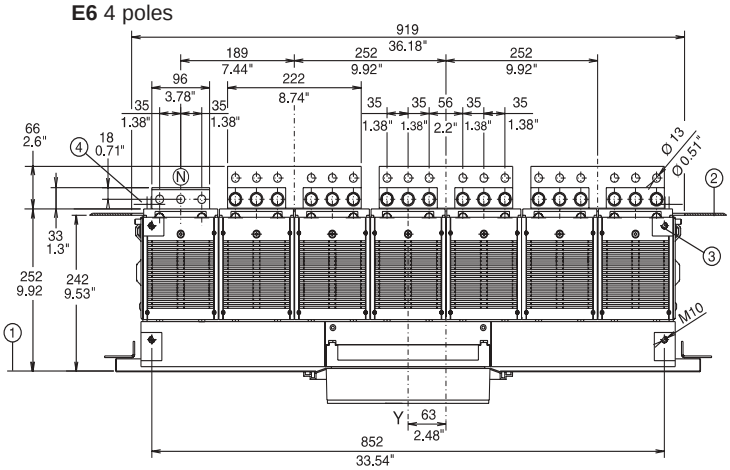

Legend

① Inside edge of compartment door

② Segregation (where foreseen)

③ M10 mounting holes for circuit breaker (included in the supply)

④ No. 1 M12 screw for earthing (included in the supply)

Fig. 37

Fixed circuit-breaker

Basic version with vertical rear terminals

E1

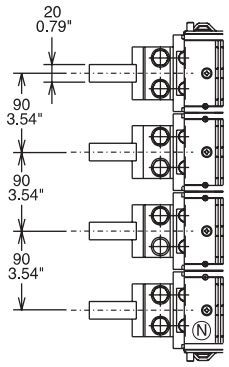

E2

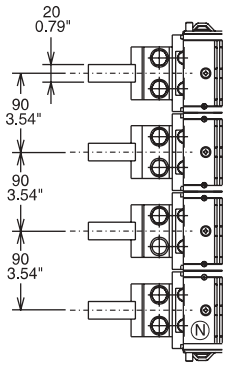

E3 1200÷2000 A

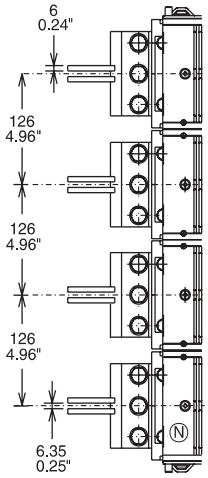

E3 2500 A

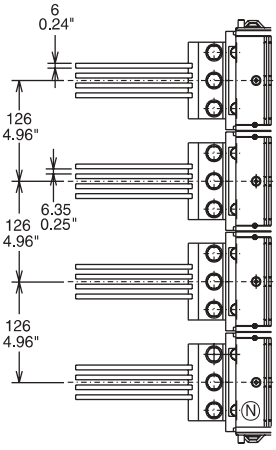

E1

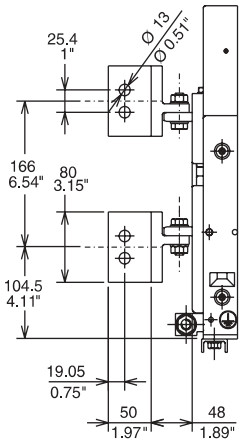

E2

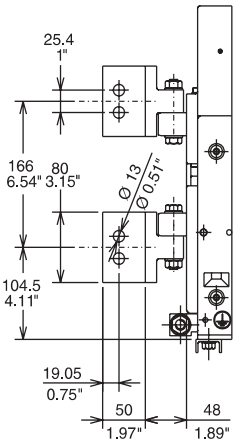

E3 1200÷2000 A

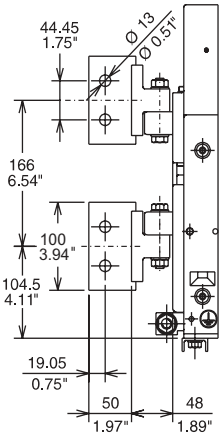

E3 2500 A

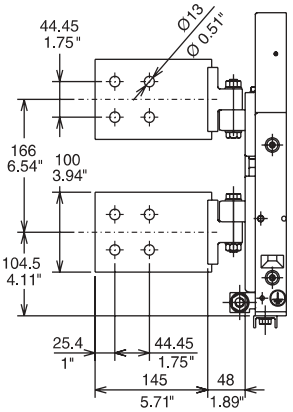

Fig. 38

Fixed circuit-breaker

Basic version with vertical rear terminals

E4

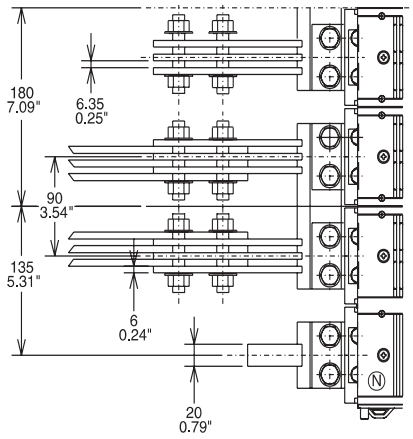

E4/f

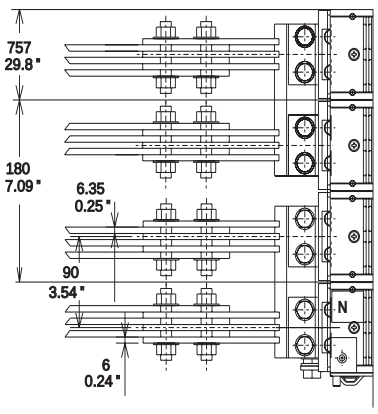

E6

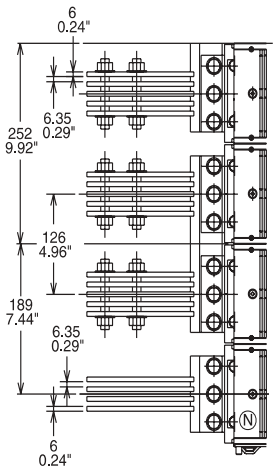

E4

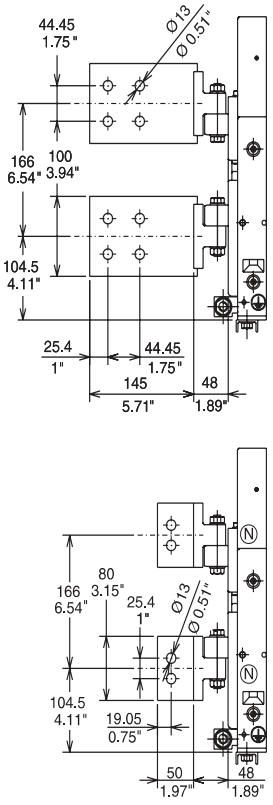

E4/f

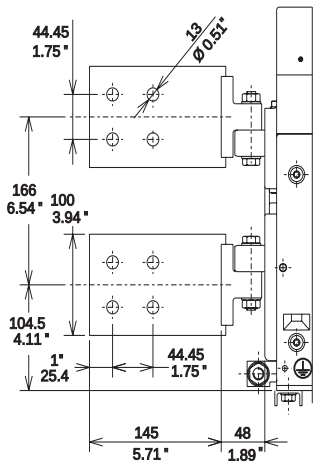

E6

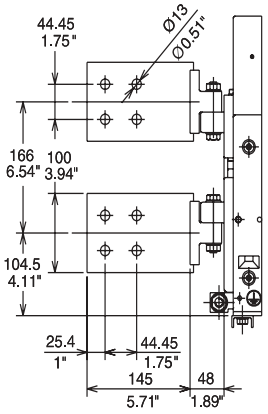

Fig. 39

Withdrawable circuit breaker

Basic version with horizontal rear terminals

E1

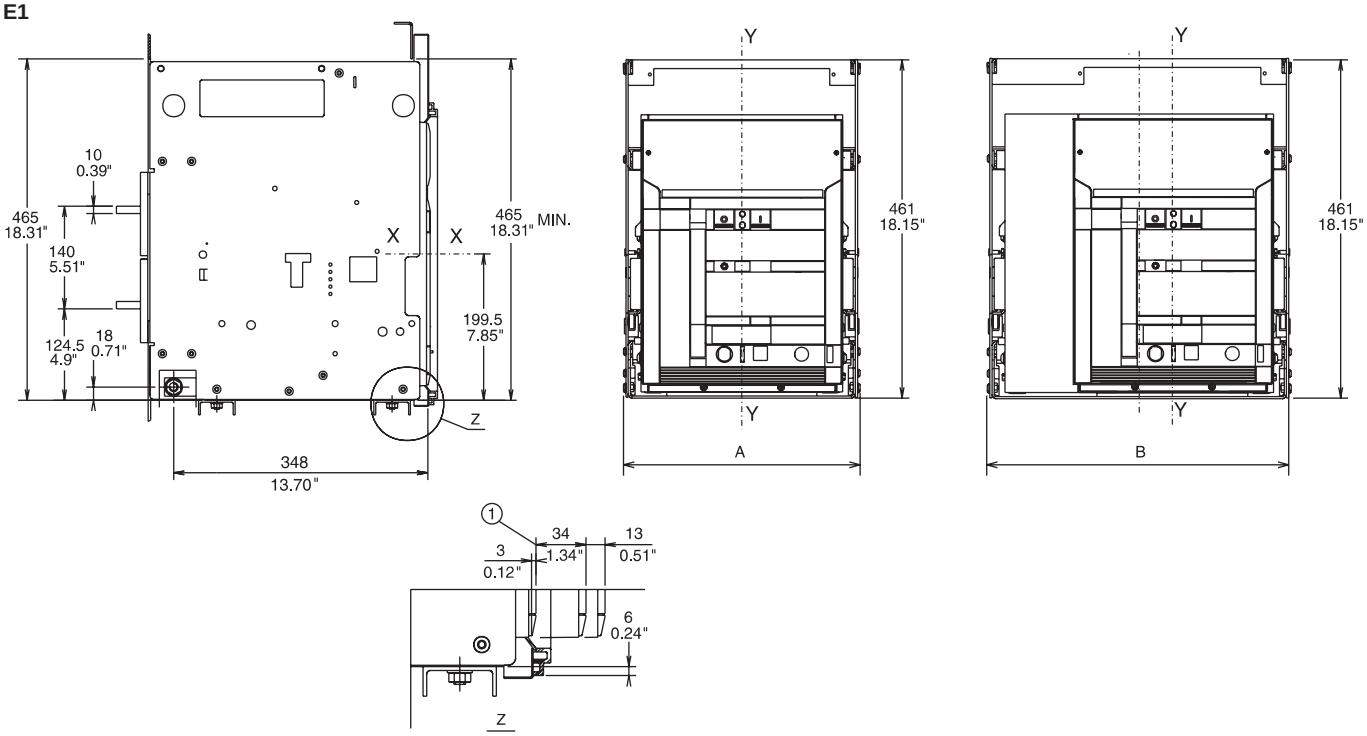

E2-E3-E4-E6

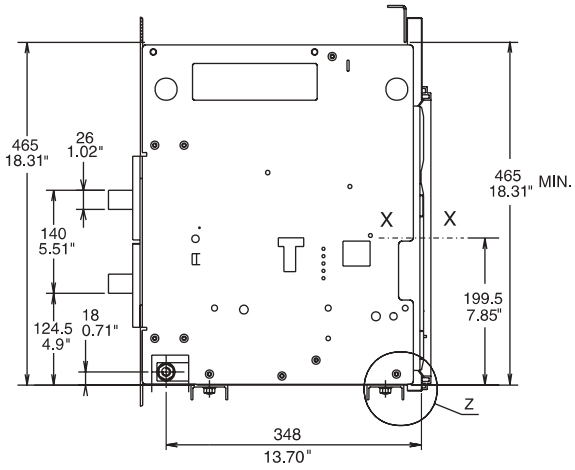

	A 3 Poles	B 4 Poles
E1-A	324/12.76"	414/16.3"
E2-A	324/12.76"	414/16.3"
E3-A	432/17.01"	558/21.97"
E4-A	594/23.39"	684/26.93"
E4/f-A		774/30.47"
E6-A	810/31.89"	936/36.85"

Legend

① Run from connected for a TEST to isolated

Fig. 40

Withdrawable circuit breaker

Basic version with horizontal rear terminals

E1 3 poles / **E2** 3 poles

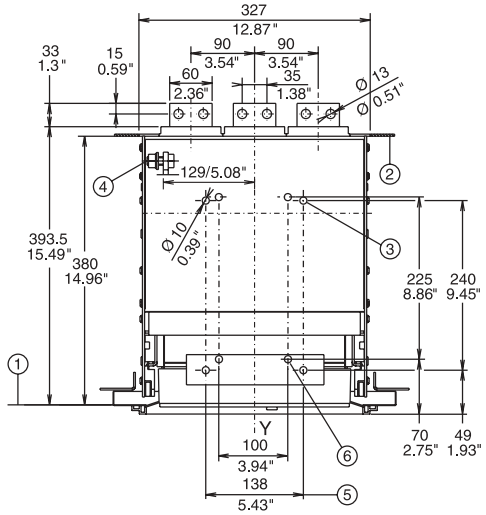

E1 4 poles / **E2** 4 poles

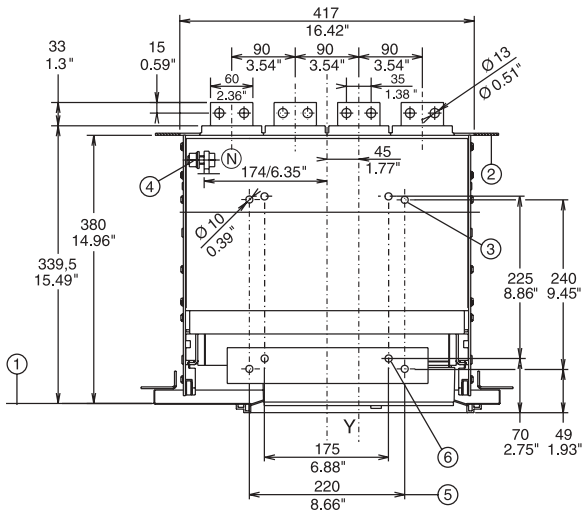

E3 3 poles

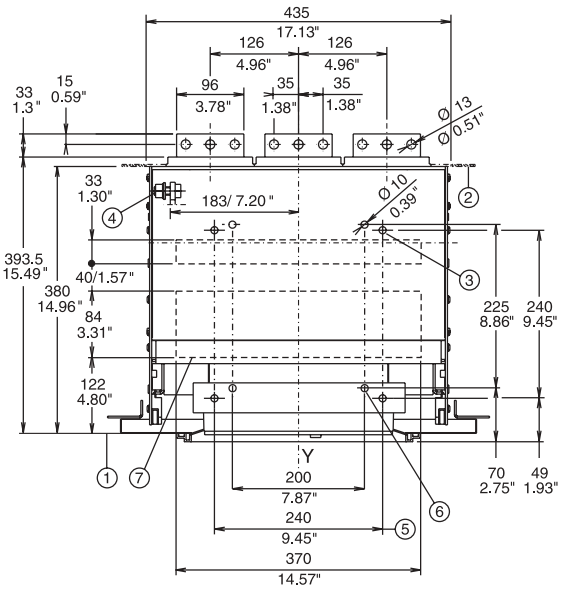

E3 4 poles

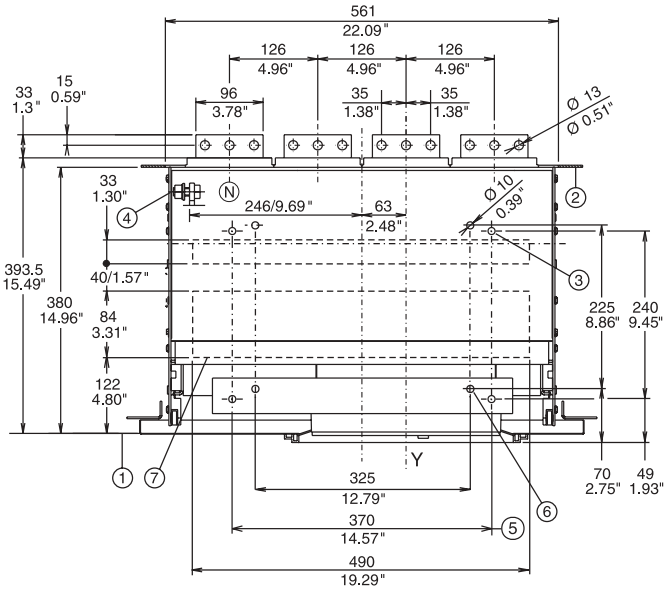

Legend

① Inside edge of compartment door
② Segregation (where foreseen)
③ M8 mounting holes for circuit breaker (included in the supply)
④ No. 1 M12 screw for earthing (included in the supply)
⑤ No. 4 fixed part mounting holes (standard)
⑥ Alternative drilling with 25 mm pitch for fixing fixed part
⑦ Ventilation drilling on the switchboard

Fig. 41

Withdrawable circuit breaker

Basic version with horizontal rear terminals

E4 3 poles

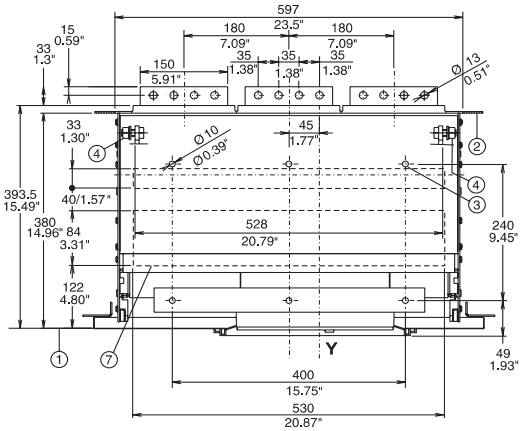

E4 4 poles

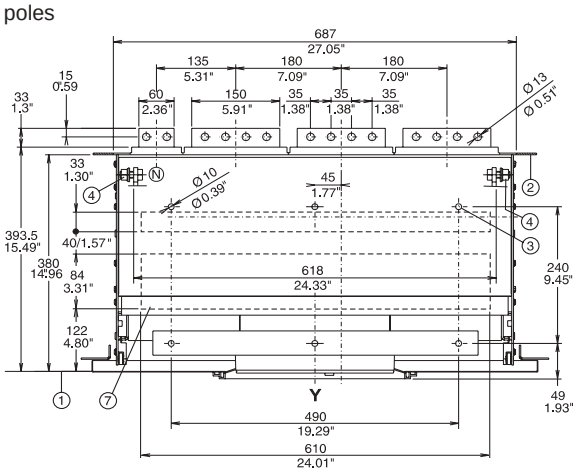

E4/f 4 poles

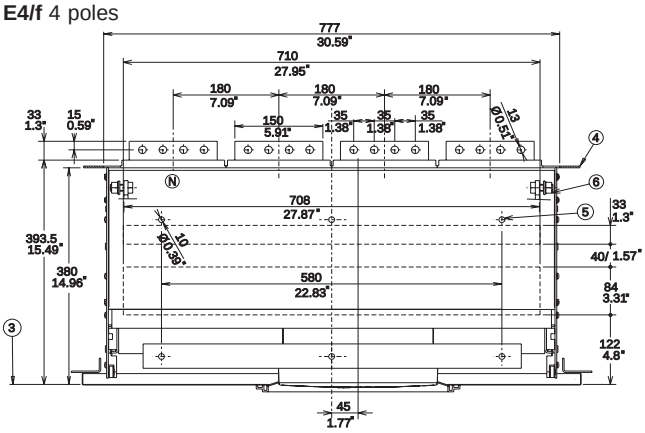

E6 3 poles

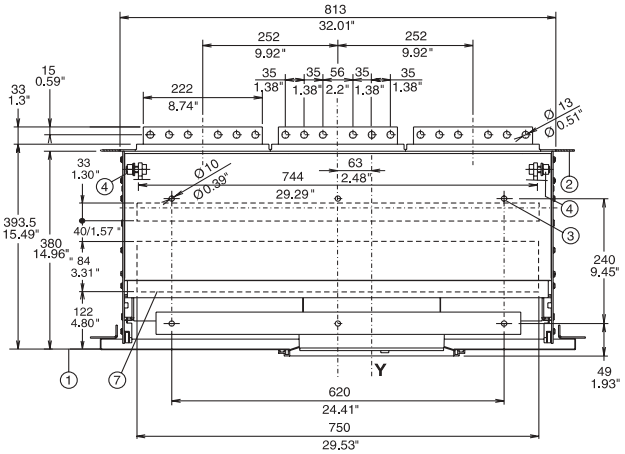

E6 4 poles

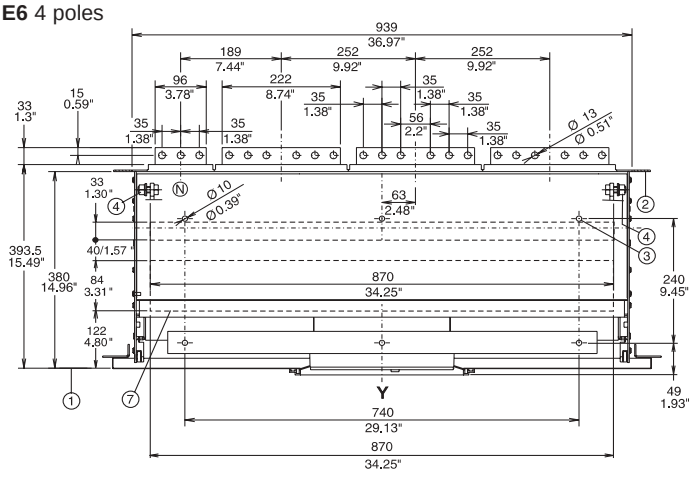

Legend

① Inside edge of compartment door

② Segregation (where foreseen)

③ M8 mounting holes for circuit breaker (included in the supply)

④ No. 1 M12 screw for earthing (included in the supply)

⑦ Ventilation drilling on the switchboard

Fig. 42

Withdrawable circuit breaker

Version with vertical rear terminals

E1 3 poles / **E2** 3 poles

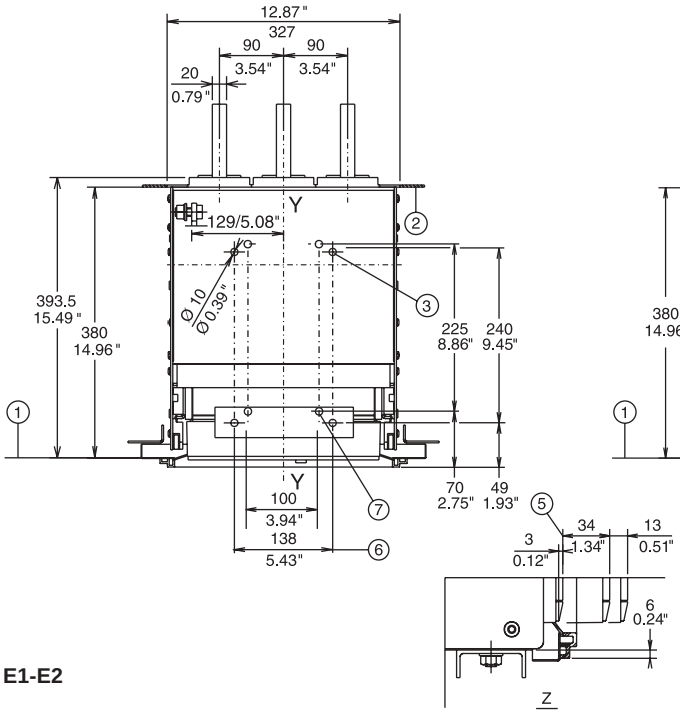

E1 4 poles / **E2** 4 poles

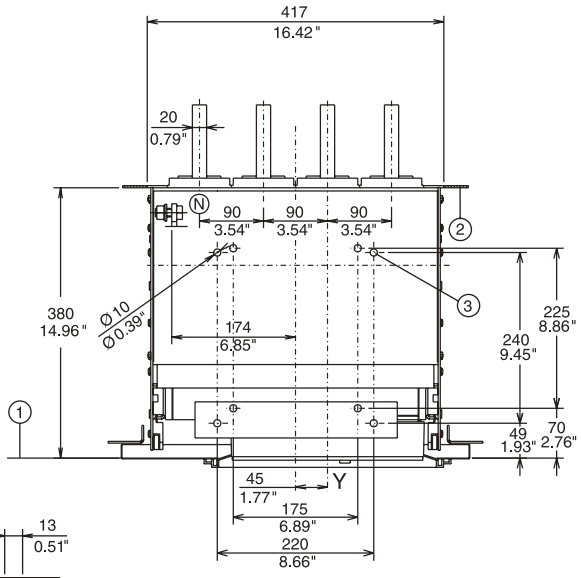

E1-E2

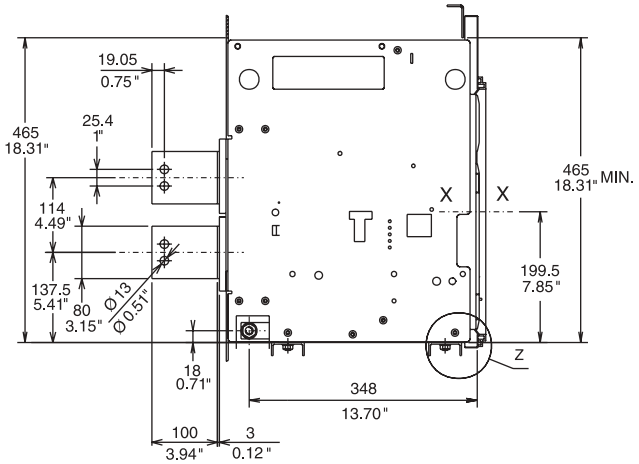

Legend

1. Inside edge of compartment door
2. Segregation (where foreseen)
3. M8 mounting holes for circuit breaker (included in the supply)
5. Run from connected for a TEST to isolated
6. No. 4 fixed part mounting holes (standard)
7. Alternative drilling with 25 mm pitch for fixing fixed part

Fig. 43

Withdrawable circuit breaker

Version with vertical rear terminals

E3 3 poles 1200÷2000 A

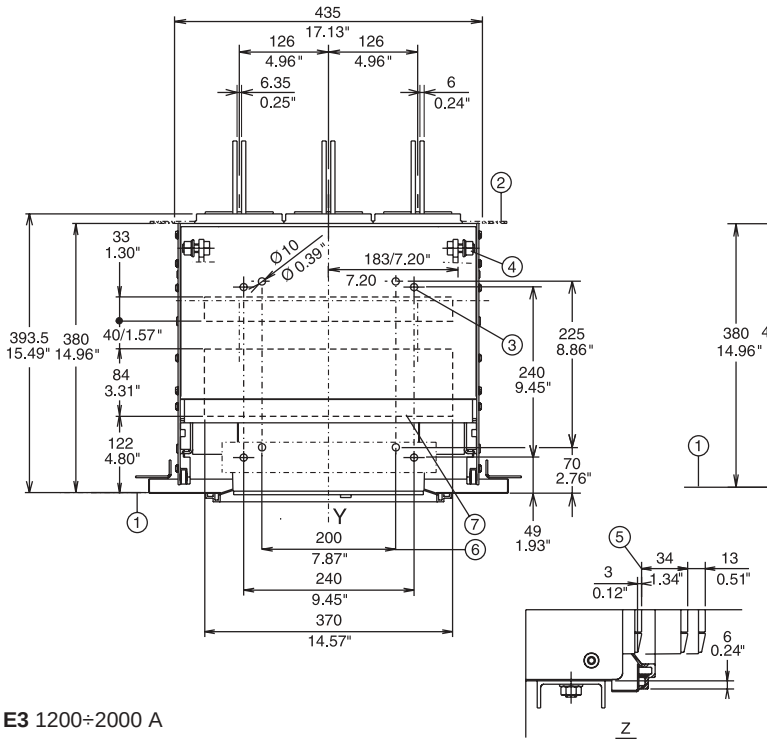

E3 4 poles 1200÷2000 A

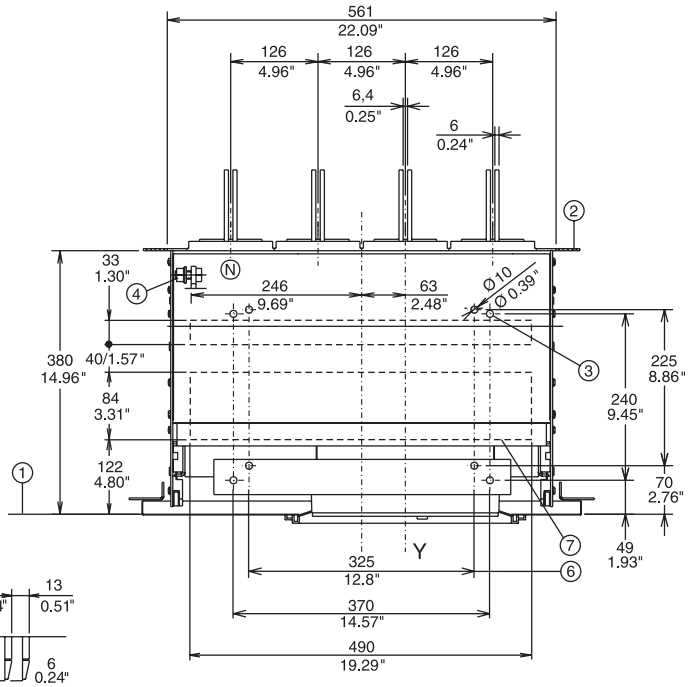

E3 1200÷2000 A

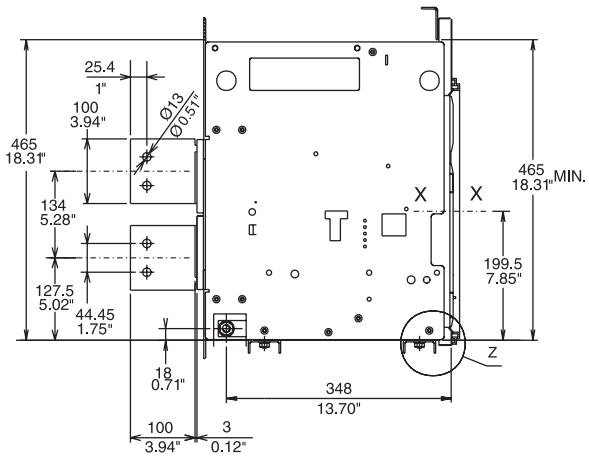

Legend

① Inside edge of compartment door

② Segregation (where foreseen)

③ M8 mounting holes for circuit breaker (included in the supply)

④ No. 2 M12 screws for earthing (included in the supply)

⑤ Run from connected for a TEST to isolated

⑥ Alternative drilling with 25 mm pitch for fixing fixed part

⑦ Ventilation drilling on the switchboard

Fig. 44

Withdrawable circuit breaker

Version with vertical rear terminals

E3 3 poles 2500 A

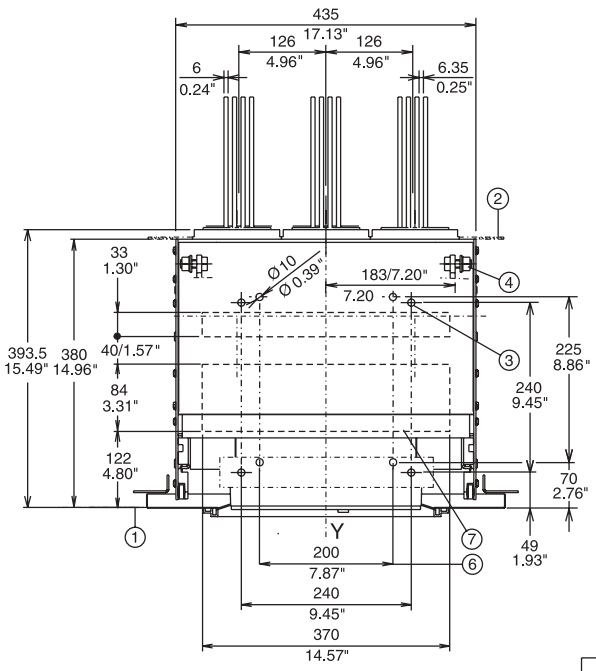

E3 4 poles 2500 A

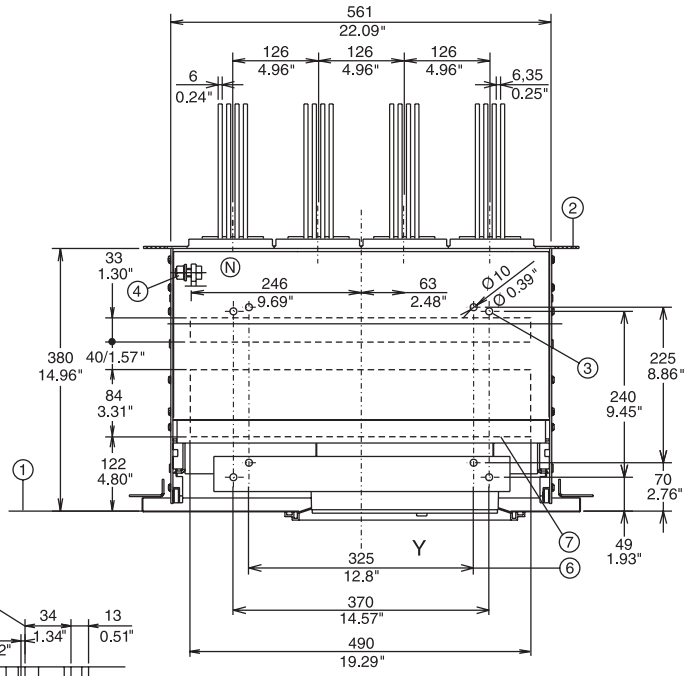



E3 2500 A

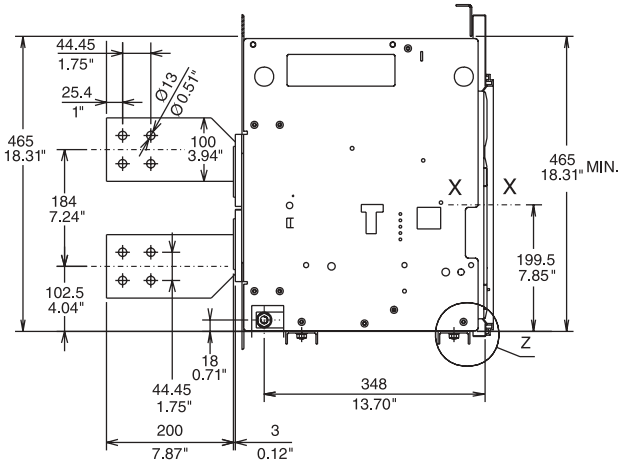

Legend

(1) Inside edge of compartment door

(2) Segregation (where foreseen)

(3) M8 mounting holes for circuit breaker (included in the supply)

(4) No. 2 M12 screws for earthing (included in the supply)

(5) Run from connected for a TEST to isolated

(6) Alternative drilling with 25 mm pitch for fixing fixed part

(7) Ventilation drilling on the switchboard

Fig. 45

Withdrawable circuit breaker

Version with vertical rear terminals

E4 3 poles

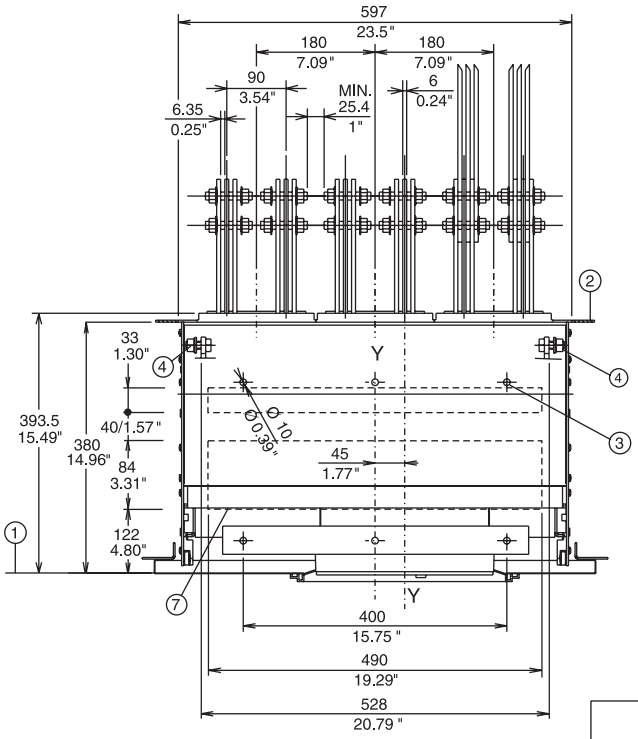

E4 4 poles

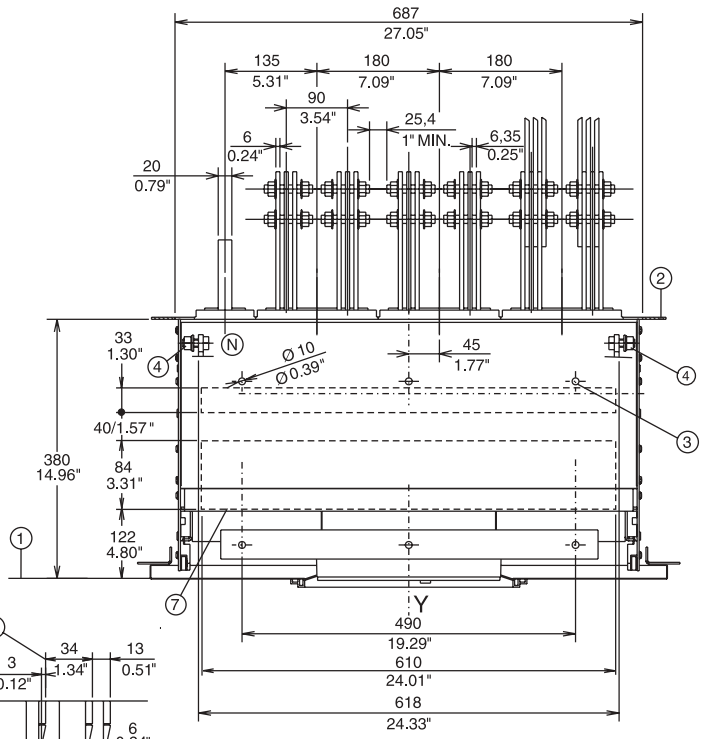



E4

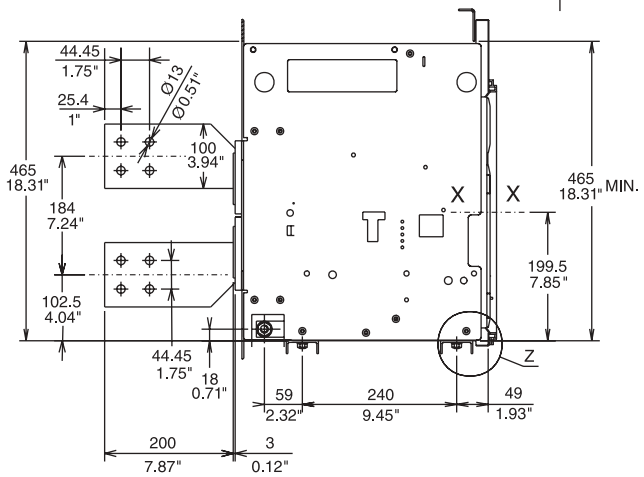

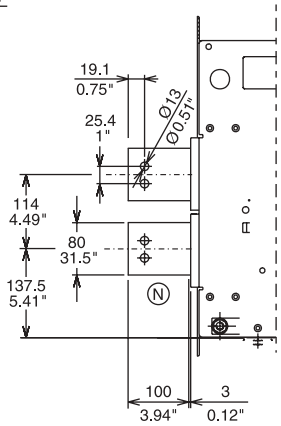

Legend

① Inside edge of compartment door

② Segregation (where foreseen)

③ M8 mounting holes for circuit breaker (included in the supply)

④ No. 2 M12 screws for earthing (included in the supply)

⑤ Run from connected for a TEST to isolated

⑦ Ventilation drilling on the switchboard

Fig. 46

Withdrawable circuit breaker

Version with vertical rear terminals

E4/f 4 poles

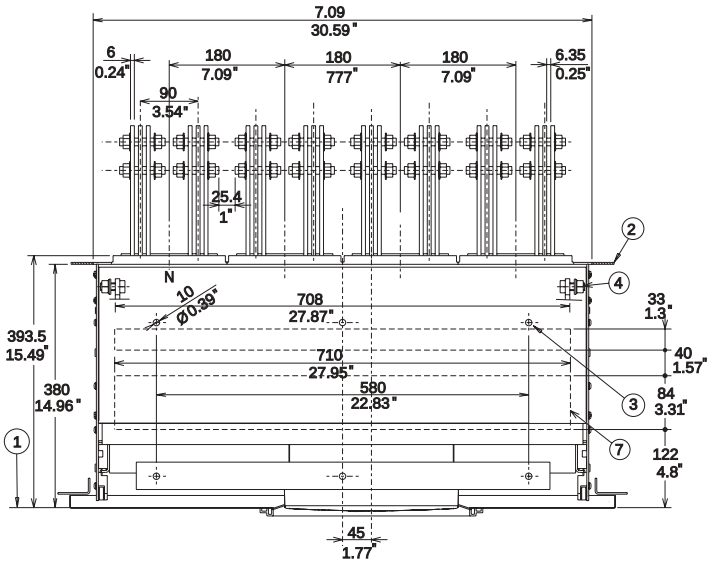



E4

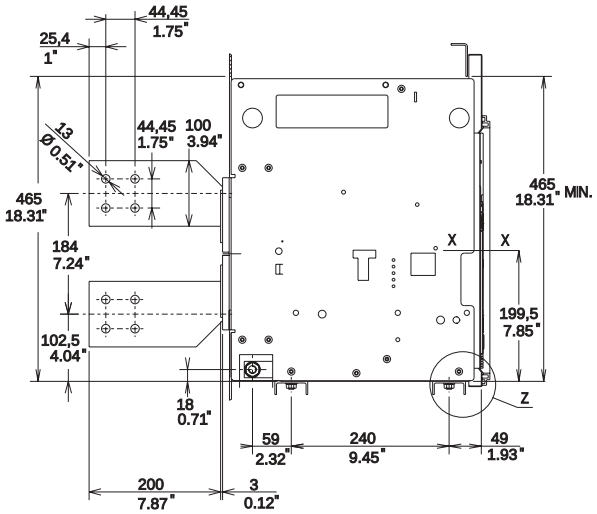

Legend

1. Inside edge of compartment door
2. Segregation (where foreseen)
3. M8 mounting holes for circuit breaker (included in the supply)
4. No. 2 M12 screws for earthing (included in the supply)
5. Run from connected for a TEST to isolated
7. Ventilation drilling on the switchboard

Fig. 47

Withdrawable circuit breaker

Version with vertical rear terminals

E6 3 poles

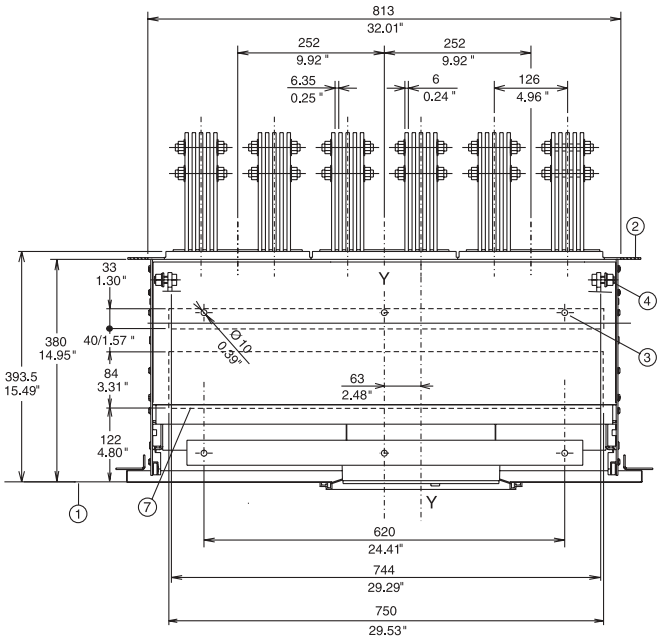

E6 4 poles

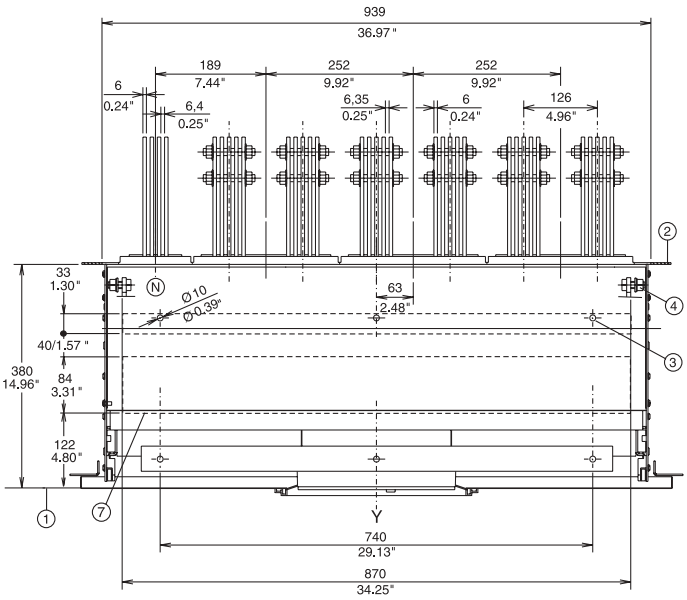

E6

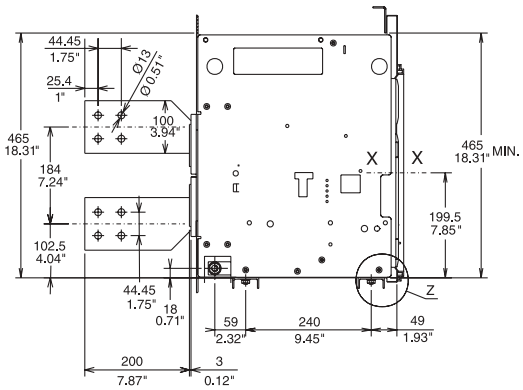



Legend

① Inside edge of compartment door

② Segregation (where foreseen)

③ M8 mounting holes for circuit breaker (included in the supply)

④ No. 2 M12 screws for earthing (included in the supply)

⑤ Run from connected for a TEST to isolated

⑦ Ventilation drilling on the switchboard

Fig. 48

Withdrawable circuit breaker

Version with vertical rear terminals

E3 3 poles 3200 A

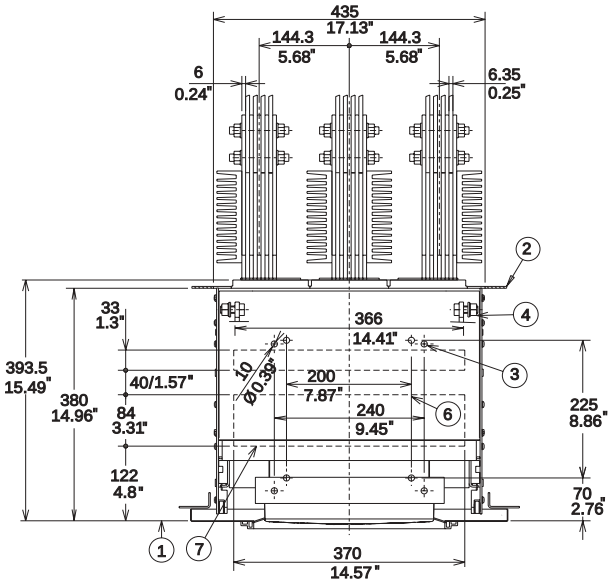

E3 4 poles 3200 A

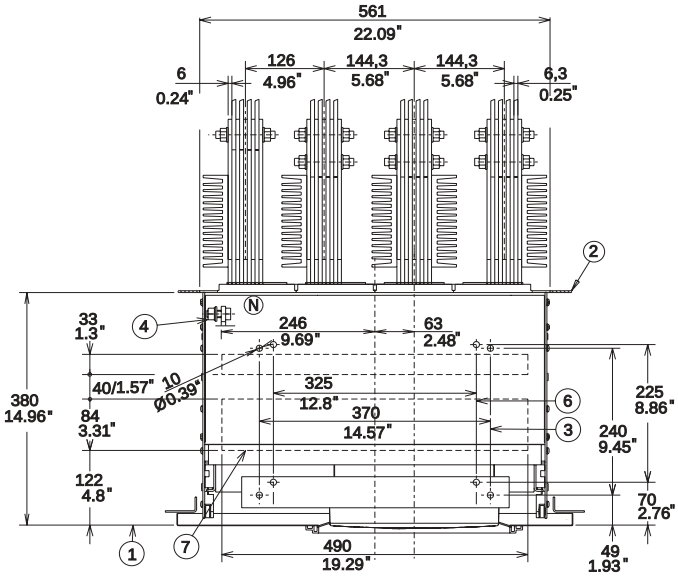

E3 3200 A

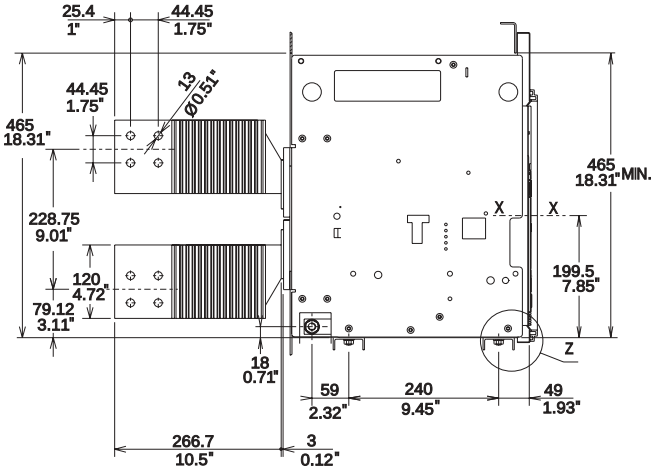



Legend

(1) Inside edge of compartment door

(2) Segregation (where foreseen)

(3) M8 mounting holes for circuit breaker (included in the supply)

(4) No. 2 M12 screws for earthing (included in the supply)

(5) Run from connected for a TEST to isolated

(6) Alternative drilling with 25 mm pitch for fixing fixed part

(7) Ventilation drilling on the switchboard

Fig. 49

Compartment dimensions

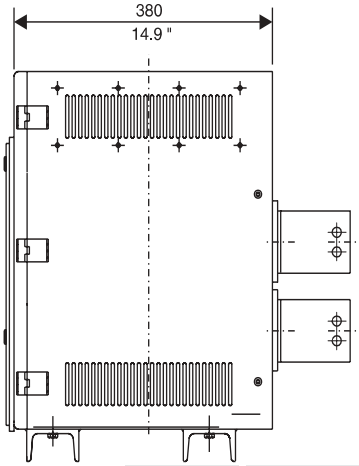

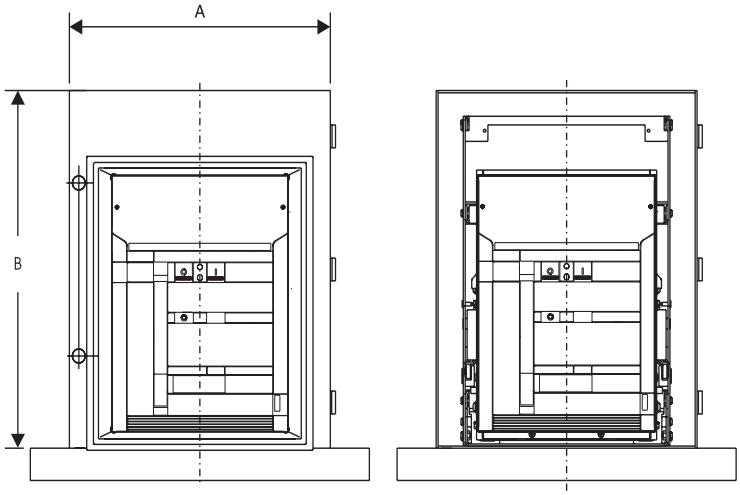

	A 3 Poles	A 4 Poles	B
E1-A	400/15.7"	490/19.3"	500/19.7"
E2-A	400/15.7"	490/19.3"	500/19.7"
E3 N-S-A	500/19.7"	630/24.8"	500/19.7"
E3 H-V-A	500/19.7"	630/24.8"	850/34.5"
E4 S-H-A	700/25.7"	790/30.1"	500/19.7"
E4/f-A		880/34.6"	500/19.7"
E4 V-L-A	700/25.7"	790/30.1"	850/34.5"
E6 H-A	1000/39.3"	1130/44.5"	500/19.7"
E6 V-L-A	1000/39.3"	1130/44.5"	850/34.5"

Suitable to operate at 100% current in a cubicle of the dimensions reported in the figure, with a 48 square inch ventilation (12x4) in the upper portion.

Check cubicle drawing.

Fig. 50

Drilling of compartment door

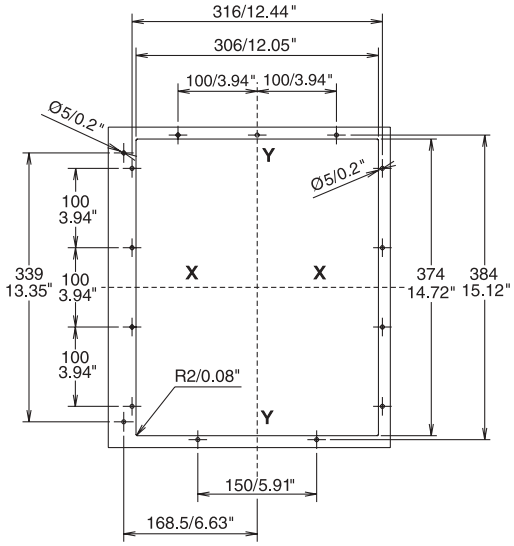

Tightening torque for fastening screws Nm 20 - 177 lb/in
Tightening torque for main terminals Nm 70 - 620 lb/in
Tightening torque of the earthing screw Nm 70 - 620 lb/in

		High resistance M12 screw Quantity per terminal	
		PHASE	NEUTRAL
	E1-E2	2	2
	E3	3	3
	E4	4	2
	E4/f	4	4
	E6	6	3

Fig. 51

Compartment door mechanical lock

Drilling of compartment door

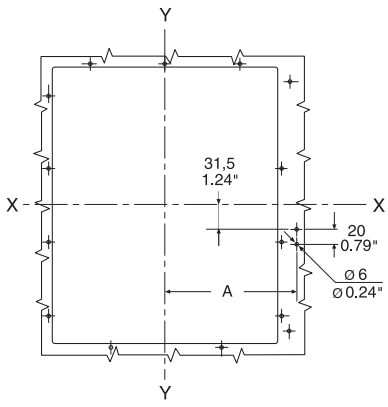

Minimum distance between circuit breaker and switchboard wall

Fixed version

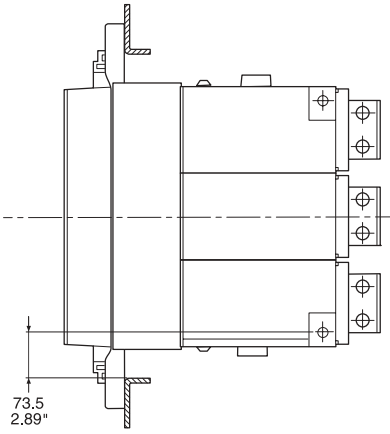

Withdrawable version

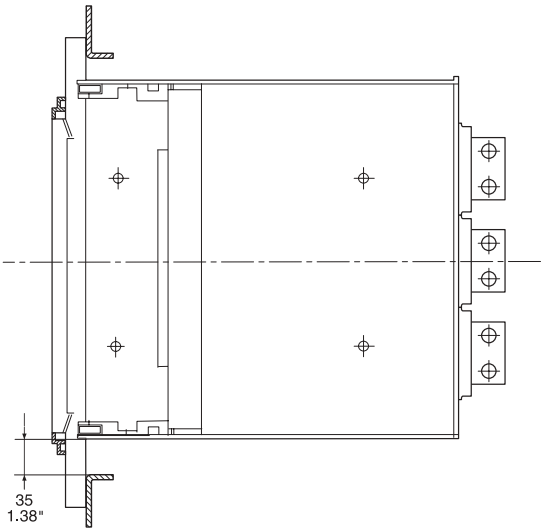

	A 3 Poles	A 4 Poles
E1-A	180/7.09"	180/7.09"
E2-A	180/7.09"	180/7.09"
E3-A	234/9.21"	234/9.21"
E4-A	270/10.63"	360/14.17"
E4/f-A		360/14.17"
E6-A	360/14.17"	486/19.13"

Fig. 52

18. Electrical circuit diagrams

Warning

Before installing the circuit breaker, read notes F and O in the circuit diagrams carefully.
All the external connections to the terminal box are in charge of the customer.

Operating state shown

The diagram is shown under the following conditions:
- withdrawable circuit breaker, open and racked-in
- circuits de-energized
- releases not tripped
- motor operating mechanism with springs discharged.

Versions

The diagram shows a withdrawable circuit breaker but is also valid for fixed circuit breakers.

Fixed version
The control circuits are included between the XV terminals (the X connector is not supplied).
The applications indicated in figures 31, 32 cannot be supplied with this version.

Withdrawable version
The control circuits are included between the poles of the X connector (the XV terminal box is not supplied).

Version without overcurrent releases
The applications indicated in figures 13, 14, 41, 42, 43, 44, 45, 46, 47, 48, 62 cannot be supplied with this version.

Version with electronic release PR121/P
The applications indicated in figures 42, 43, 44, 45, 46, 47, 48 cannot be supplied with this version.

Version with electronic release PR122/P
The applications indicated in figure 41 cannot be supplied with this version.

Version with electronic release PR123/P
The applications indicated in figure 41 cannot be supplied with this version.

Captions

□ = Number of figure for the diagram
* = See the note indicated by the letter
A1 = Circuit breaker applications
A3 = Applications located on the fixed part of the circuit breaker (only provided with withdrawable circuit breakers)
A4 = Indicative apparatus and connections for control and signaling, outside the circuit breaker
A13 = PR021/K signaling unit (outside the circuit breaker)
AY = SACE SOR TEST UNIT control/monitoring unit (see note R)
D = Electronic time-delay device of the undervoltage release, outside the circuit breaker
F1 = Delayed-trip fuse
K51 = PR121/P, PR122/P, PR123/P type electronic release with the following protection functions:
- L against overload with inverse long delay trip - adjustment I1
- S against short circuit with inverse short or independent delay trip - adjustment I2
- I against short circuit with instantaneous trip - adjustment I3
- G against ground fault with inverse short delay trip - adjustment I4

K51/1...8 = PR021/K signaling unit contacts
K51/GZin = (DBin) Zone selectivity: input for protection G (only provided with Vaux and PR122/P or PR123/P releases) or “inverse” input for protection D (only provided with Vaux and PR123/P release)
K51/GZout = (DBout) Zone selectivity: output for protection G (only provided with Vaux and PR122/P or PR123/P releases) or “inverse” output for protection D (only provided with Vaux and PR123/P release)
K51/IN1 = Programmable digital polarised input (only provided with Vaux. and PR122/P or PR123/P releases with PR120/K signal module) at 24 Vdc (K9 ⊕, K7 ⊖)
K51/P1...P4 = Programmable digital signal (only provided with Vaux. and PR122/P or PR123/P releases with PR120/K signal module)
K51/SZin = (DFin) Zone selectivity: input for protection S or “direct” input for protection D (only provided with Vaux. and PR122/P or PR123/P releases)
K51/SZout = (DFout) Zone selectivity: output for protection S or “direct” output for protection D (only provided with Vaux. and PR122/P or PR123/P releases)
K51/YC = Closing control from PR122/P or PR123/P P electronic release with PR120/D-M communication module
K51/YO = Opening control from PR122/P or PR123/P electronic release with PR120/D-M communication module
M = Motor for closing spring charging
Q = Circuit breaker
Q/1...27 = Circuit breaker auxiliary contacts
S33M/1...3 = Limit contacts of spring charging motor
S43 = Changeover switch for setting remote/local control
S51 = Contact for electric signal indicating circuit breaker opened by overcurrent release. The circuit breaker can only be closed again after the reset button is pressed or after the electric reset coil YR has been powered (if present).
S75E/1.4 = Contacts for electric signal indicating circuit breaker in open position (only for withdrawable version circuit breakers)
S75I/1..5 = Contacts for electric signal indicating circuit breaker racked-in (only for withdrawable version circuit breakers)
S75T/1..4 = Contact for electric signal indicating circuit breaker in test position (only for withdrawable version circuit breakers)
CS = Button or contact to close the circuit breaker
SO = Button or contact to open the circuit breaker

SO1 = Button or contact to open the circuit breaker with delayed trip
SO2 = Button or contact to open the circuit breaker with instantaneous trip
SR = Button or contact to reset the circuit breaker
TI/L1 = Current transformer located on phase L1
TI/L2 = Current transformer located on phase L2
TI/L3 = Current transformer located on phase L3
Vaux = Auxiliary power voltage (see note F)
UI/L1 = Current sensor (Rogowski coil) located on phase L1
UI/L2 = Current sensor (Rogowski coil) located on phase L2
UI/L3 = Current sensor (Rogowski coil) located on phase L3
UI/N = Current sensor (Rogowski coil) located on the neutral
UI/0 = Current sensor (Rogowski coil) located on the conductor connecting the MV/LV transformer star center to the ground (see note G)
W1 = Serial interface with the control system (external bus): EIA RS485 interface (see note E)
W2 = Serial interface with the accessories of the PR121/P, PR122/P and PR123/P releases (internal bus)
X = Delivery connector for auxiliary circuits of withdrawable circuit breaker
X1...X7 = Connectors for the circuit breaker applications
XF = Delivery terminal box for position contacts of the withdrawable circuit breaker (located on the fixed part of the circuit breaker)
XK1 = Connector for the power circuits of the PR121/P, PR122/P and PR123/P releases
XK2 - XK3 = Connector for the auxiliary power circuits of the PR121/P, PR122/P and PR123/P releases
XK5 = Connectors for the PR120/V module
XO = Connector for the YO1 release
XV = Delivery terminal box for auxiliary circuits of fixed version circuit breaker
YC = Shunt closing release
YO = Shunt opening release
YO1 = Overcurrent shunt opening release (trip coil)
YO2 = Second shunt opening release (see note Q)
YR = Coil for electric circuit breaker reset
YU = Undervoltage release (see notes B and Q)
XK4 = Connector for open/close signal
XK5 = Voltage connector for PR120/V
XK6 = Connector for PR120/K
XK7 = Connector for "charged spring" and "racked in/racked out" for PR120/D-M

Description of figures

Fig. 1 = Closing spring charging motor circuit.
Fig. 2 = Shunt closing release circuit.
Fig. 4 = Shunt opening release.
Fig. 6 = Instantaneous undervoltage release (see notes B and Q).
Fig. 7 = Undervoltage release with electronic time-delay device, outside the circuit breaker (see notes B and Q).
Fig. 8 = Second shunt opening release (see note Q)
Fig. 11 = Contact for electrical signaling of springs charged.
Fig. 12 = Contact for electrical signaling of undervoltage release energized (see notes B and S).
Fig. 13 = Contact for electrical signaling that the circuit breaker is open because the overcurrent release has tripped. The circuit breaker can only be closed after the reset pushbutton has been pressed.
Fig. 14 = Contact for electrical signaling that the circuit breaker is open because the overcurrent release and electric reset coil have tripped. The circuit breaker can only be closed after the reset pushbutton has been pressed or after the coil has been powered.
Fig. 21 = First pack of auxiliary contacts for circuit breaker.
Fig. 22 = Second pack of auxiliary contacts for circuit breaker (see note V).
Fig. 23 = Third pack of additional auxiliary contacts outside the circuit breaker.
Fig. 31 = First pack of contacts for electrical signaling that the circuit breaker is in the racked-in, test or racked-out position.
Fig. 32 = Second pack of contacts for electrical signaling that the circuit breaker is in the racked-in, test or racked-out position.
Fig. 41 = Auxiliary circuits for the PR121/P release (see note F).
Fig. 42 = Auxiliary circuits for the PR122/P and PR123/P release (see notes F, N and V).
Fig. 43 = Circuits for measurement module PR120/V for PR122/P and PR123/P releases connected internally to the three-pole or four-pole circuit breaker (optional for PR122/P release; see note U).
Fig. 44 = Circuits for measurement module PR120/V for PR122/P and PR123/P releases connected externally to the circuit breaker (optional for PR122/P release; see notes O and U).
Fig. 45 = Circuits for communication module PR120/D-M for PR122/P and PR123/P releases (optional; see note E).
Fig. 46 = Circuits for signal module PR120/K for PR122/P and PR123/P releases - connection 1 (optional; see note V).
Fig. 47 = Circuits for signal module PR120/K for PR122/P and PR123/P releases - connection 2 (optional; see note V).
Fig. 48 = Circuits for measurement module PR120/V for PR122/P and PR123/P releases connected internally to the three-pole circuit breaker with external neutral (optional for PR122/P release; see note U).
Fig. 61 = SACE SOR TEST UNIT control/monitoring unit (see note R).
Fig. 62 = PR021/K signaling unit (available with all releases)

Incompatibility

The circuits shown in the following figures cannot be powered on the same circuit breaker at the same time:
6 - 7 - 8
13 - 14
22 - 46 - 47
43 - 44 - 48

Notes

A) The circuit breaker is only fitted with the applications specified in the ABB order confirmation. To make out the order, please consult the apparatus catalogue.

B) The undervoltage release is provided for power supply branched on the supply side of the circuit breaker or from an independent source: circuit breaker closing is only allowed with the release energized (the lock on closing is made mechanically).
In the case where there is the same power supply for the closing and undervoltage releases and automatic circuit breaker closing is required, on return of the auxiliary voltage, a 30 millisecond delay must be introduced between the instant of consent of the undervoltage release and powering of the closing coil. This can be carried out by means of a circuit outside the circuit breaker including a permanent closing contact, the contact indicated in figure 12 and a time-delay relay.

E) For connection of the EIA RS485 see document RH0298 on MODBUS communication.

F) The Vaux. auxiliary voltage allows activation of all the functions of the PR121/P, PR122/P and PR123/P releases.
Since the Vaux must be isolated from the ground, “galvanically separated converters” compliant with IEC 60950 (UL 1950) or equivalent must be used to guarantee a shared current or a runaway current (see IEC 478/1, CEI 22/3) of not more than 3.5mA, IEC 60364-41 and CEI 64-8.

G) Protection against ground fault is available with the PR122/P and PR123/P releases by means of a current sensor located on the conductor which connects the MV/LV transformer star center to ground.
The connection between terminals 1 and 2 (or 3) of the UI/O current transformer and poles T7 and T8 of the X (or XV) connector must be made using a shielded and corded two-pole cable (e.g. BELDEN 3105A/3106A) not longer than 15 m. The shield must be grounded on the circuit breaker side and on the current sensor side

N) With PR122/P and PR123/P releases, connection with the zone selectivity inputs and outputs must be made using a shielded and corded two-pole cable (e.g. BELDEN 3105A/3106A) not longer than 300m. The shield must be grounded on the selectivity input side.

O) For systems with nominal voltage greater than 690V use of an insolated voltage transformer is mandatory for connection to the busbars (to be connected in compliance with the diagrams on sheet 1SDH000460R0508).

P) With PR122/P - PR123/P releases with communication module PR120/D-M, coils YO and YC can be operated directly by contacts K51/YO and K51/YC with maximum voltages of 110-120 VDC and 240-250 VAC.

Q) The second shunt opening release must be installed as an alternative to the undervoltage release.

R) Operation of the SACE SOR TEST UNIT + shunt opening release (YO) system is guaranteed starting from 75% of the Vaux of the shunt opening release itself.
When the YO power supply contact is closing (short circuit of terminals 4 and 5), the SACE SOR TEST UNIT cannot determine the state of the opening coil. For this reason:
- If the opening coil has a continuous power supply, the TEST FAILED and ALARM signals will be activated
- If the control of the opening coil is carried out impulsively, the TEST FAILED signal may be activated at the same moment. In this case, the TEST FAILED signal should only be considered an actual alarm signal if it remains on for longer than 20s.

S) Also available in the normally closed contact version

U) The measurement module PR120/V is always supplied with relay PR123/P.

V) If fig. 22 (second pack of auxiliary contacts for circuit breaker) is present simultaneously with relay PR122/P (or PR123/P), the contacts for the selectivity zone in fig. 42 (K51/Zin, K51/Zout, K51/Gzin and K51/Gzout) are not wired. Moreover, the signal module PR120/K in figures 46 and 47 cannot be supplied.

Graphic signs for circuit diagrams (IEC 60617 and CEI 3-14...3-26)


Shield (can be drawn in any shape)


Terminal or clamp


Changeover position contact with momentary trip (limit switch)


Timing


Socket and plug (female and male)


Molded case circuit breaker with automatic opening


Mechanical or electric connection



Motor (general symbol)


Molded case circuit breaker


Manual mechanical operating mechanism (general case)


Current transformer


Control coil (general symbol)


Rotary operating mechanism


Voltage transformer


Instantaneous overcurrent relay


Pushbutton operating mechanism


Three-phase transformer winding, star connection


Overcurrent relay with short adjustable time-delay


Equipotentiality


Closing contact


Overcurrent relay with short inverse time-delay


Galvanically separated converter


Opening contact with automatic changeover


Overcurrent relay with long inverse time-delay


Shielded cable conductors (e.g. three wires)


Changeover contact


Overcurrent relay for ground failure with short inverse time-delay

Corded conductors or wires (e.g. 3 wires)


Closing position contact (limit switch)


Fuse (general symbol)


Conductor connection


Opening position contact (limit switch)


Current sensor

Circuit diagrams – operating status

Three-pole circuit breaker with electronic release PR121/P, PR122/P or PR123/P

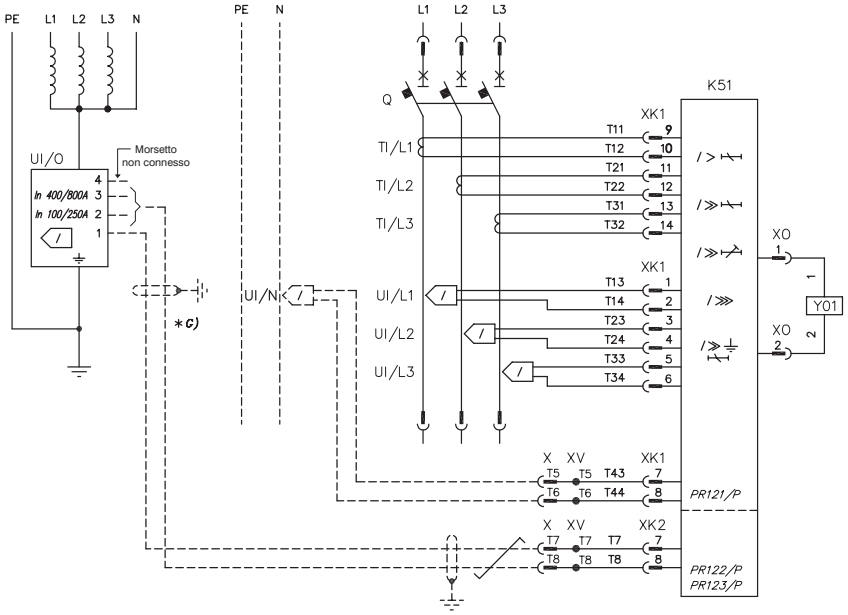

Four-pole circuit breaker with electronic release PR121/P, PR122/P, PR123/P.

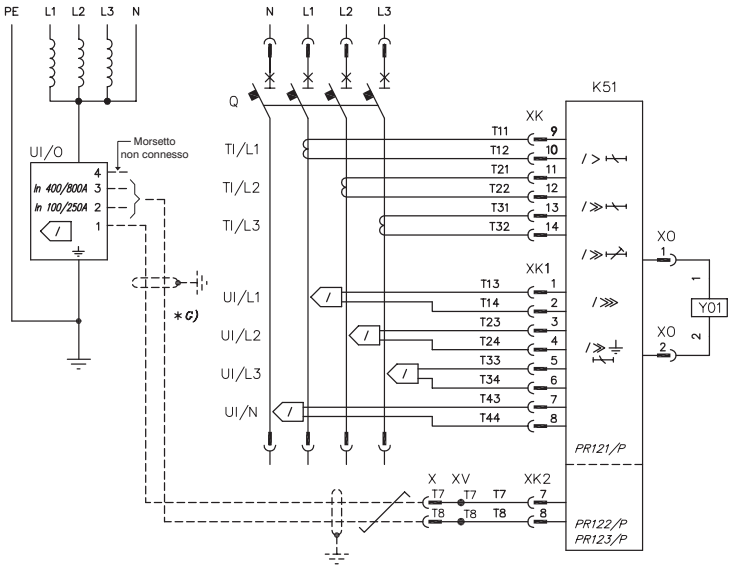

Three-pole or four-pole molded case circuit breaker

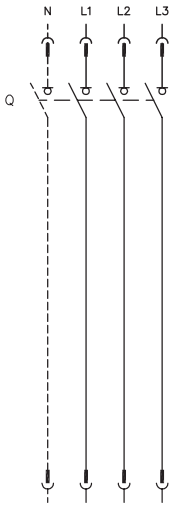

Model	L2564			Apparatus	**Emax UL**	Scale
				Doc.N°	**1SDH000532R0002**	Page N° **158/163**

Motor operating mechanism, opening, closing and undervoltage releases

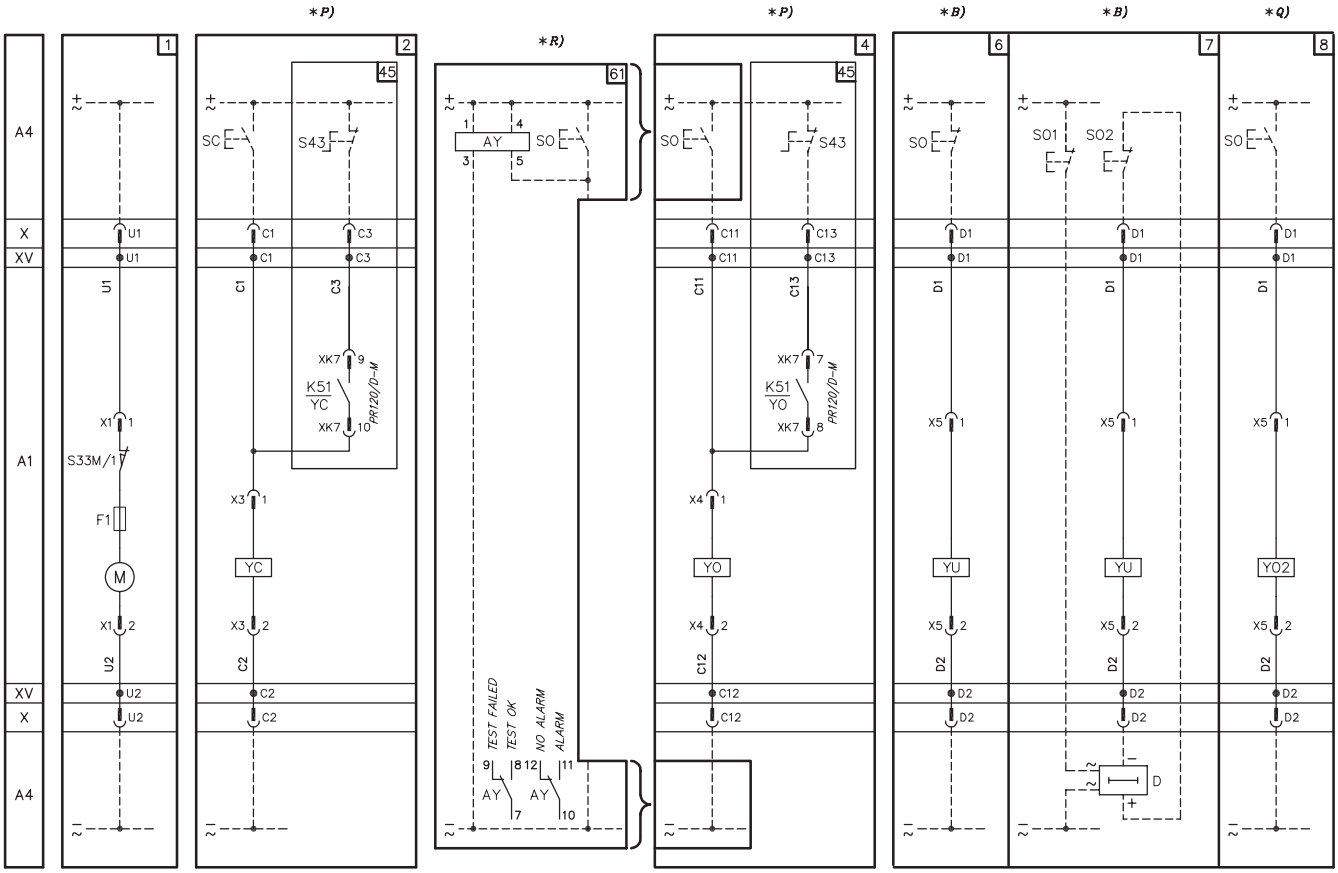

Signaling contacts

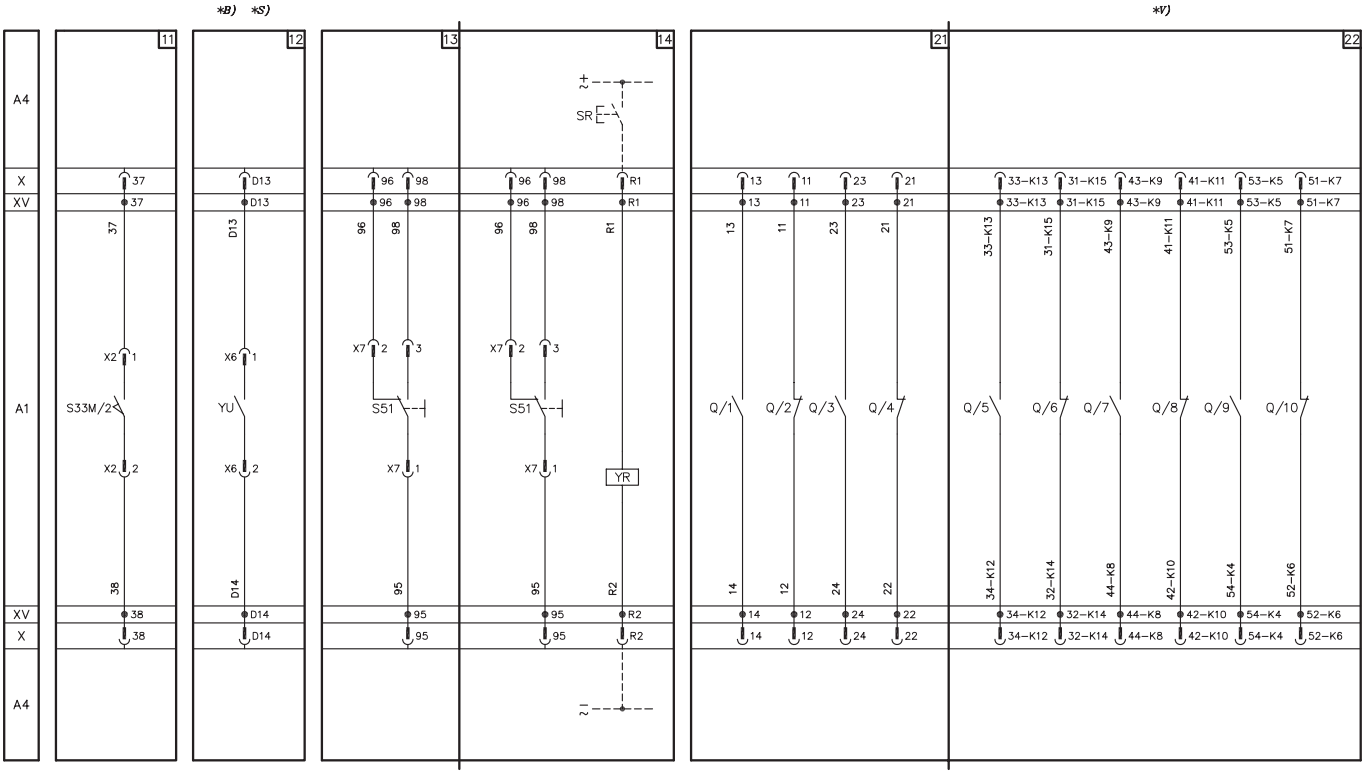

Model	L2564			Apparatus	Emax UL	Scale
				Doc. N°	1SDH000532R0002	Page N° 159/163

Signaling contacts

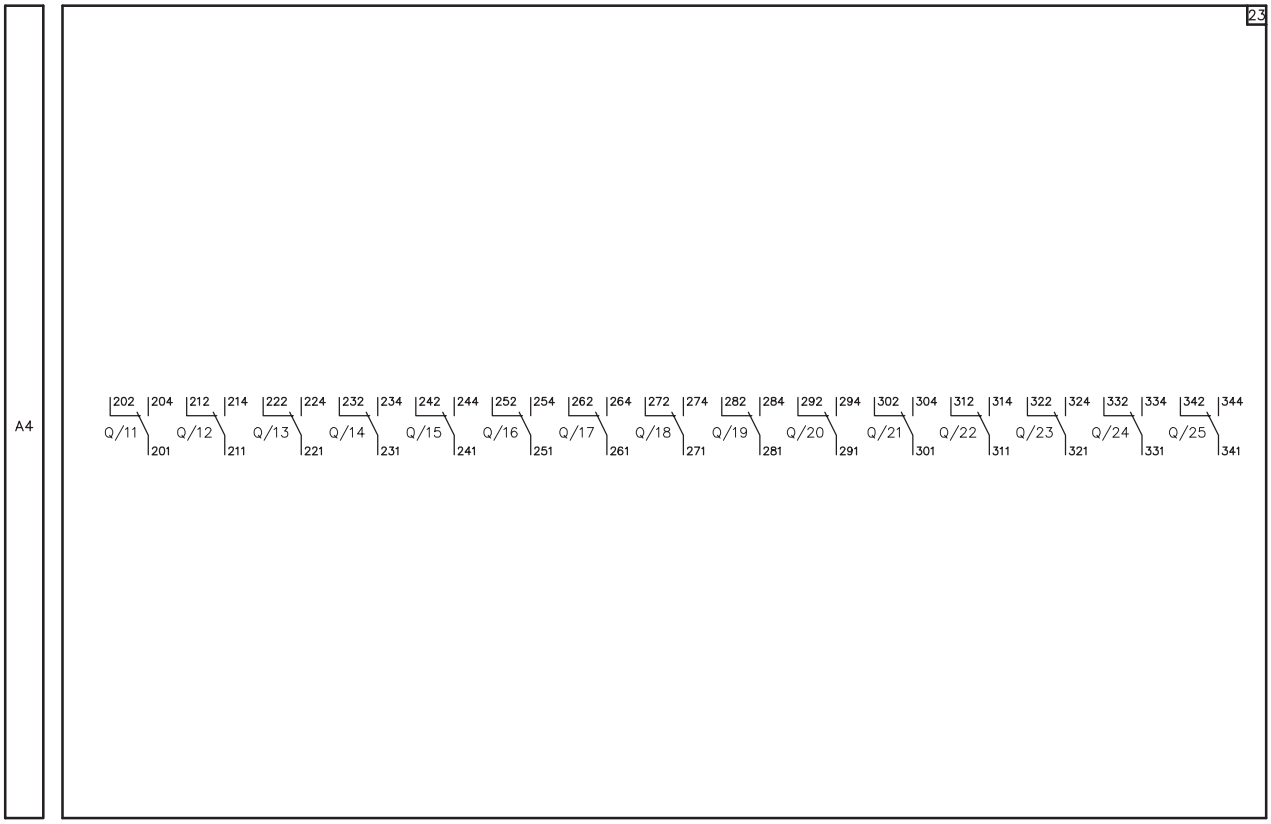

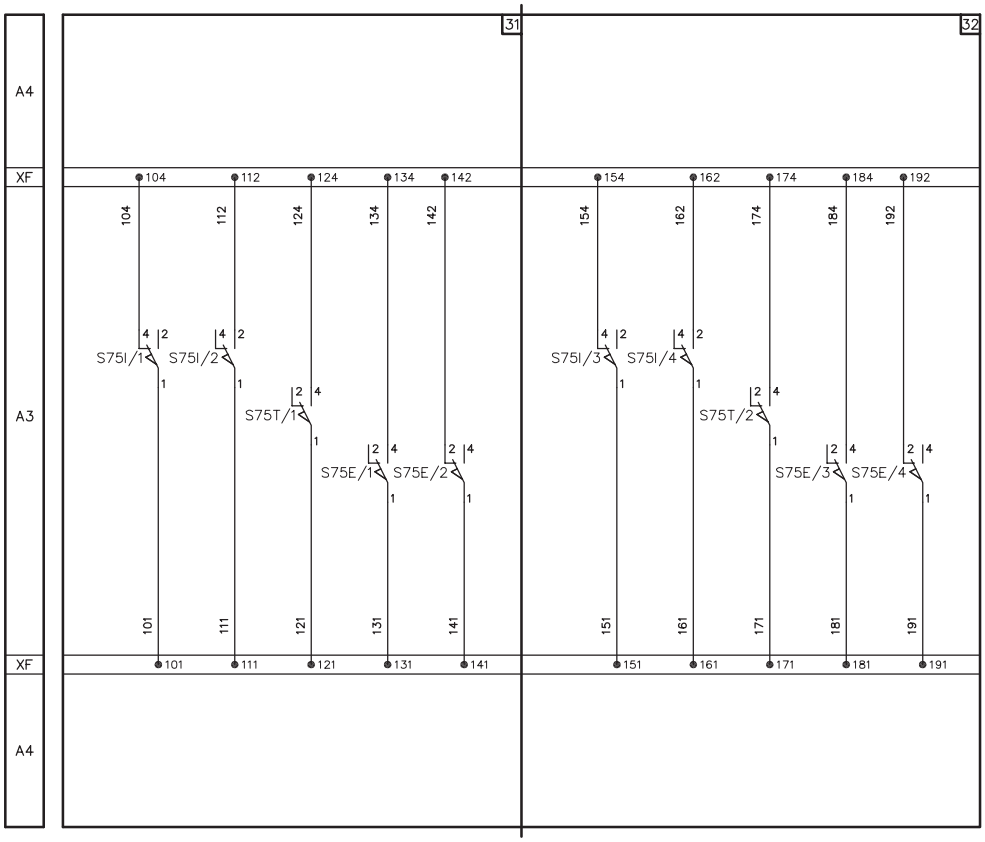

Model	L2564			Apparatus	Emax UL	Scale
				Doc.N°	1SDH000532R0002	Page N° 160/163

Auxiliary circuits for PR121/P, PR122/P and PR123/P releases

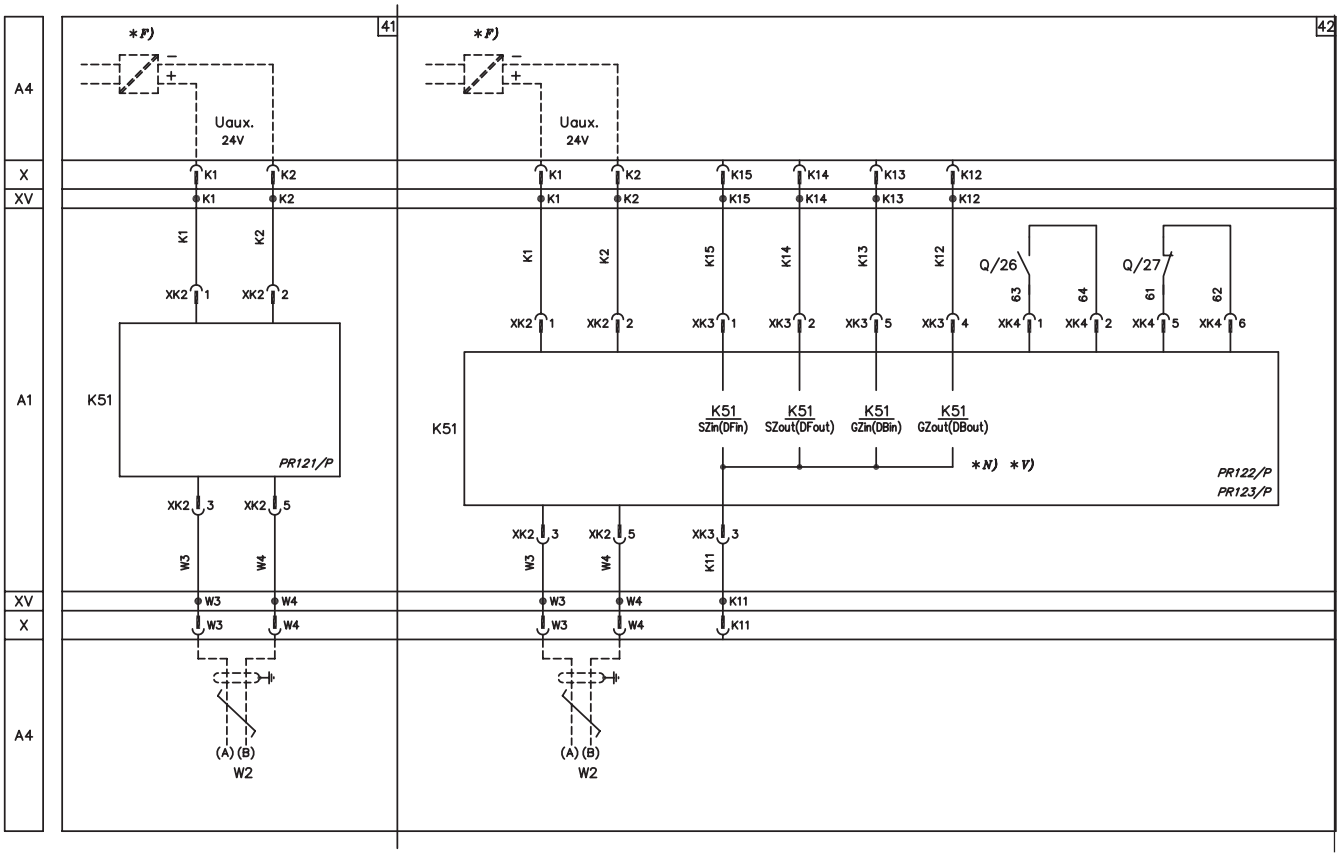

Measurement module PR120/V

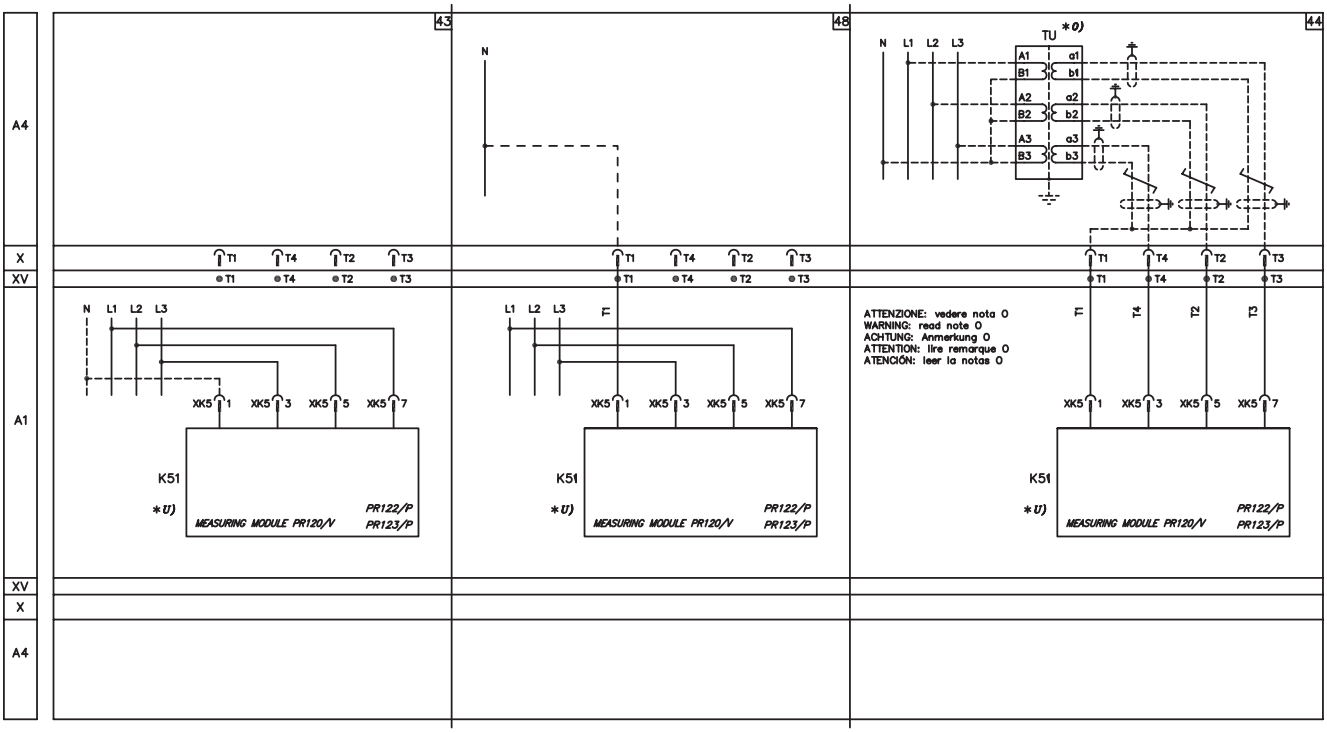

Communication module PR120/D-M

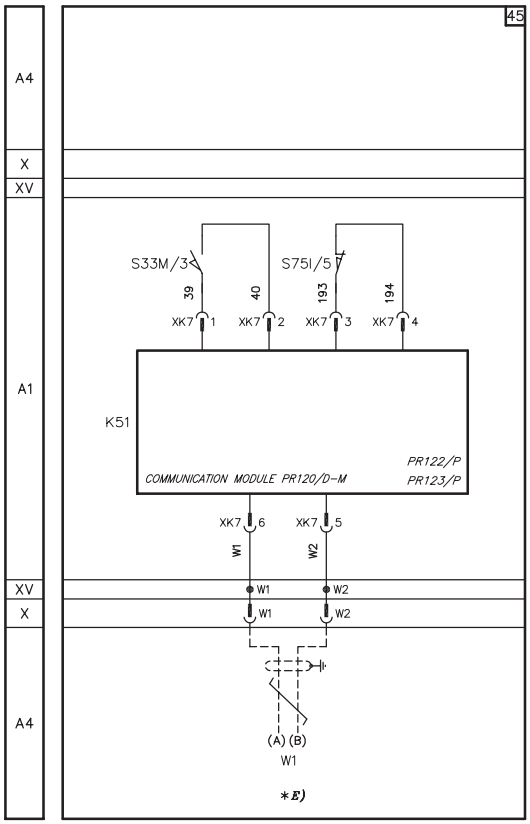

Signaling module PR120/K

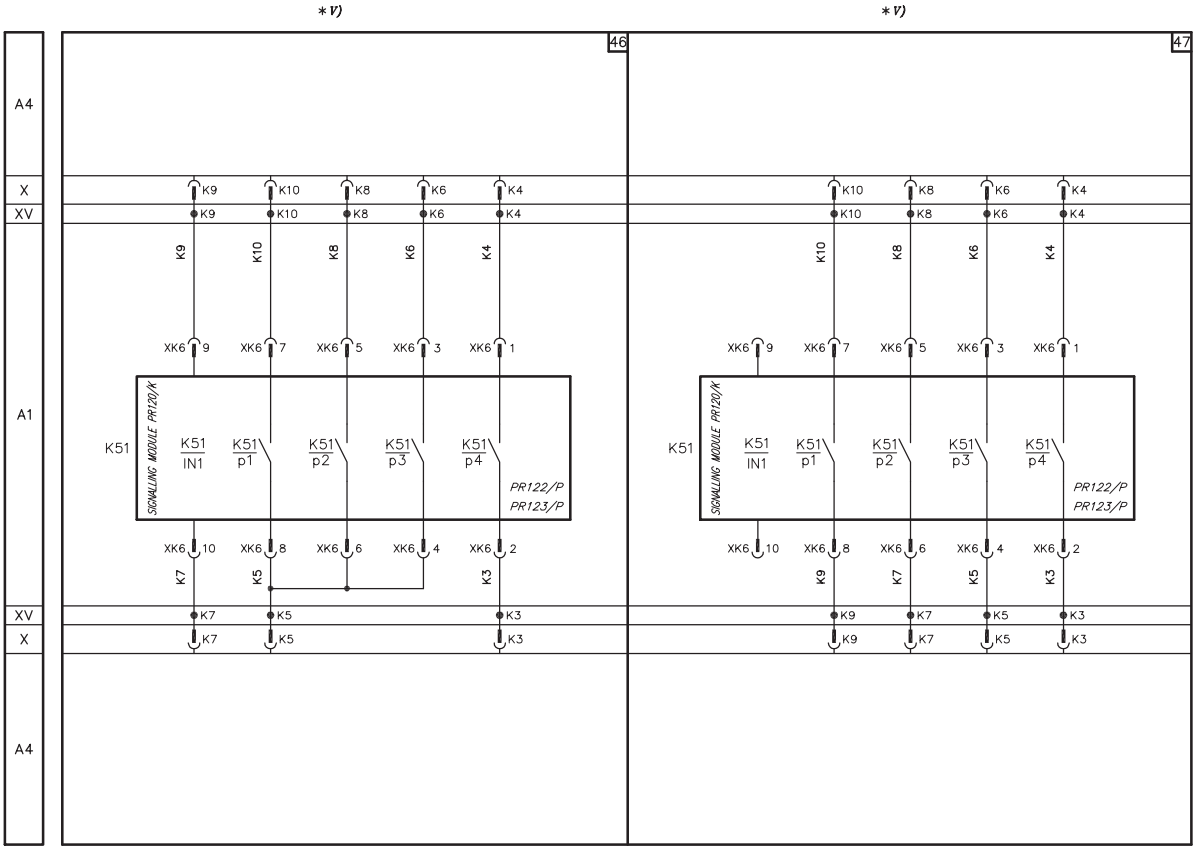

Model	L2564			Apparatus	Emax UL	Scale
				Doc.N°	1SDH000532R0002	Page N° 162/163

Signaling unit PR021/K

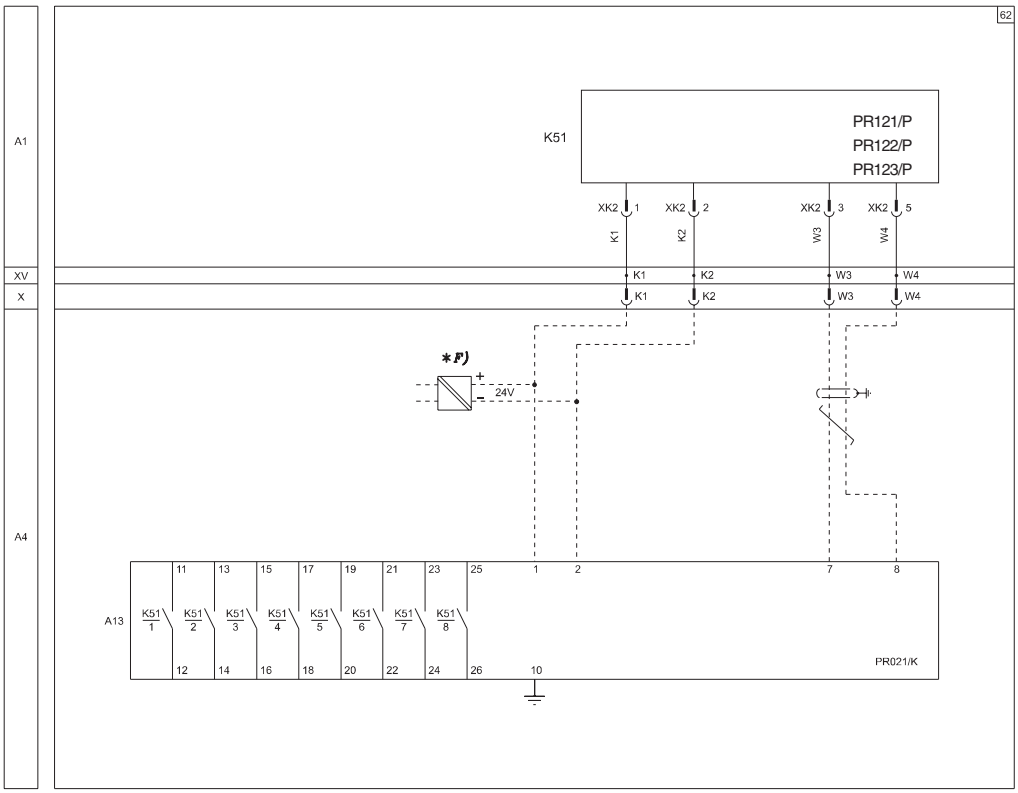

Due to possible developments of standards as well as of materials, the characteristics and dimensions specified in the present catalogue may only be considered binding after confirmation by ABB SACE.

1SDH000532R0002 L2564

ABB SACE S.p.A.
Divisione Interruttori B.T.
Via Baioni, 35 - 24123 Bergamo - Italy
Tel.: +39 035.395.111 - Telefax: +39 035.395.306-433

http://www.abb.com